

Z:\2019-5052 Joy Lieser - Maple Leaf Crossings Calumet Avenue - Munster\dwg\2019-5052.dwg 5/10/2020 2:20:27 PM CDT


MAPLE LEAF CROSSINGS

A PLANNED UNIT DEVELOPMENT TO THE TOWN OF MUNSTER, LAKE COUNTY, INDIANA

INDEX	
PAGE	DESCRIPTION
COVER	TITLE PAGE
C-1.0	EXISTING TOPOGRAPHY & UTILITIES
C-1.1	DEMOLITION PLAN
C-2.0	SITE PLAN
C-3.0	SANITARY SEWERS & WATERMAIN PLAN
C-4.0	STORM SEWERS & GRADING PLAN
C-5.0 TO C-5.3	DETAILS & SPECIFICATIONS
C-6.0	STORM WATER POLLUTION PREVENTION PLAN
C-7.0 TO C-7.1	STORM WATER POLLUTION PREVENTION PLAN DETAILS & SPECIFICATIONS
1 OF 1	FINAL PLAT

Legal Descriptions:
PARCEL 1
Lot 1 in Munster Business Complex, a Planned Unit Development, in the Town of Munster, as per plat thereof, recorded in Plat Book 110, page 02 in the Office of the Recorder, Lake County, Indiana.

PARCEL 2
Part of the Southeast Quarter of Section 25, Township 36 North, Range 10 West of the Second Principal Meridian, lying West of Lot 1 in Munster Business Complex, a Planned Unit Development, in the Town of Munster, as per plat thereof, recorded in Plat Book 110, page 02 in the Office of the Recorder, Lake County, Indiana, and North of Canadian National Railroad right-of-way, being more particularly described as follows: Commencing at the Northeast corner of said Section 25; thence South 00° 26' 30" West, along the East line of said Section 25, a distance of 3,054.86 feet; thence North 89° 43' 30" West, along the North line of said Lot 1 extended East, a distance of 756.34 feet to the Northwest corner of said Lot 1 and also being point of beginning; thence South 37° 47' 07" East, along the West line of said Lot 1, a distance of 511.81 feet to the Southwest corner of said Lot 1; thence North 59° 52' 07" West, along the Northerly line of said Canadian National Railroad right-of-way (100 feet wide), a distance of 265.99 feet; thence North 37° 47' 07" West, a distance of 343.63 feet; thence South 89° 43' 30" East, a distance of 127.01 feet to the point of beginning, containing 0.982 acres, more or less, all in the Town of Munster, Lake County, Indiana.

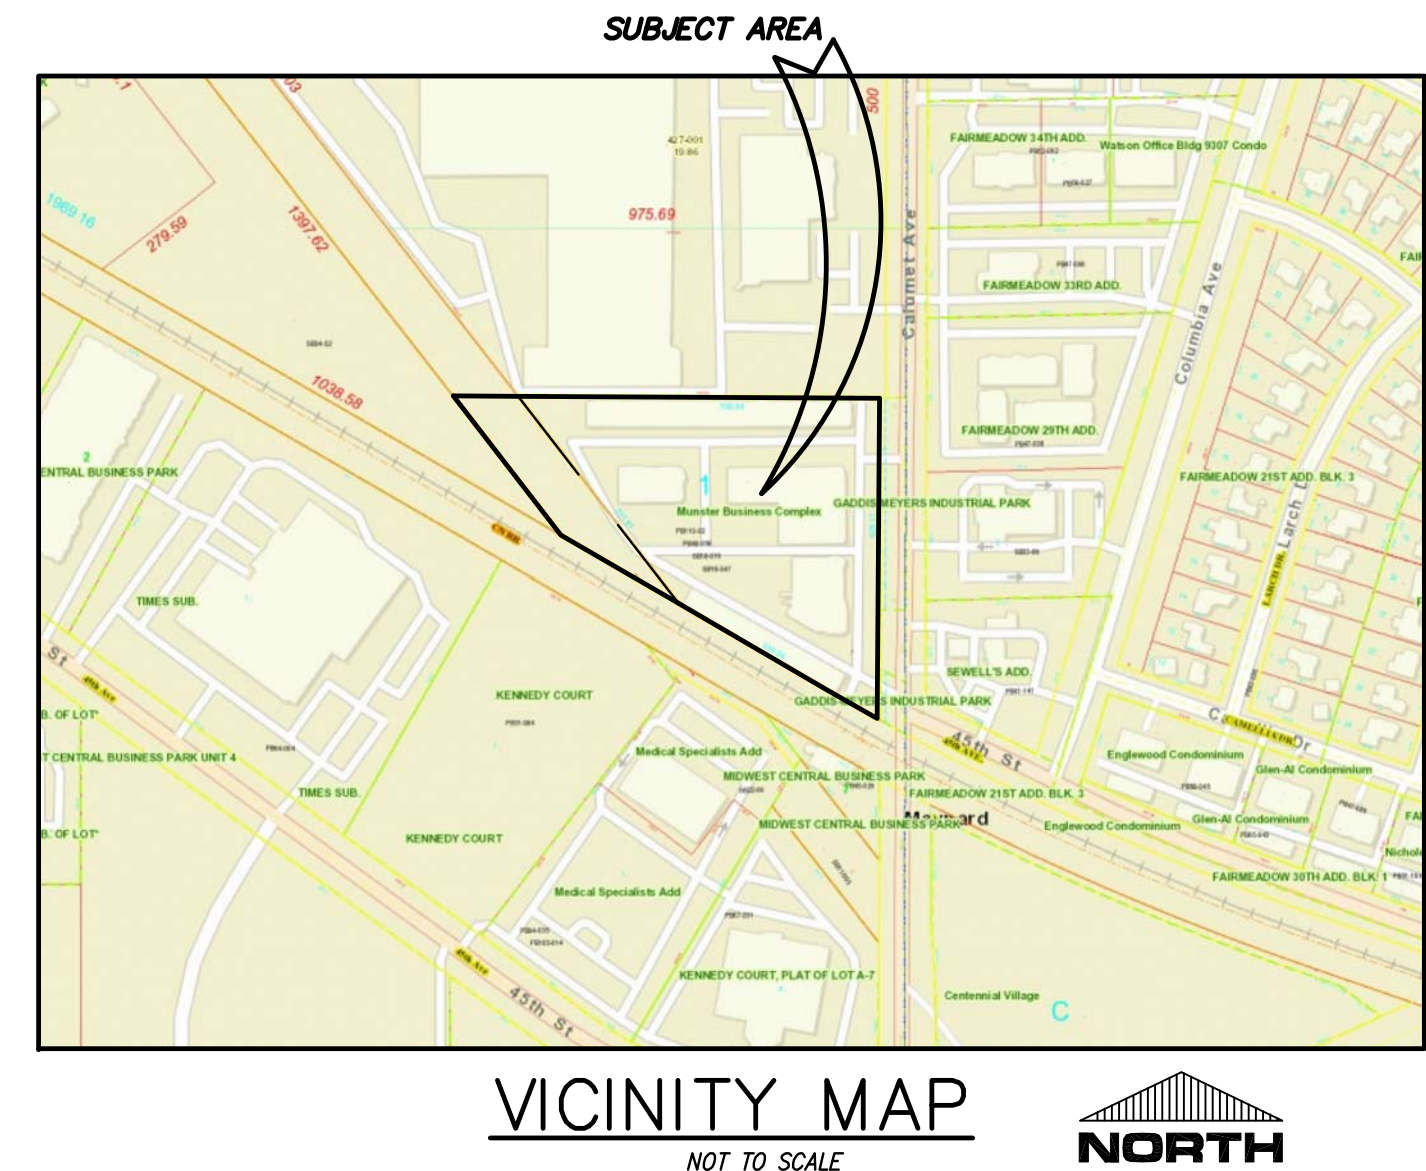

- NOTES:
- TOTAL SITE AREA = 7.049± (ACRES) 307,066± (S.F)
 - THIS PROPERTY IS LOCATED IN FLOOD ZONE "X", AREAS DETERMINED TO BE OUTSIDE OF THE 0.2% ANNUAL CHANCE FLOODPLAIN AS TAKEN FROM THE FLOOD INSURANCE RATE MAP (FIRM) FOR MUNSTER, LAKE COUNTY, INDIANA, MAP NUMBER 18089C0117E, EFFECTIVE DATE JANUARY 18, 2012.

TBM #2 - MAG. NAIL SET LOCATED ALONG THE EAST SIDE OF CALUMET AVENUE AT CONCRETE SIDEWALK, 120 FEET SOUTH OF THE NORTH LINE OF LOT 1 IN MUNSTER BUSINESS COMPLEX, ELEVATION 616.73.
 - BENCHMARK(S):
TBM #1 - FIRE HYDRANT LOCATED ALONG THE WEST SIDE OF CALUMET AVENUE, 85.65 FEET SOUTH OF THE NORTHWEST CORNER OF LOT 1 IN MUNSTER BUSINESS COMPLEX, SOUTH SOUTHEAST BOLT ELEVATION 618.87.

TBM #2 - MAG. NAIL SET LOCATED ALONG THE EAST SIDE OF CALUMET AVENUE AT CONCRETE SIDEWALK, 120 FEET SOUTH OF THE NORTH LINE OF LOT 1 IN MUNSTER BUSINESS COMPLEX, ELEVATION 616.73.
 - DEVELOPER:
First Metropolitan Builders
400 Fisher Avenue
Munster, IN 46321
 - EXISTING TOPOGRAPHY AND UTILITIES DATA ARE PROVIDED AND TAKEN FROM TORRENGA SURVEYING, LLC, JOB NO.: 2019-0676 DATED 03-25-2020
 - ALL VERTICAL DATUM IS BASED ON NAVD88.
 - HYDROLOGIC UNIT CODES: 07120003030030- HART DITCH (PLUM CREEK)-DYER DITCH
 - LOCATION:
LATITUDE - 41°32'35" N
LONGITUDE - 87°30'36" W
 - CURRENT ZONING: CD-4A WITH NO GROUND FLOOR RESIDENTIAL USES PERMIT



"IT'S THE LAW"
CALL 2 WORKING DAYS BEFORE YOU DIG
811 or 1-800-382-5544
CALL TOLL FREE
PER INDIANA STATE LAW IC8-1-26.
IT IS AGAINST THE LAW TO EXCAVATE
WITHOUT NOTIFYING THE UNDERGROUND
LOCATION SERVICE TWO (2) WORKING
DAYS BEFORE COMMENCING WORK.

County: Lake
SE Qtr., Sec. 25, T. 36 N. R. 10 W.
Township: MUNSTER


DATE AND REVISIONS:


1	05-11-2020	PRIMARY SUBMITTAL	DT/EMMH
NO.	DATE	DESCRIPTION	BY

CLIENT/OWNER:
First Metropolitan Builders
400 Fisher Avenue
Musnter, IN 46321

PREPARED BY:
Torrenga Engineering, Inc.
907 Ridge Road
Munster, Indiana 46321
(219)836-8918

CERTIFIED BY: DONALD C. TORRENGA
P.E. # 19868

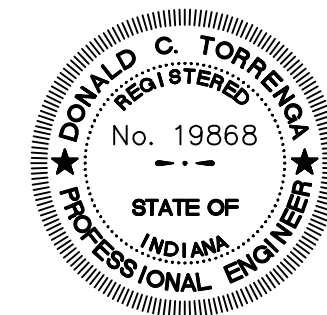

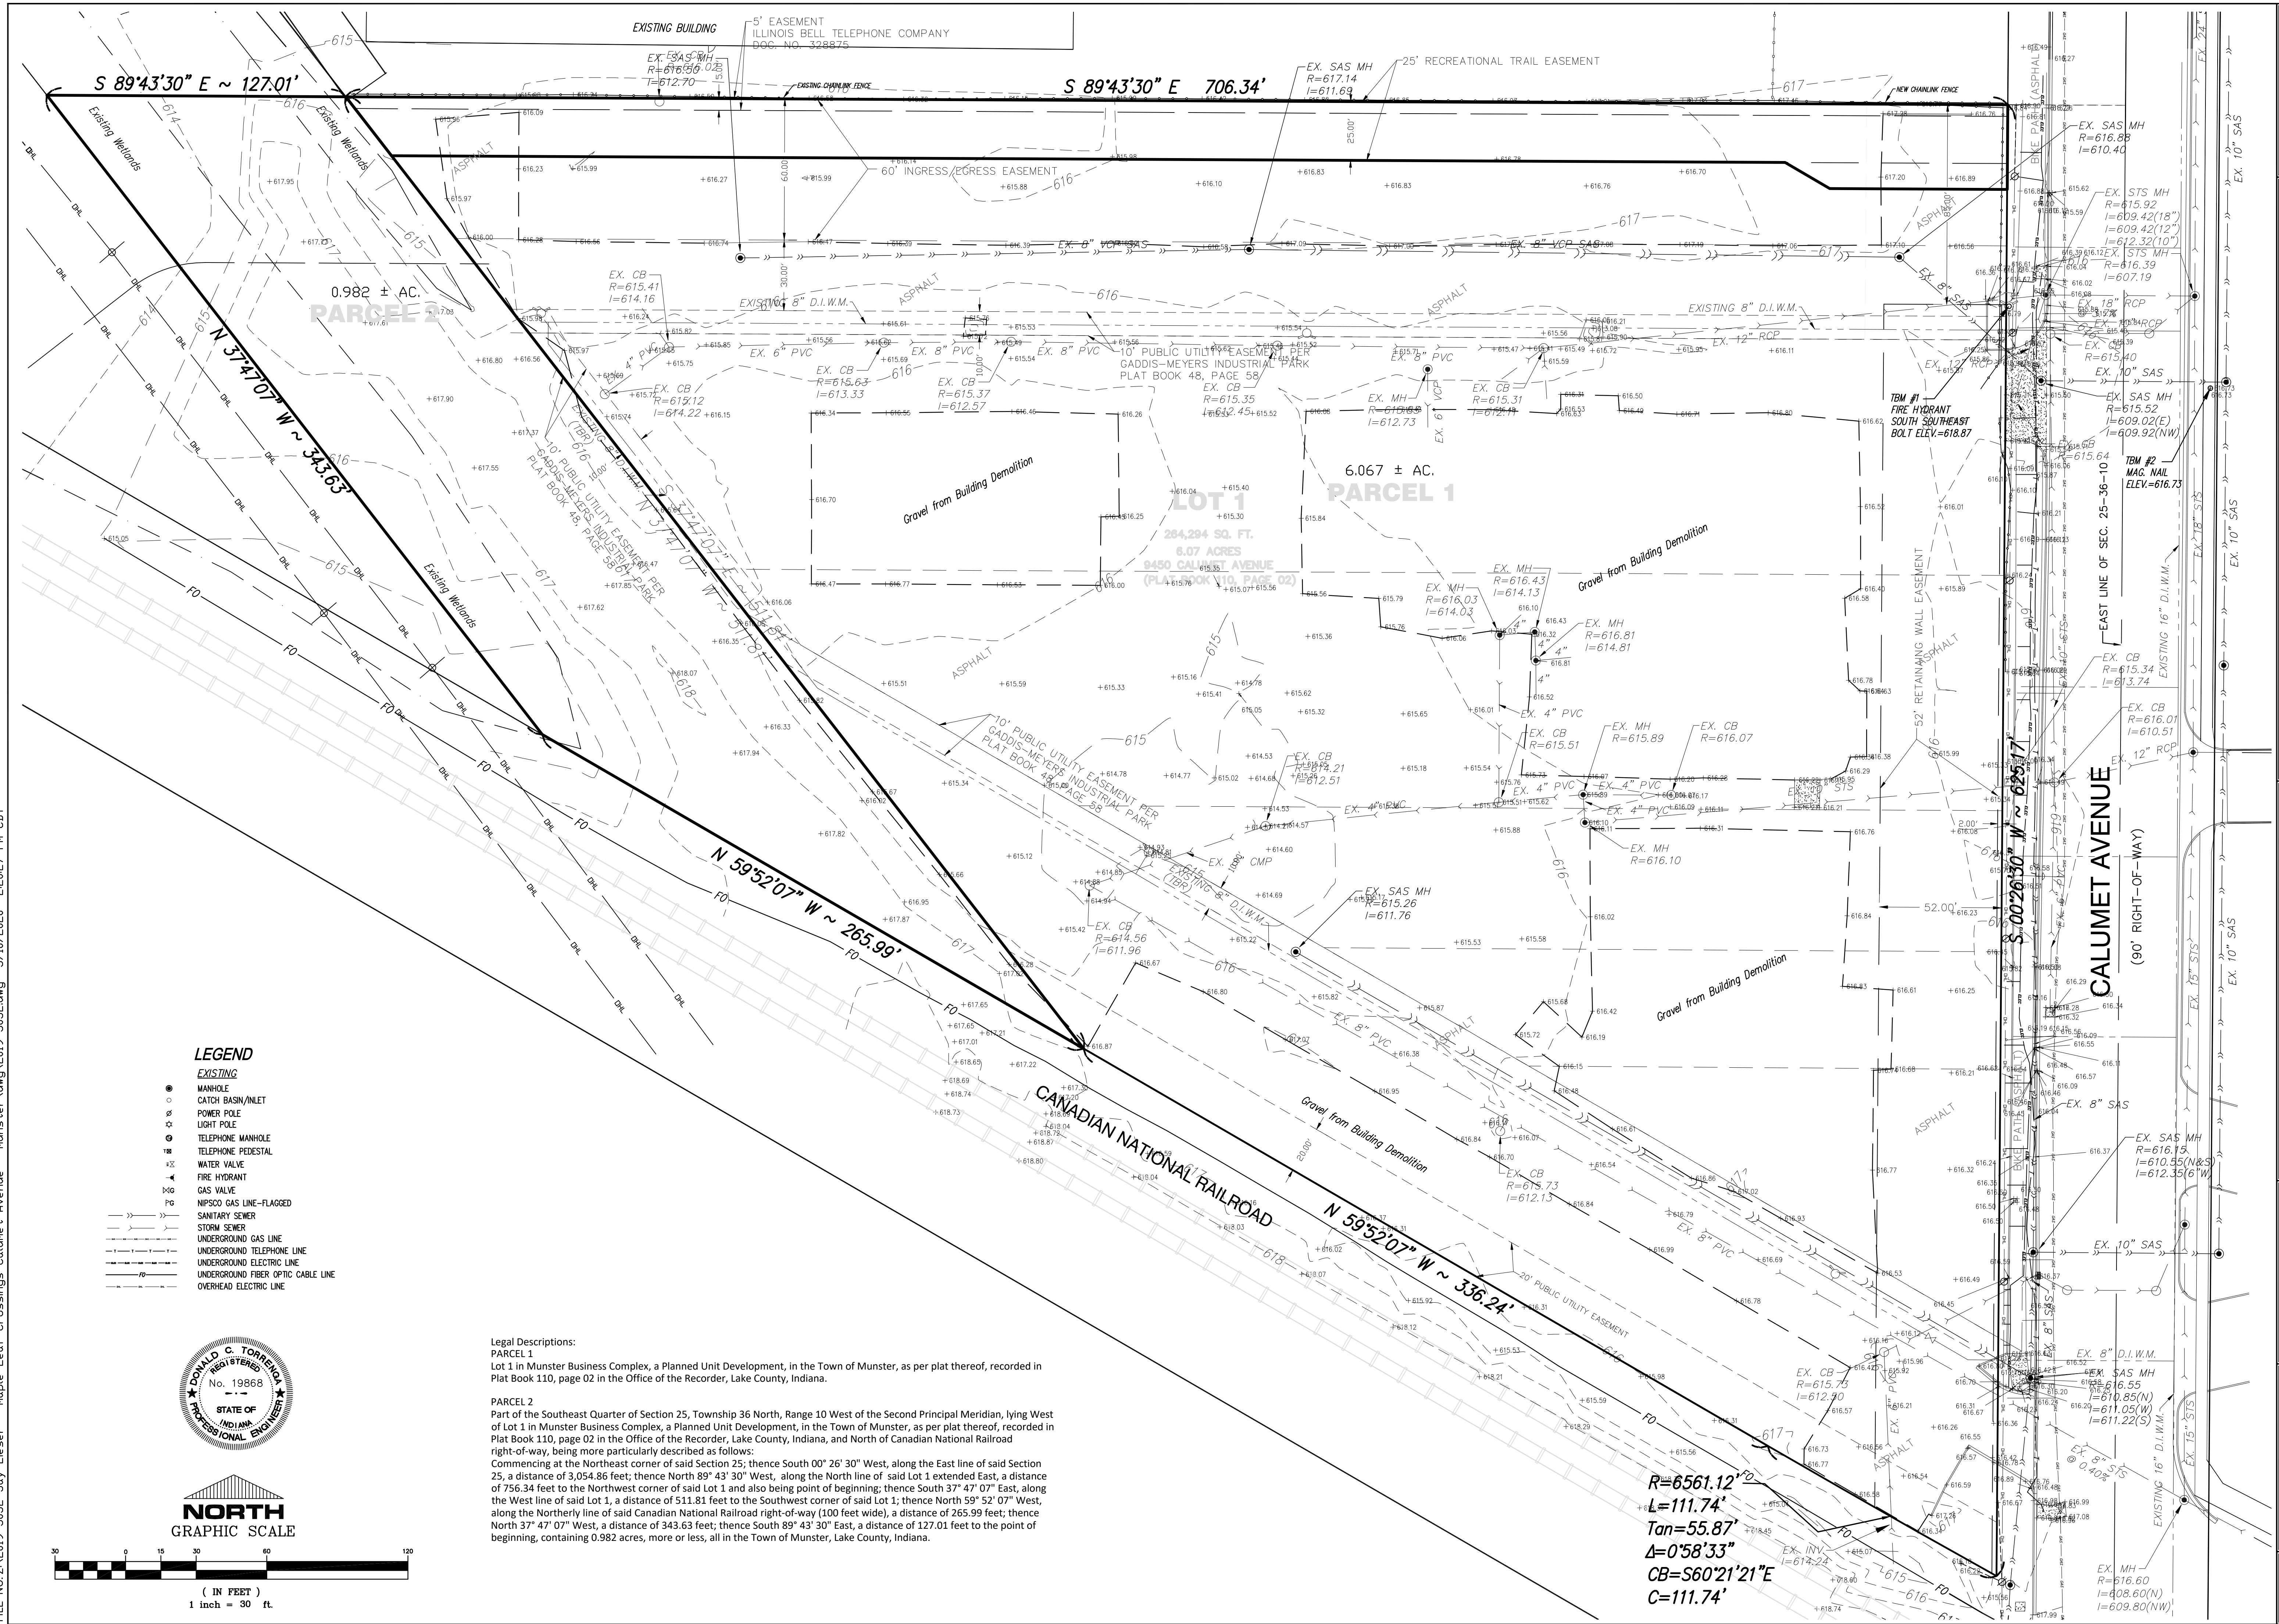

MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
EXISTING TOPOGRAPHY & UTILITIES


DATE OF REVISIONS:

First Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321

JOB NO: 2019-5052

SCALE: 1" = 30'

SHEET
C-1.0

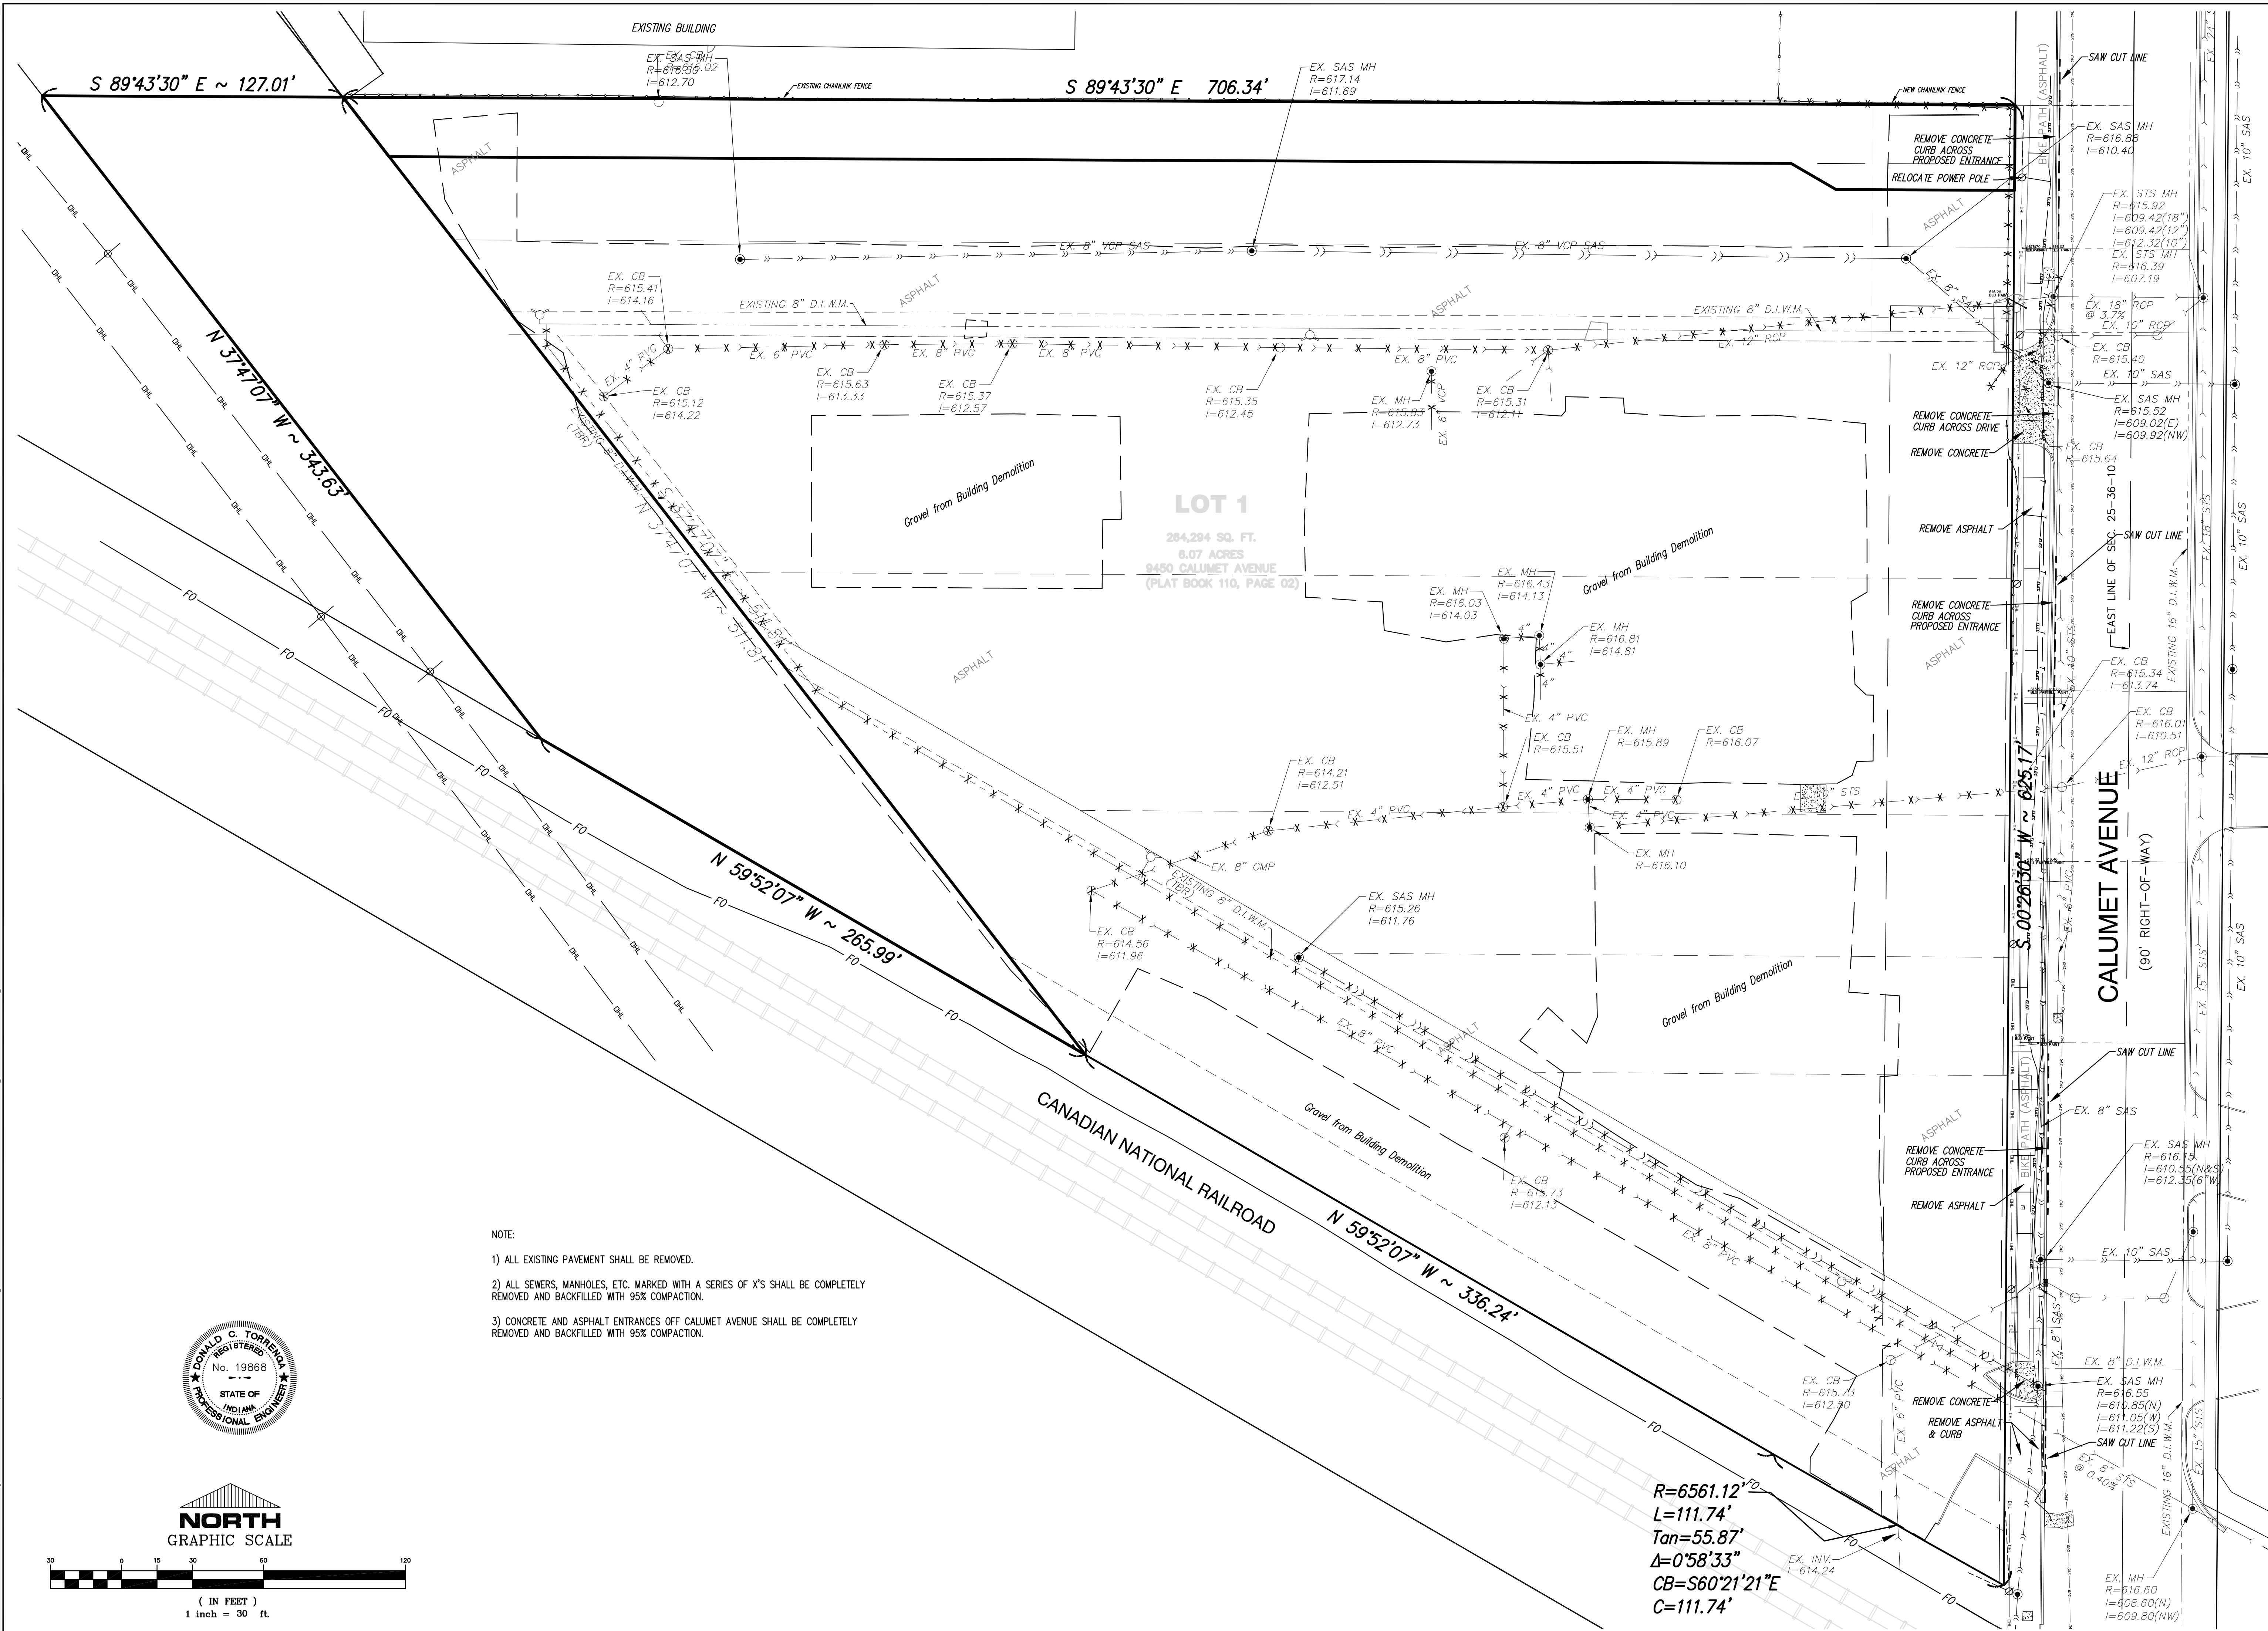

MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
DEMOLITION PLAN


TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321
Tel. No.: (219) 836-8918
website: www.torrennga.com

CLIENT:
First Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321

JOB NO: 2019-5052

SCALE: 1" = 30'

SHEET
C-1.1

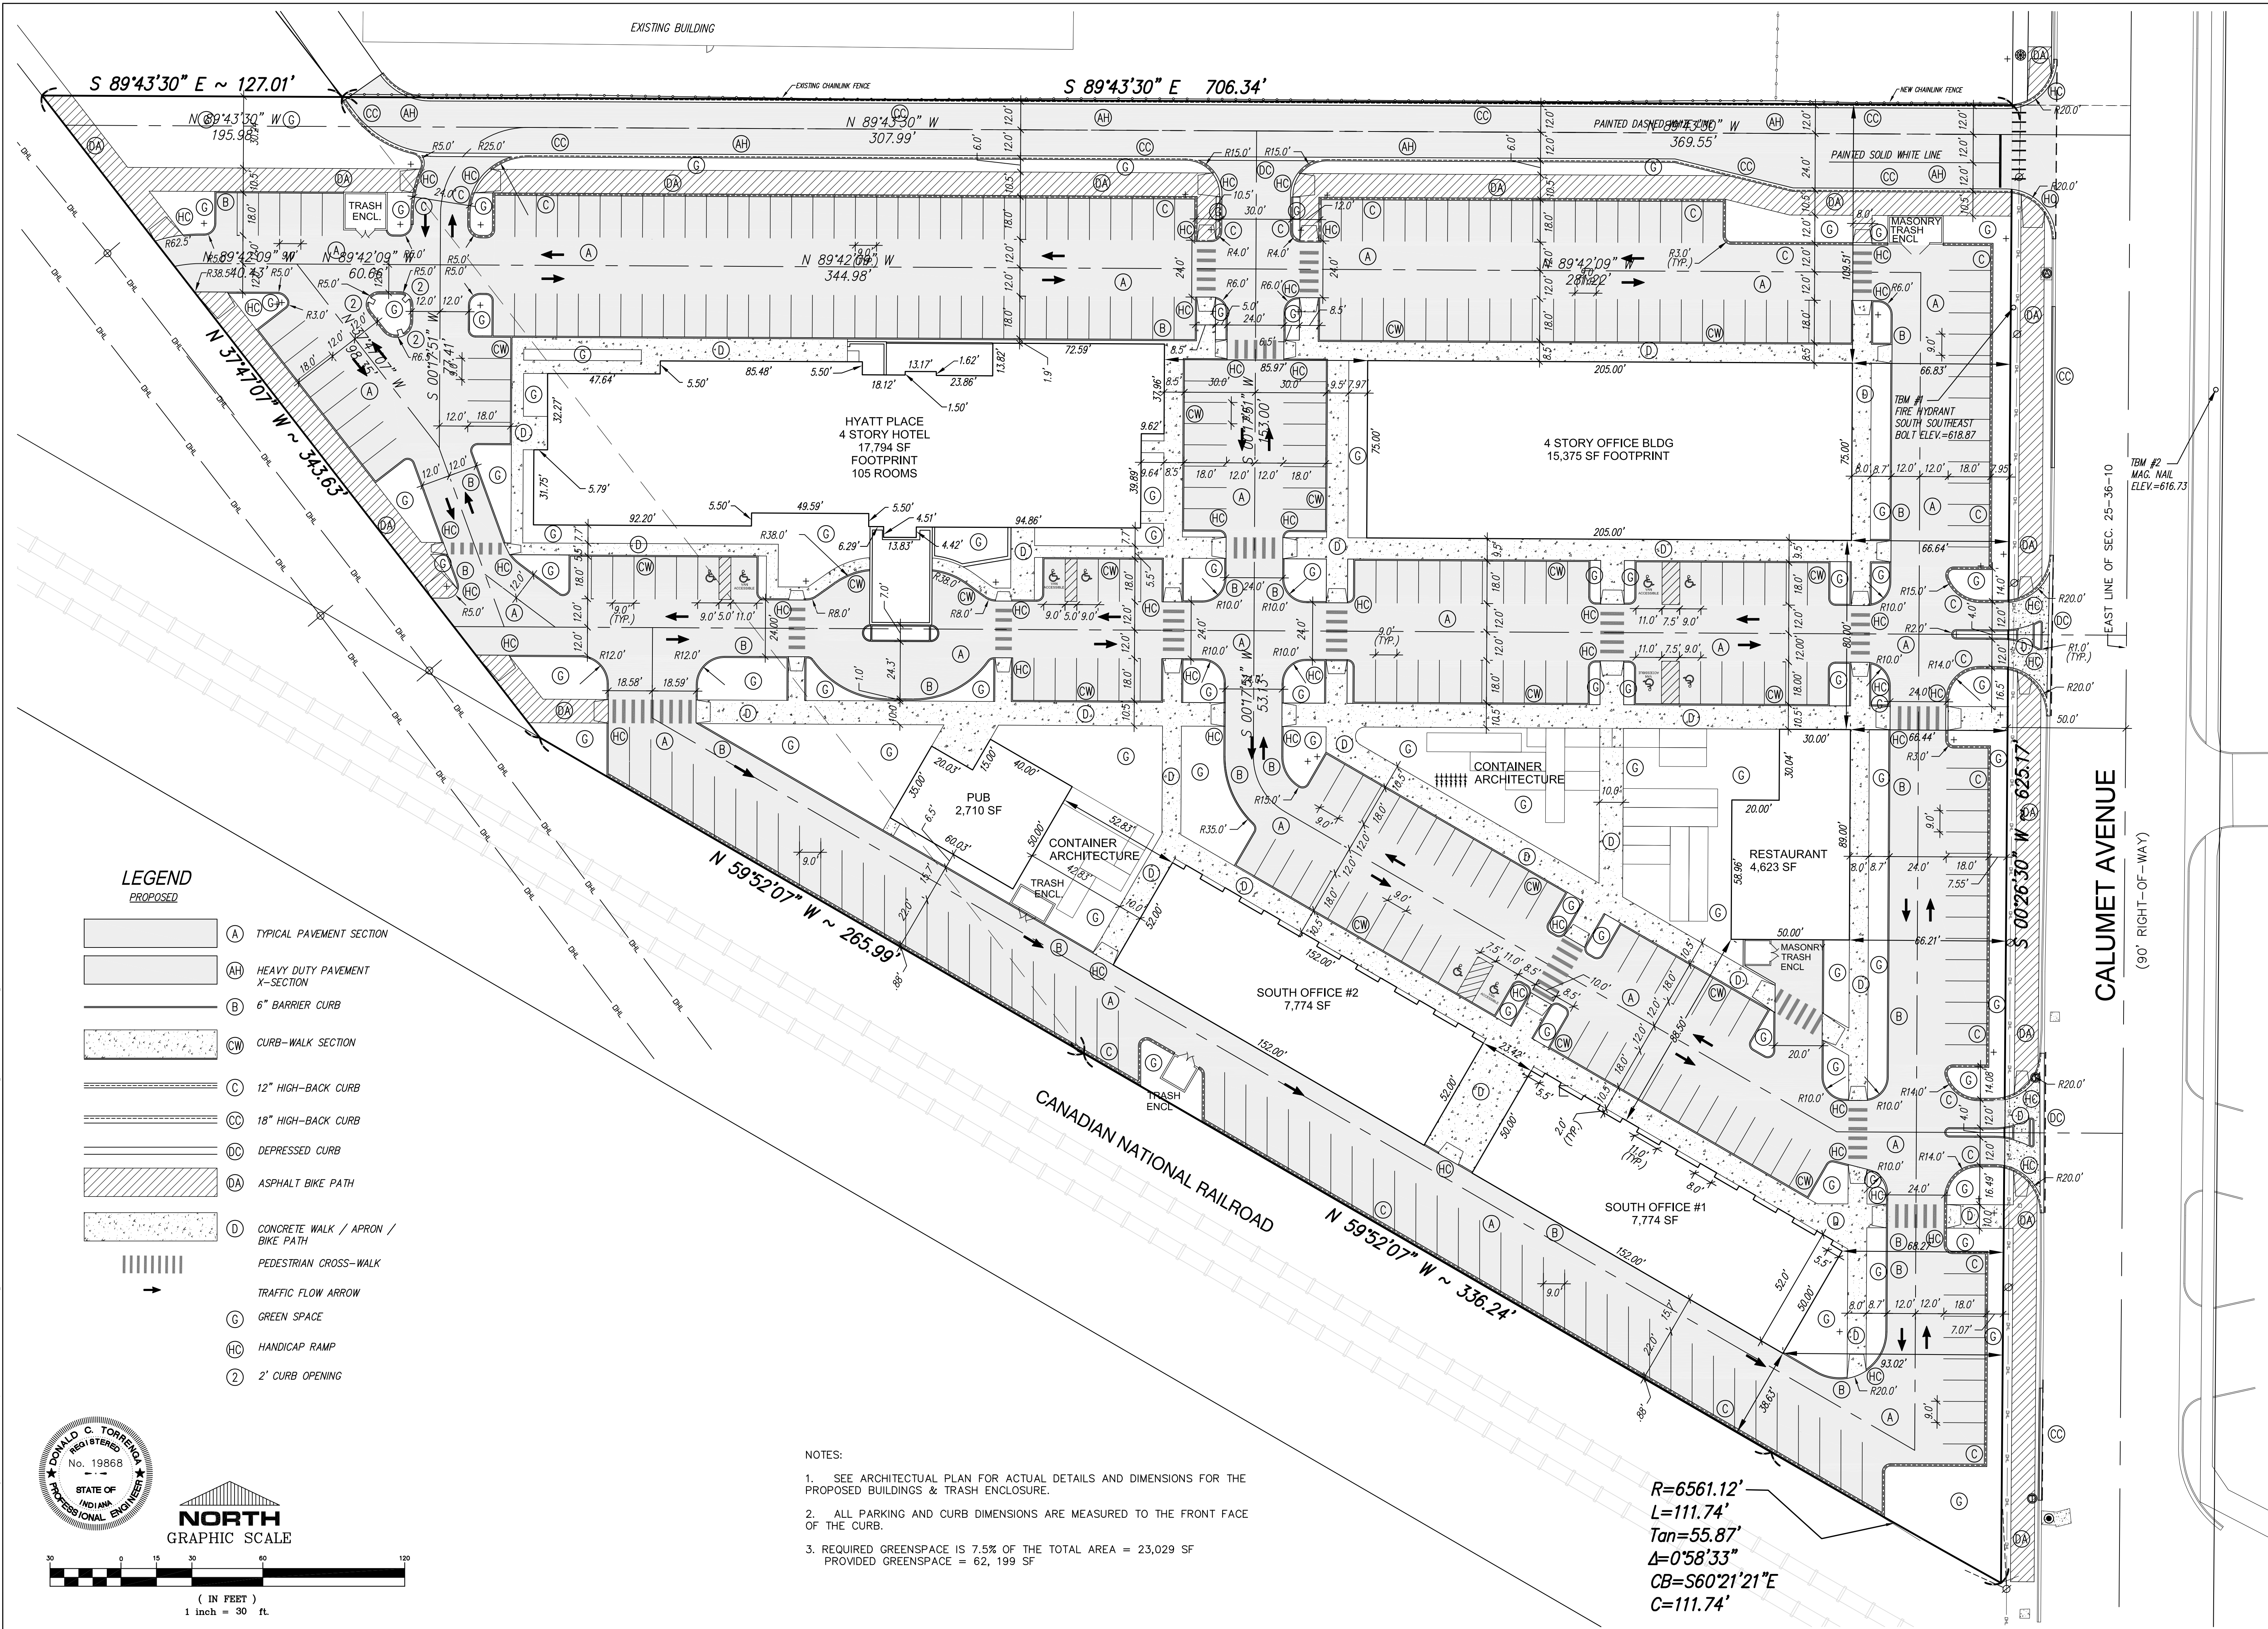

TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321
Tel. No.: (219) 836-8918
website: www.torrennga.com


MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
SITE PLAN


CLIENT: Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321

JOB NO: 2019-5052
SCALE: 1" = 30'

REVISIONS:
DATE: 05-11-2020

SHEET
C-2.0

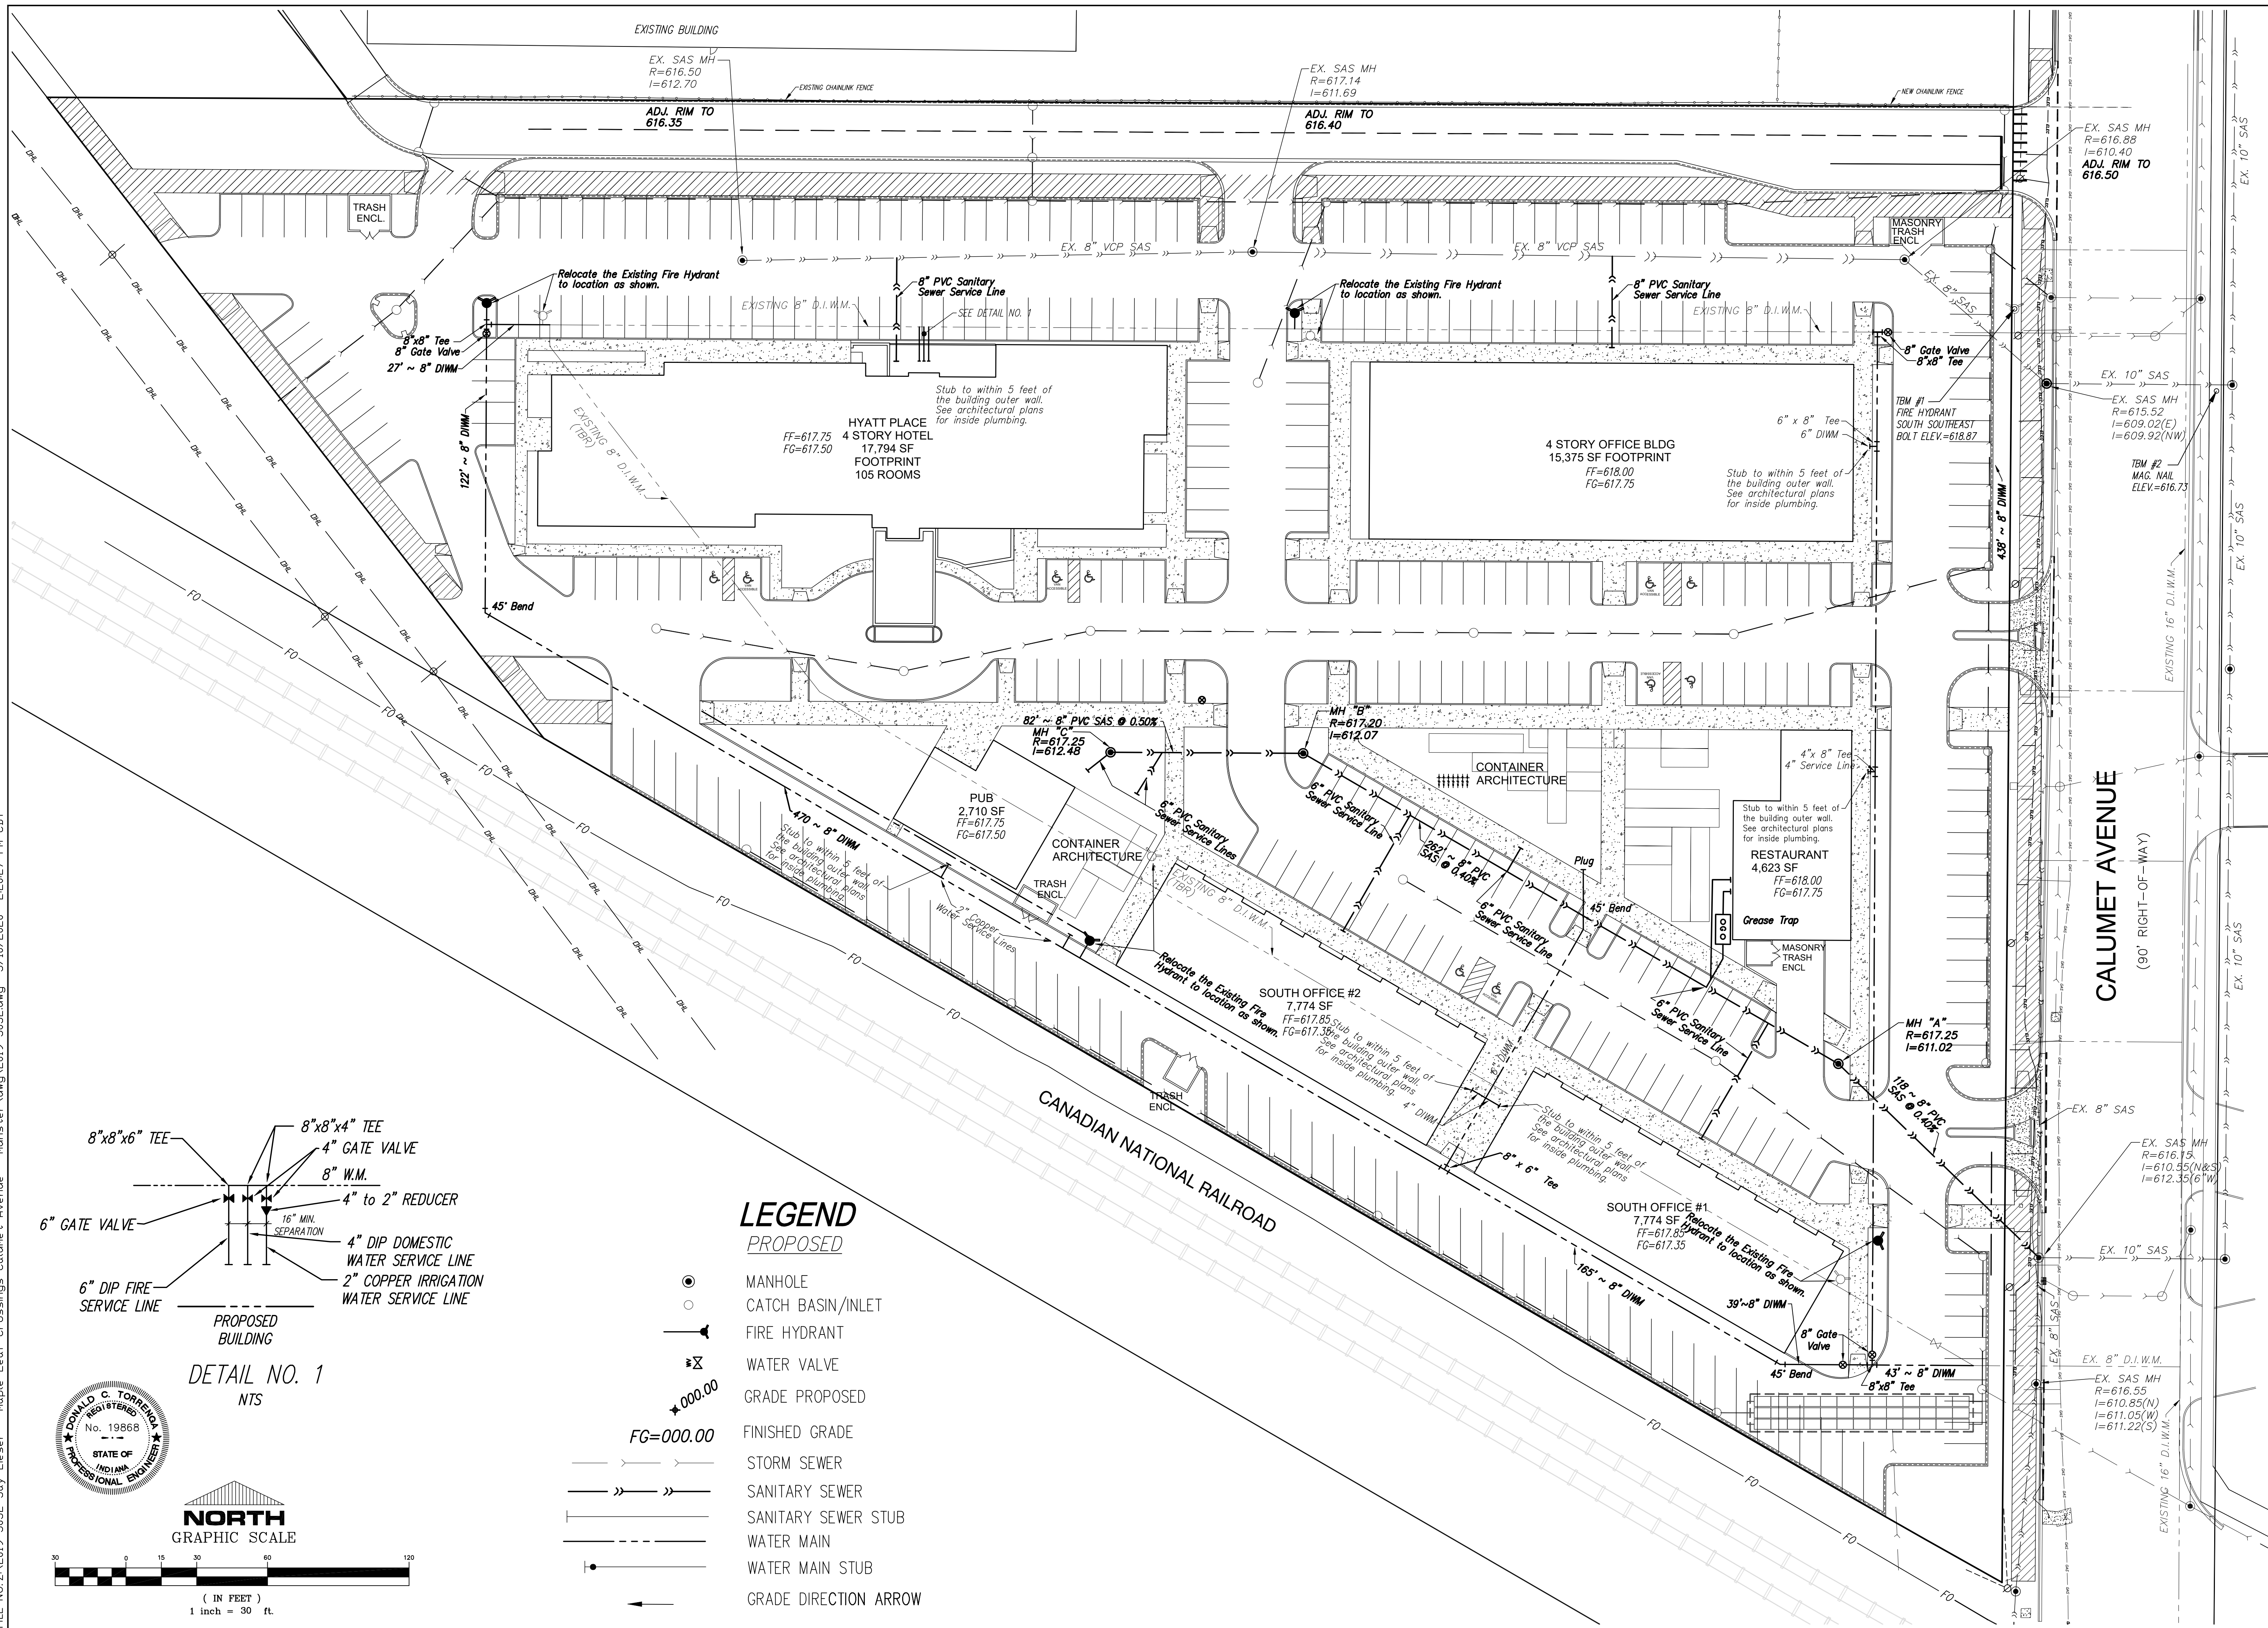

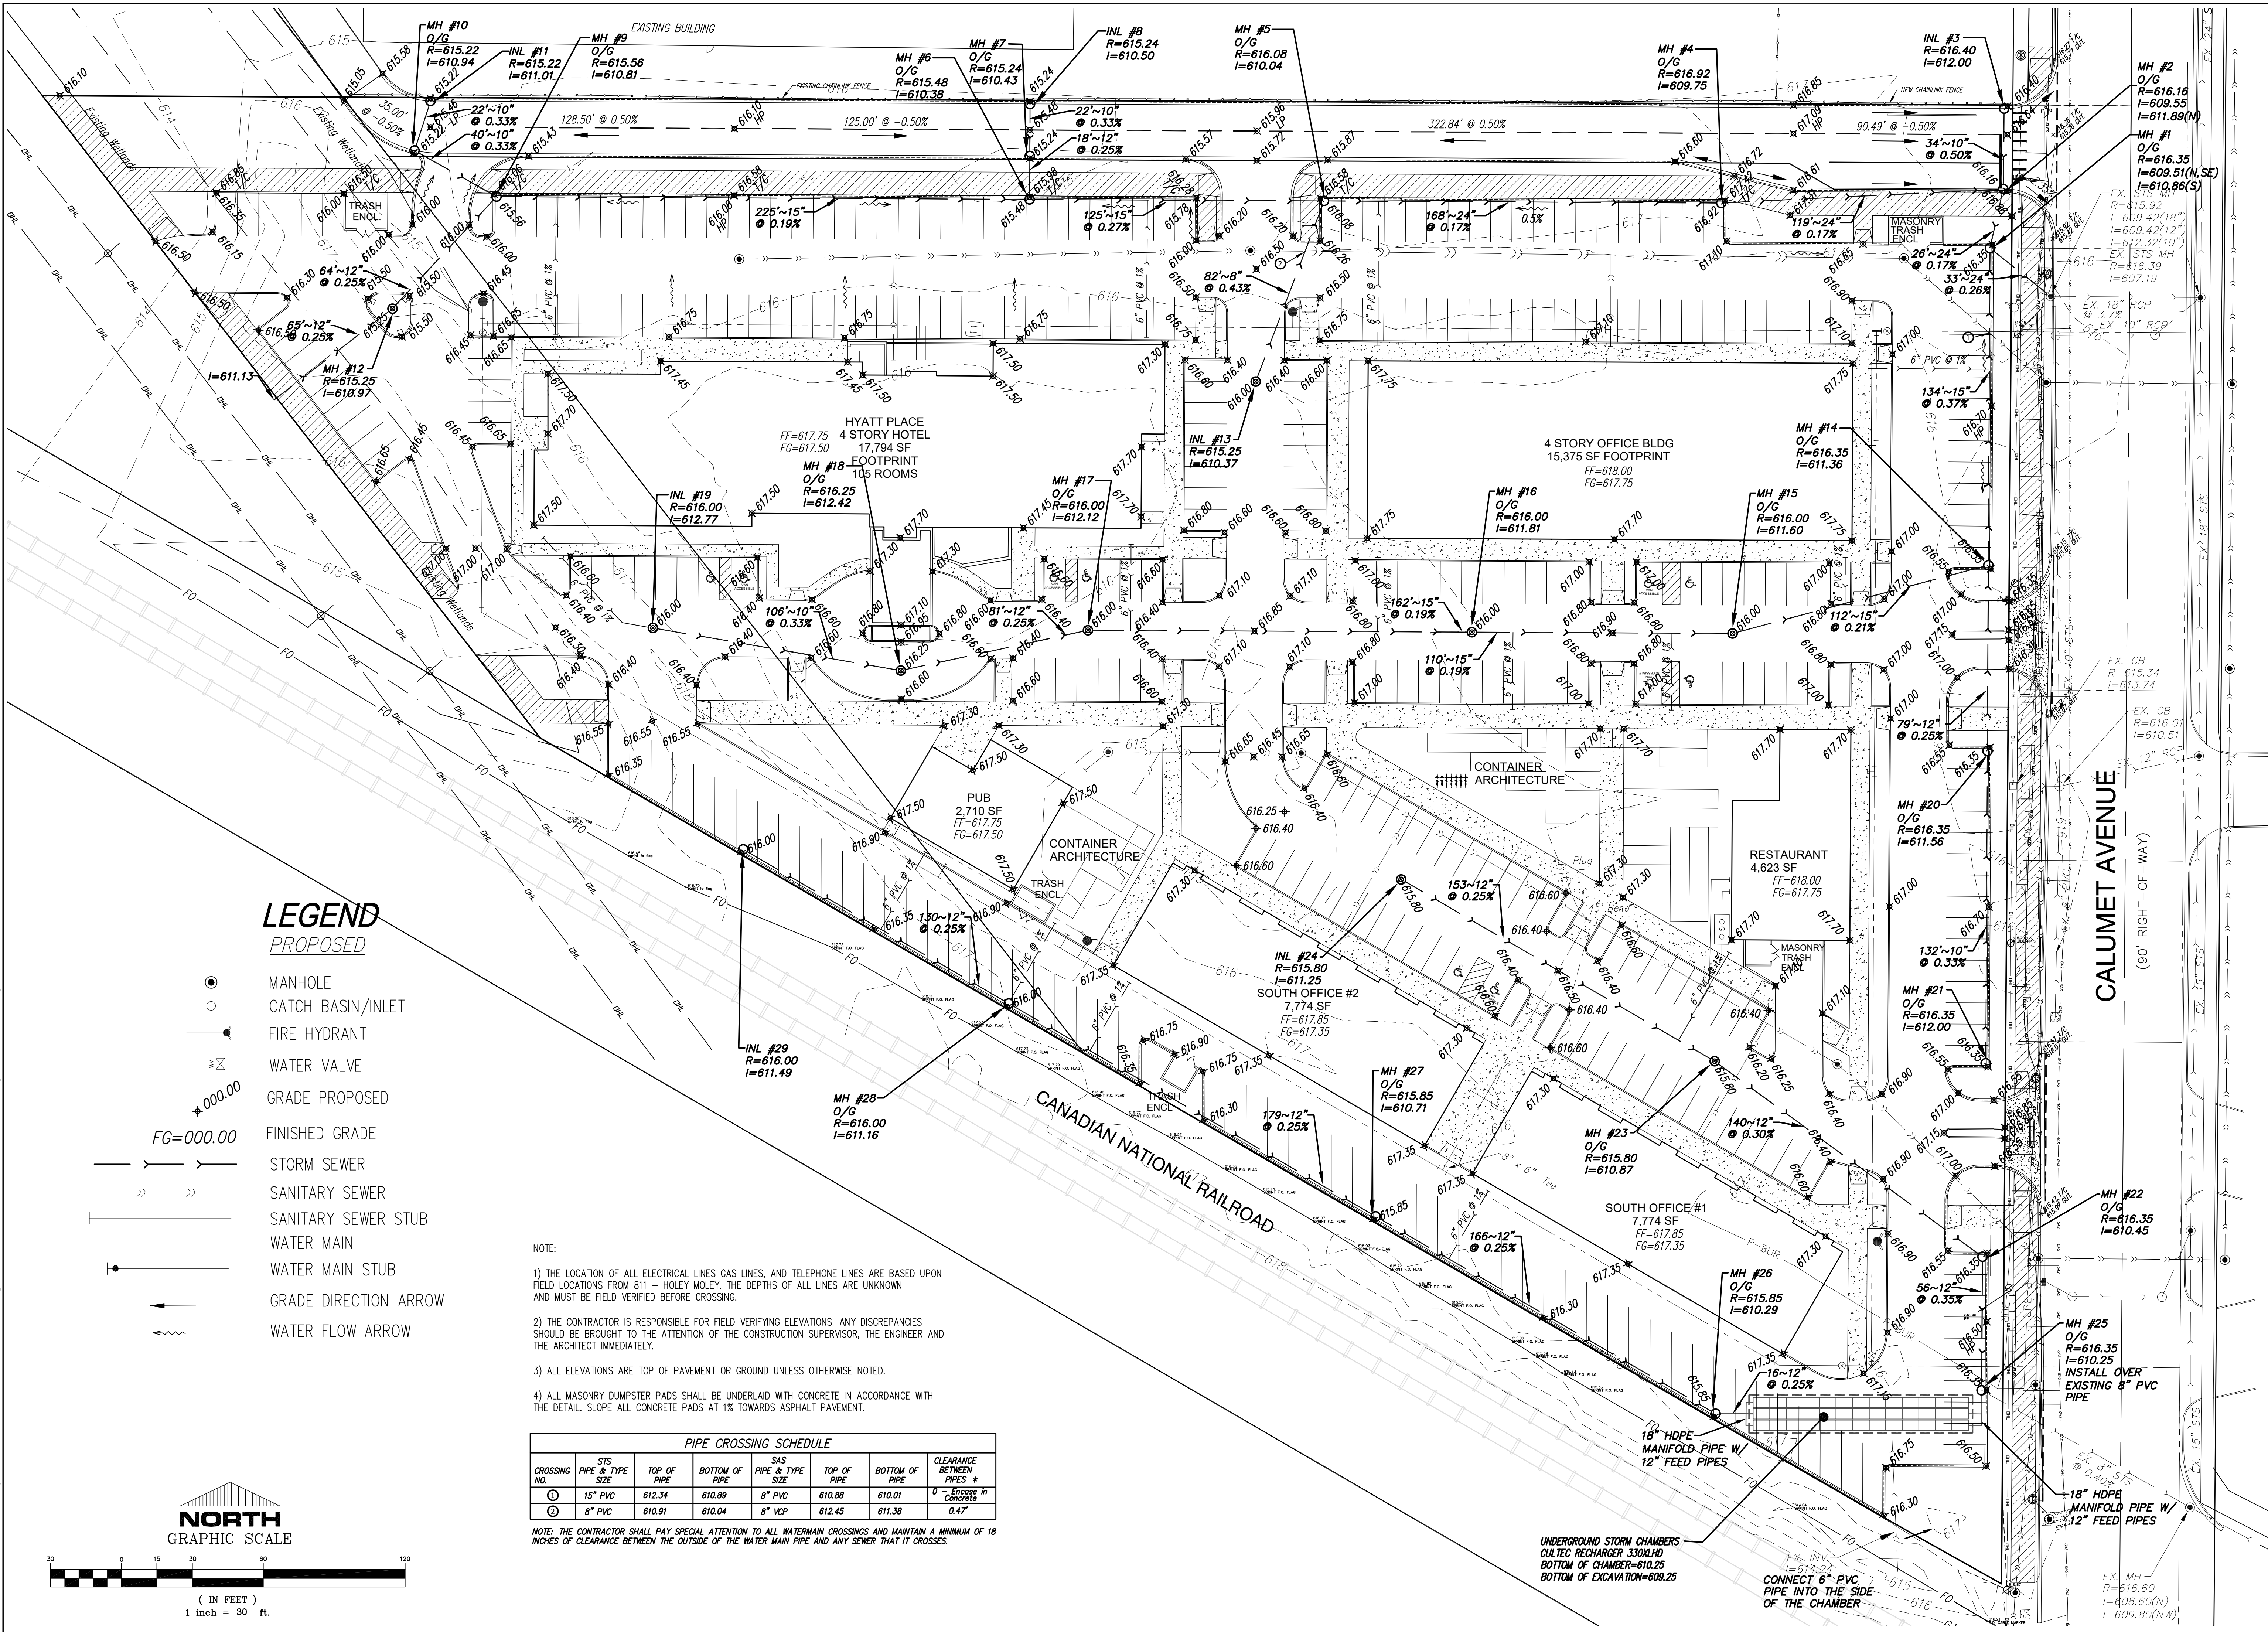

LEGEND
PROPOSED

- MANHOLE
- CATCH BASIN/INLET
- FIRE HYDRANT
- WATER VALVE
- GRADE PROPOSED
- FINISHED GRADE
- STORM SEWER
- SANITARY SEWER
- SANITARY SEWER STUB
- WATER MAIN
- WATER MAIN STUB
- GRADE DIRECTION ARROW
- WATER FLOW ARROW




(IN FEET)
1 inch = 30 ft.

NOTE:

- 1) THE LOCATION OF ALL ELECTRICAL LINES GAS LINES, AND TELEPHONE LINES ARE BASED UPON FIELD LOCATIONS FROM 811 - HOLEY MOLEY. THE DEPTHS OF ALL LINES ARE UNKNOWN AND MUST BE FIELD VERIFIED BEFORE CROSSING.
- 2) THE CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFYING ELEVATIONS. ANY DISCREPANCIES SHOULD BE BROUGHT TO THE ATTENTION OF THE CONSTRUCTION SUPERVISOR, THE ENGINEER AND THE ARCHITECT IMMEDIATELY.
- 3) ALL ELEVATIONS ARE TOP OF PAVEMENT OR GROUND UNLESS OTHERWISE NOTED.
- 4) ALL MASONRY DUMPSTER PADS SHALL BE UNDERLAID WITH CONCRETE IN ACCORDANCE WITH THE DETAIL. SLOPE ALL CONCRETE PADS AT 1% TOWARDS ASPHALT PAVEMENT.

PIPE CROSSING SCHEDULE							
CROSSING NO.	STS PIPE & TYPE SIZE	TOP OF PIPE	BOTTOM OF PIPE	SAS PIPE & TYPE SIZE	TOP OF PIPE	BOTTOM OF PIPE	CLEARANCE BETWEEN PIPES *
1	15" PVC	612.34	610.89	8" PVC	610.88	610.01	0 - Encase in Concrete
2	8" PVC	610.91	610.04	8" VCP	612.45	611.39	0.47'

NOTE: THE CONTRACTOR SHALL PAY SPECIAL ATTENTION TO ALL WATERMAIN CROSSINGS AND MAINTAIN A MINIMUM OF 18 INCHES OF CLEARANCE BETWEEN THE OUTSIDE OF THE WATER MAIN PIPE AND ANY SEWER THAT IT CROSSES.

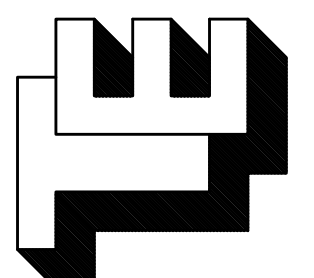

TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321
Tel. No.: (219) 836-8918
website: www.torrenga.com

MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
STORM SEWERS & GRADING PLAN

CLIENT:
First Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321

REVISIONS:
DATE: 05-11-2020

JOB NO: 2019-5052
SCALE: 1" = 30'

SHEET
C-4.0

FILE NO: Z:\2019-5052 Jay Lieser - Maple Leaf Crossings Columnet Avenue - Munster\dwg\2019-5052 Details.dwg 5/10/2020 2:35:45 PM CDT

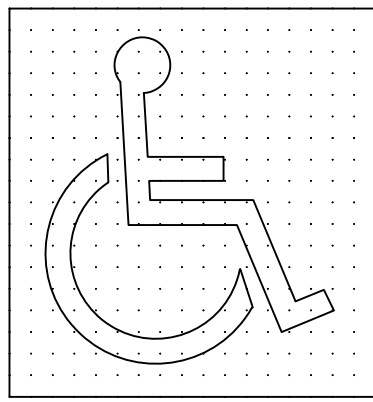


Figure 43a


INTERNATIONAL SYMBOL OF ACCESSIBILITY PROPORTIONS

NOT TO SCALE




ACCESSIBILITY SIGNAGE

NOT TO SCALE

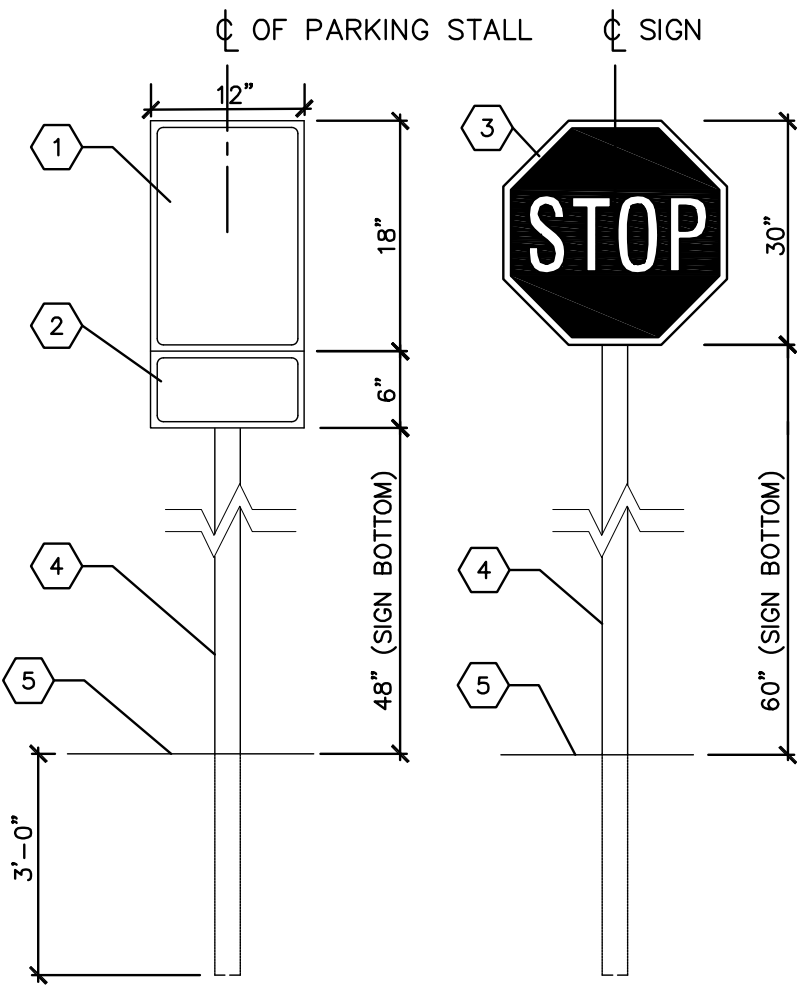


SIGN AND POST (FREE STANDING)

NOT TO SCALE

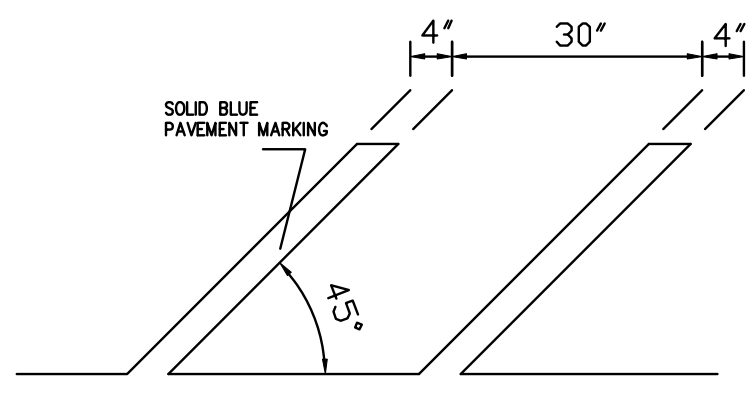


ACCESSIBILITY AND PARKING STRIPING DETAIL

NOT TO SCALE

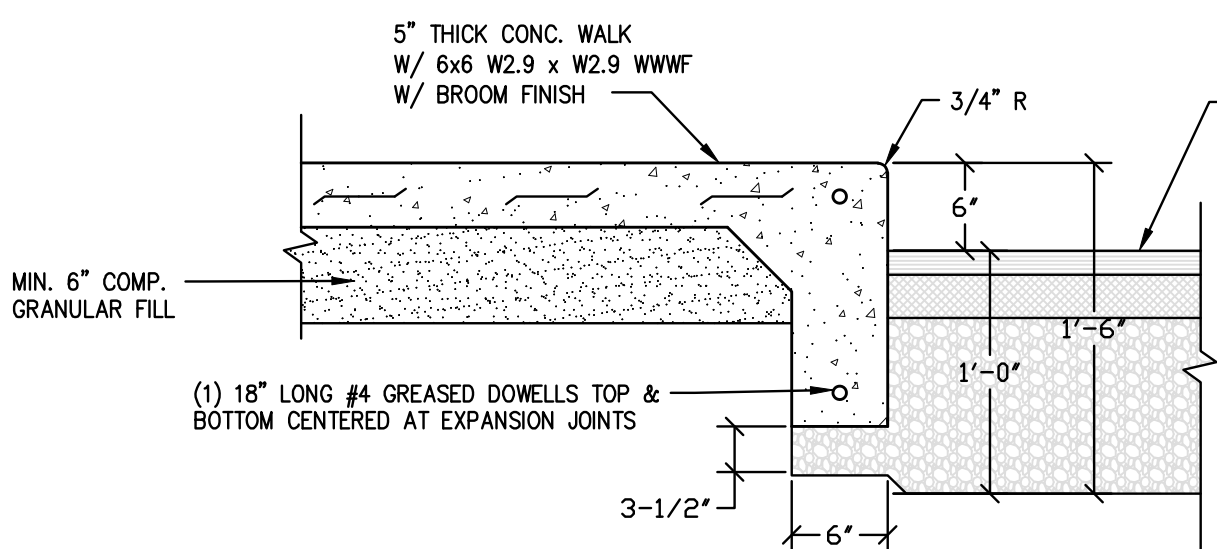


CURB-WALK SECTION

NOT TO SCALE

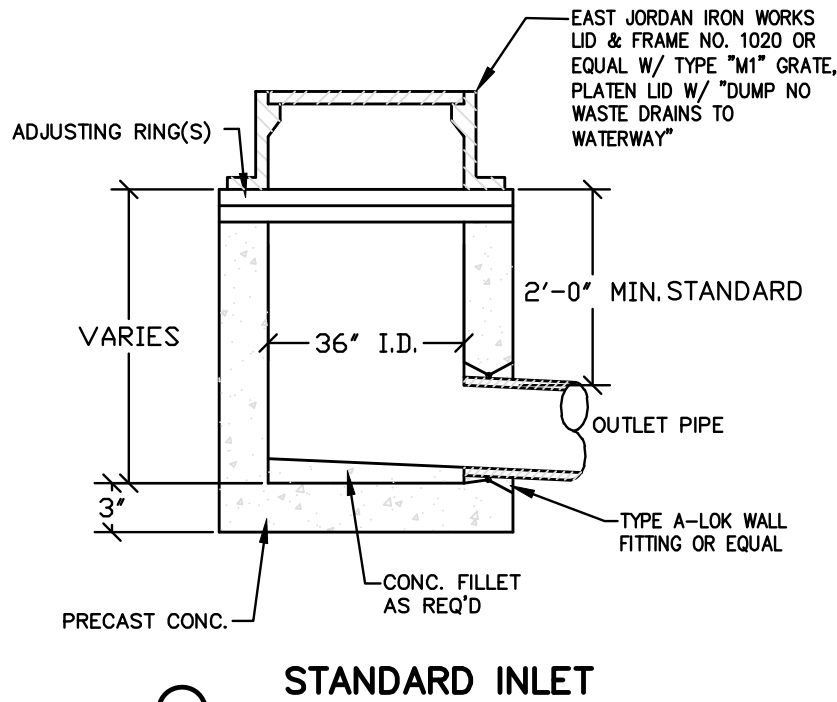


STANDARD INLET

NOT TO SCALE

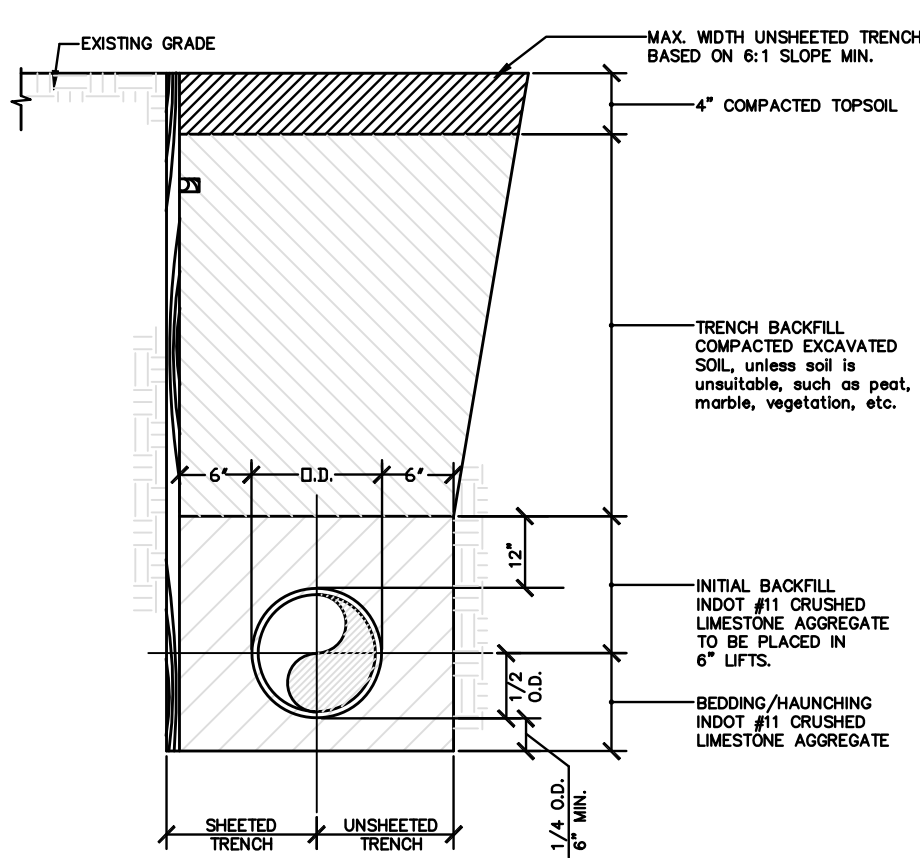


PIPE BEDDING DETAIL FOR TRENCH IN GRASS AREAS

NOT TO SCALE

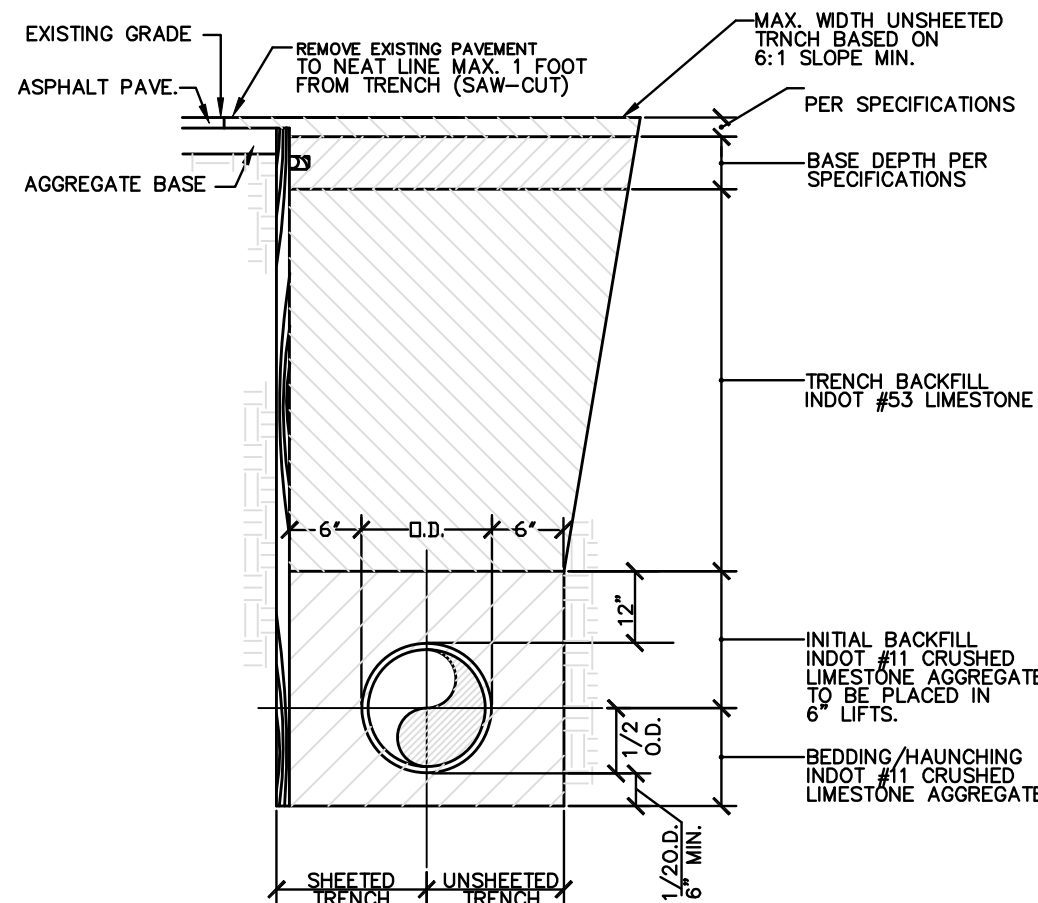

PIPE BEDDING DETAIL FOR TRENCH IN PAVED AREAS


NOT TO SCALE

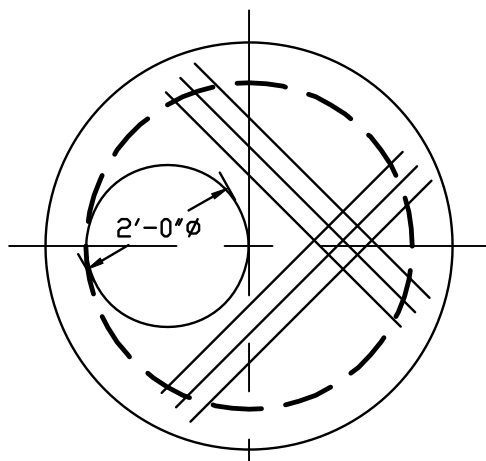

TYPE "C" (FLAT TOP) MANHOLE

NOT TO SCALE


USED WHERE RESTRICTED HEAD ROOM WILL NOT ALLOW FOR TAPERED WALLS

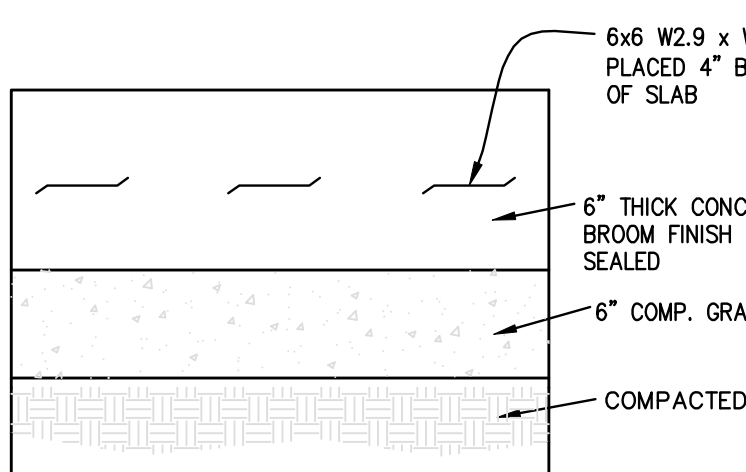

DUMPSTER PAD


SECTION VIEW

NOT TO SCALE

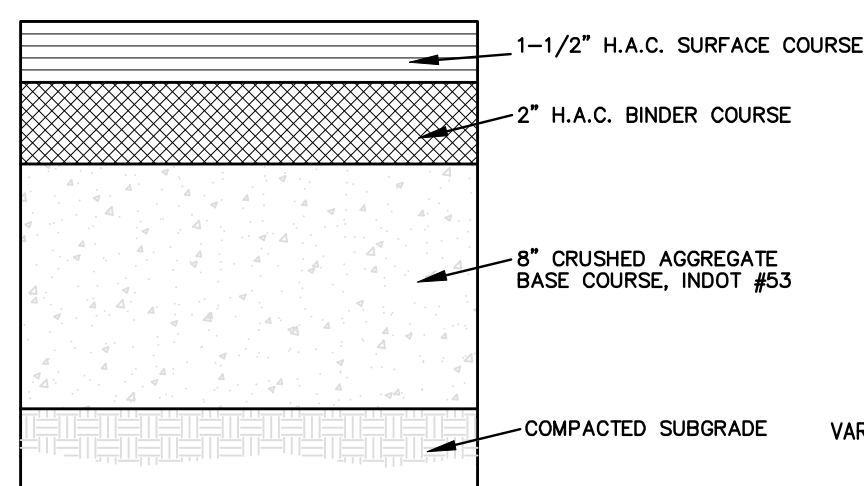

TYPICAL PAVEMENT SECTION


NOT TO SCALE

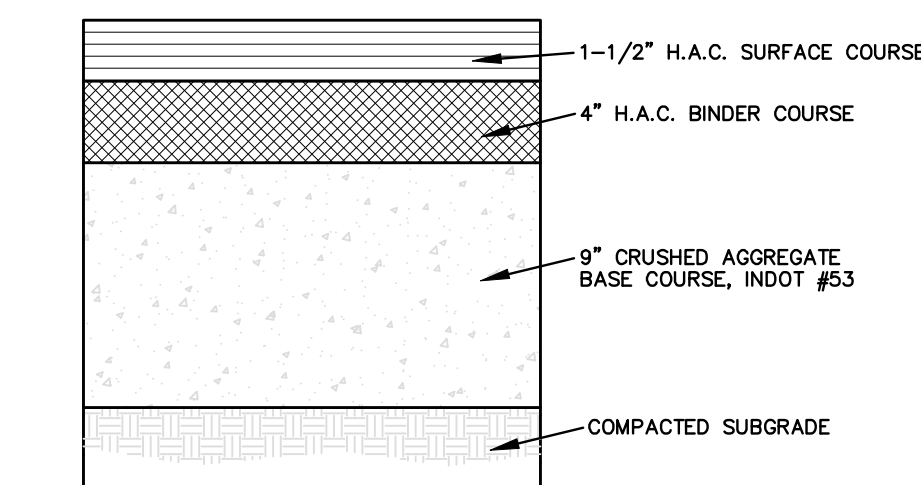

HEAVY DUTY PAVEMENT X-SECTION


NOT TO SCALE

AH

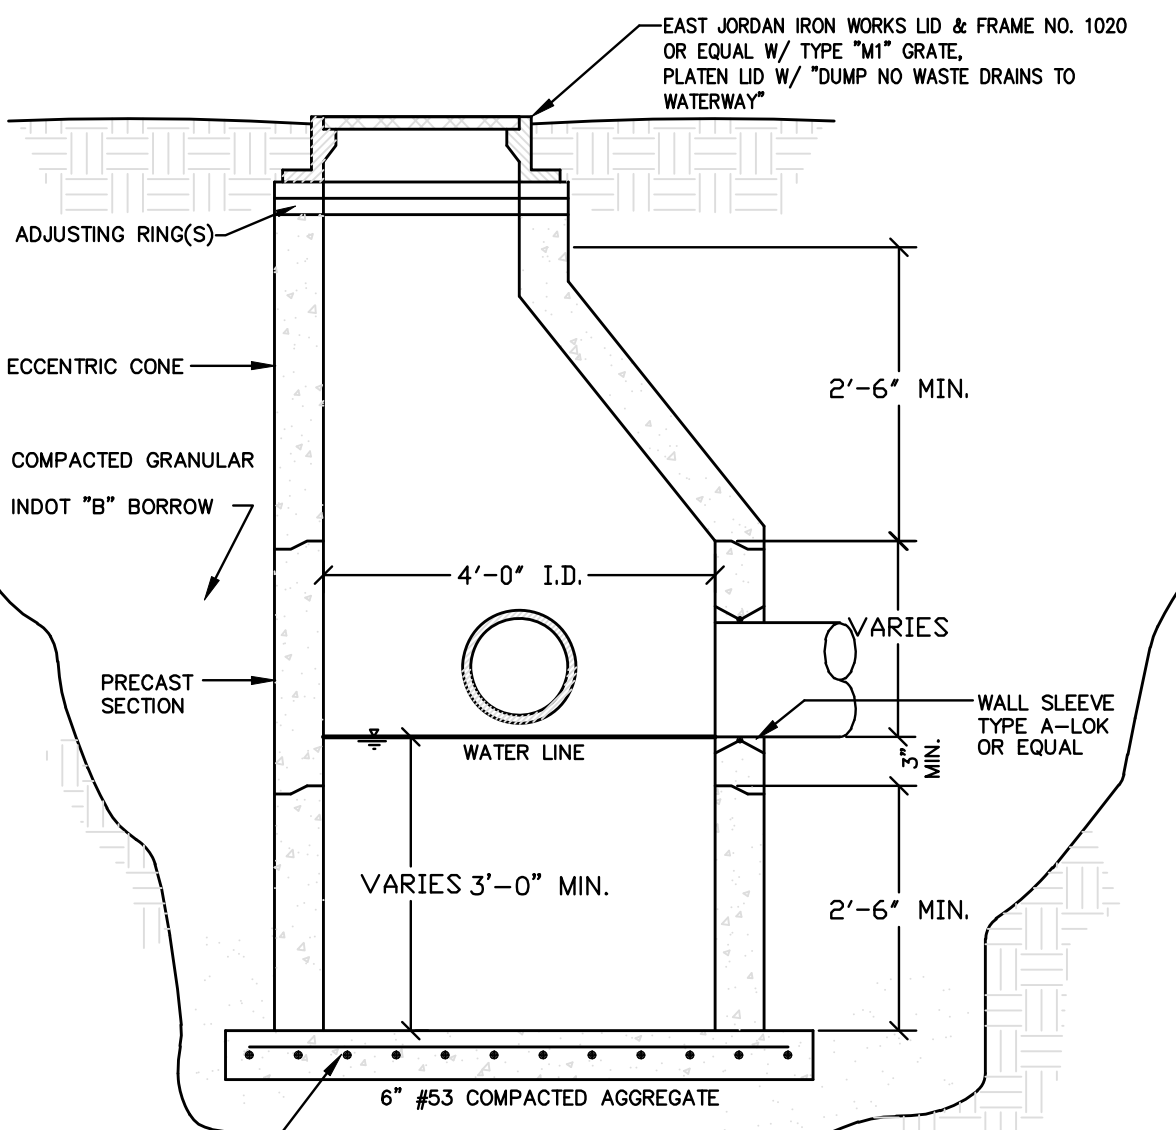


TYPE "A" CATCH BASIN

NOT TO SCALE

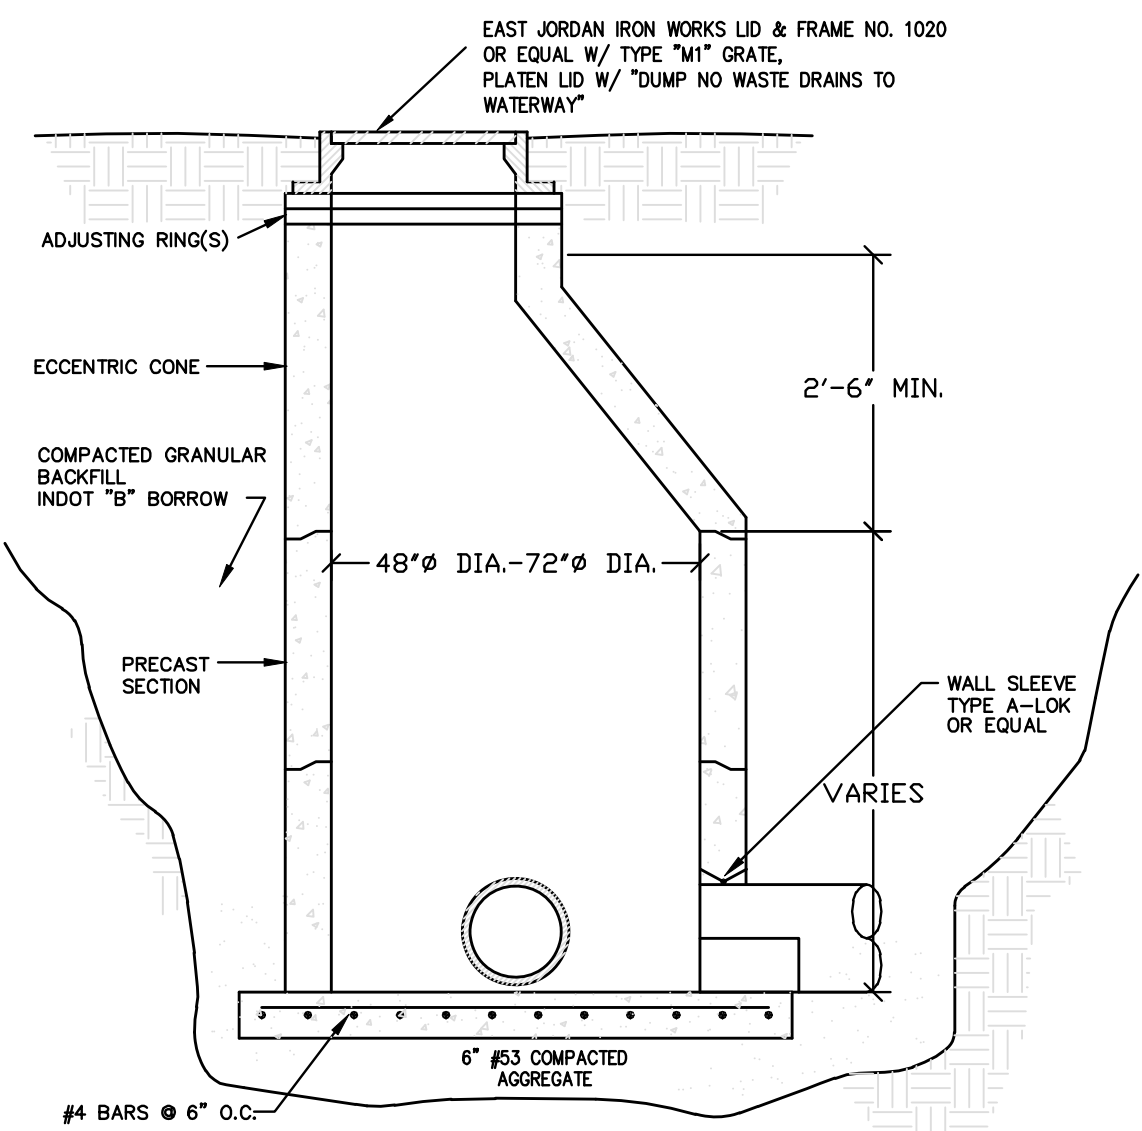


STORM TYPE MANHOLE


NOT TO SCALE

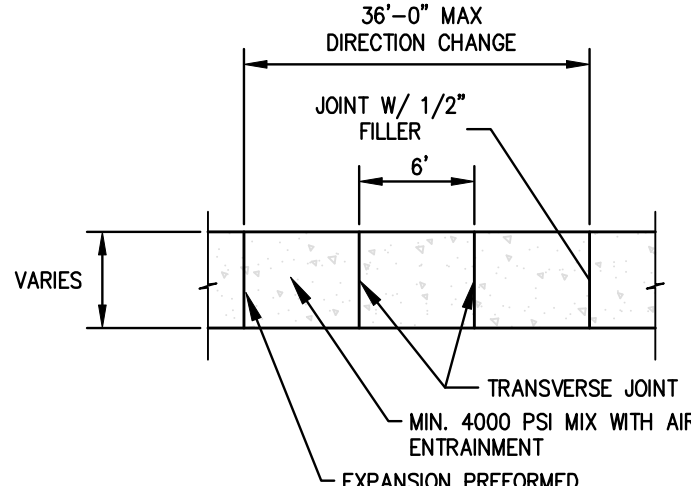

SIDEWALK PLAN

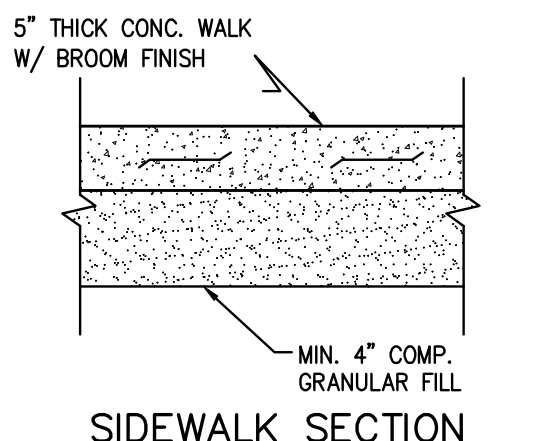

SIDEWALK SECTION

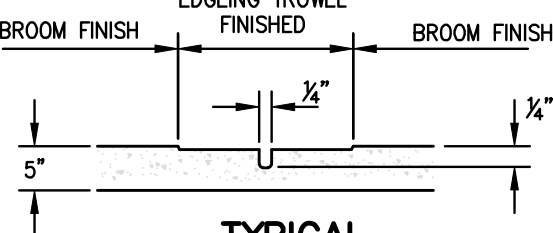

TYPICAL SIDEWALK DETAIL

NOT TO SCALE

D

GENERAL SPECIFICATIONS FOR STORM SEWERS

- All work shall be performed in accordance with the Codes, Ordinances and Standards of the Town of Munster, Lake County, Indiana.
- All storm sewer pipe, branches and fittings shall conform to either of the following: (A) Poly-vinyl chloride SDR 35 or SDR 26 (ASTM D-3034) with push on rubber gasket joints (ASTM C-1212) for pipe 15" in diameter or under or; (B) High Density Polyethylene corrugated pipe with an integrally formed smooth interior (ASTM D-1248) for pipe 18" or over or; (C) Reinforced concrete pipe (ASTM C-76) with bell and spigot or tongue and groove push-on joints. Class V reinforced concrete pipe shall be used for lines 15" diameter or under and Class III shall be used for lines 18" and over.
- Gasketed joints shall be used on all storm sewers.
- Storm sewers 18" to 27" with less than 3' cover shall be Class IV pipe.
- All storm sewer manholes shall be standard precast concrete units (ASTM C-478) conforming with the standard details sheet of these plans.
- All improvements installed across paved or future paved areas shall be backfilled with sand or graded stone aggregate to the subgrade line.
- All sewers shall be laid at least 10 feet (3.0m) horizontally from any existing or proposed water main. The distance shall be measured edge to edge. All sewers crossing water mains shall be laid to provide a minimum vertical distance of 18 inches (46 cm) between the outside of the water main and the outside of the sewer. This shall be the case where the water main is either above or below the sewer. The crossing shall be arranged so that the sewer joints will be equidistant and as far as possible from the water main joints. Where a water main crosses under a sewer, adequate structural support shall be provided for the sewer to prevent damage to the water main. When it is impossible to obtain proper horizontal and vertical separation as stipulated above, the sewer shall be designed and constructed equal to water pipe.
- The Contractor is responsible for the preparation of "As Built" construction drawings showing actual sizes and lengths of pipe installed (i.e. from manhole to manhole or tee to valve, etc.), location of service taps and any structures added or omitted in comparison with these engineering plans. The Contractor shall supply the Developer (through the Project Engineer) with one set of reproducible original "As-Built" and shall supply the Town of Munster with 2 copies thereof prior to and as a condition of final acceptance.
- No storm sewer manhole, catch basin and inlet shall be within eight (8) feet of a water main as measured from the outside edge of the storm sewer manhole, catch basin and inlet to the outside edge of the water main.

CURB NOTE:


- Concrete Curb and Gutter shall be constructed in accordance with the state specifications except as herein modified.

a) Expansion joints shall be 3/4" in thickness, using premolded joint filler material and two 3/4" diameter smooth round dowel bars 30" long fully greased, placed in pairs at the ends of all radii, at roadway intersections, at the junction of new and existing curb, at all cold joints, at a minimum 40' interval between said radii locations.

b) Said dowel shall be placed so that half their length is in either side of the joint. On the same end of each bar, there shall be placed a plastic, premolded expansion tip, which will allow lateral and expansion movement. The dowel bars shall be placed such that they shall be encased in concrete, a minimum of 3" in any direction.


INFRASTRUCTURE NOTE:

- All infrastructure being constructed shall be in accordance with the Town of Munster Proposed Infrastructure Specifications. Any difference Munster's Specification and these engineering drawings shall be brought to the attention of the Engineer immediately for review.

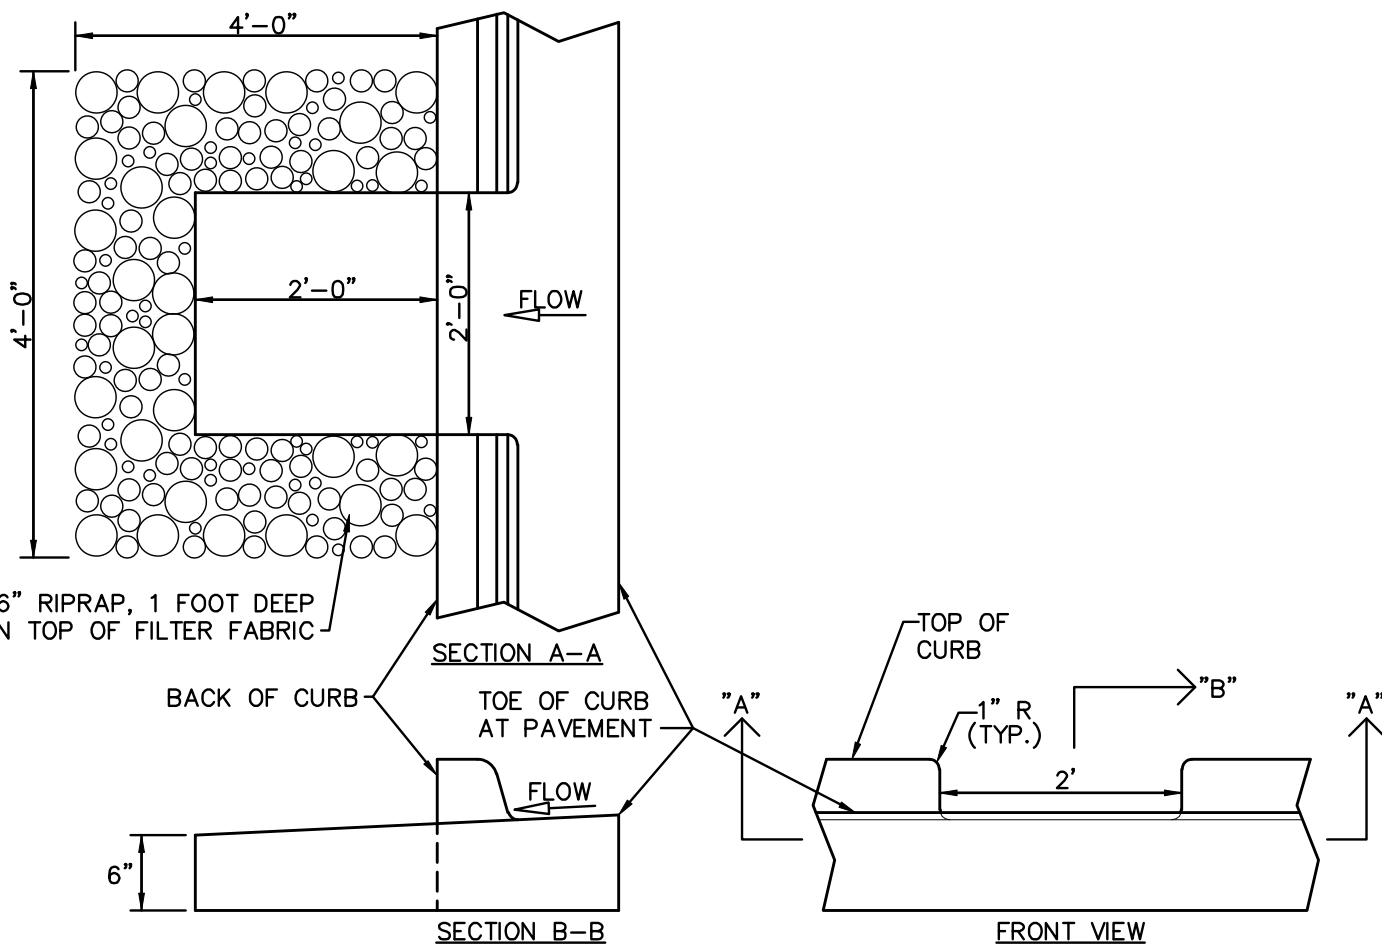

2' CURB CUT



NOT TO SCALE

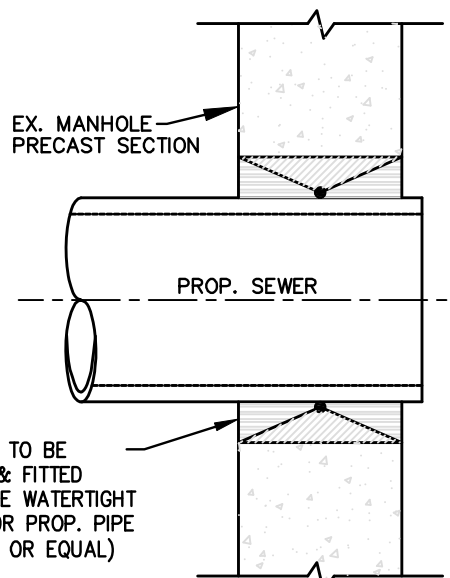

PIPE CONNECTION DETAIL TO EXISTING MANHOLE

NOT TO SCALE

C

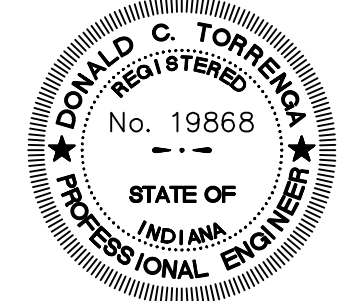

TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321
Tel. No.: (219) 836-8918
website: www.torrenga.com

MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
DETAILS & SPECIFICATIONS

REVISIONS:
DATE: 05-11-2020

CLIENT:
First Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321
JOB NO: 2019-5052
SCALE: NTS

SHEET
C-5.0

1. All work shall be performed in accordance with the Codes, Ordinances and Standards of the Town of Munster, Lake County, and the State of Indiana.
2. All sanitary sewer pipe, branches and fittings shall conform to one of the following: (a) Extra strength vitrified clay pipe (ASTM C-700) with push on rubber gasket joints (ASTM C-425), (b) Poly-vinyl chloride (PVC), SDR 26 (ASTM D-3034), with push-on rubber gasket joints (ASTM C-3212). Six inch service pipes shall be in accordance with the infrastructure improvement codes of the Town of Munster.
3. All sanitary sewer manholes shall be standard 48" diameter precast concrete units (ASTM C-478) conforming with the Standard Detail sheet of these plans.
4. The sanitary manhole base shall be precast with a minimum of 2 foot section, trough, etc..
5. Sanitary manholes shall be provided with a watertight gasketed cover
6. All improvements installed across paved or future paved areas shall be backfilled with sand or graded stone aggregate to the subgrade.

8. Deflection tests shall be performed on all flexible pipe materials placed. The contractor shall be responsible for supplying testing materials and appurtenances. The tests shall be conducted after the final backfill has been in place at least 30 days. No pipe shall exceed a deflection of 5 %. If the deflection test is to be run using a rigid ball or mandrel, it shall have a diameter equal to 95 % of the inside diameter of the pipe. The test shall be performed without mechanical pulling devices. The Town of Munster shall be notified when the system (or portion thereof) is ready for testing.

11. All sewers shall be laid at least 10 feet (3.0m) horizontally from any existing or proposed water main. The distance shall be measured edge to edge. All sewers crossing water mains shall be laid to provide a minimum vertical distance of 18 inches (46 cm) between the outside of the water main and the outside of the sewer. This shall be the case where the water main is either above or below the sewer. The crossing shall be arranged so that the sewer joints will be equidistant and as far as possible from the water main joints. Where a water main crosses under a sewer, adequate structural support shall be provided for the sewer to prevent damage to the water main. When it is impossible to obtain proper horizontal and vertical separation as stipulated above, the sewer shall be designed and constructed equal to water pipe.

13. Air pressure test shall be performed on all completed Sanitary Manholes in accordance with ASTM C 1244-93, Standard Test Method for Concrete Sewer Manholes by Negative Air Pressure (Vacuum) Test. The tests shall be conducted prior to backfill to demonstrate the integrity of the installed materials. The manhole shall pass if the test time meets or exceeds the required minimum test times as specified in ASTM C1244-93 for the vacuum reading to drop from 10 inches of mercury to 9 inches of mercury. If the manhole fails the initial test, necessary repairs shall be made, and the test shall be repeated. The contractor shall be responsible for supplying all testing materials and appurtenances. The Town of Munster shall be notified when the manholes (or portion thereof) are ready for testing.

CURB RUMPS MUST HAVE A DETECTABLE WARNING FEATURE EXTENDING THE FULL WIDTH AND DEPTH OF THE RAMP (MID-WALK "IN-LINE" RUMPS ONLY NEED DETECTABLE WARNING SURFACE ON ONE SIDE AT TRANSITION). THE DETECTABLE SURFACE MUST CONSIST OF RAISED TRUNCATED DOMES WITH A DIAMETER OF NOMINAL .93 INCHES, A HEIGHT OF .15 INCHES TO .2 INCHES, AND A CENTER-TO-CENTER SPACING OF NOMINAL 2.35 INCHES. THE TEXTURE OF THE DETECTABLE WARNING FEATURE MUST CONTRAST WITH THE SURROUNDING SURFACES (EITHER LIGHT OR DARK) FOR VISUAL CONTRAST. SEE ABOVE ACCEPTABLE PAVEMENT MANUFACTURERS.

-HANOVER ARCHITECTURAL PRODUCTS, DETECTABLE WARNING PAVING

www.hanoverpapers.com/html/detectable.html

-TeKWay™ = DETECTABLE WARNING SYSTEM

www.strongro.com/orproducts.html

HANOVER, CAST-IN TACT, DETECTABLE WARNING PAVERS

www.nuwajinc.com/CAST-IN_TACT_1.pdf

YELLOW COLOR ONLY

1. All work shall be performed in accordance with the Codes, Ordinances and Standards of the Town of Munster, and the State of Indiana.
2. All water main pipe shall be polywrapped Ductile Iron Pipe (AWWA C151 C-52) with bell and spigot push-on rubber gasket joints (AWWA C111). All water main pipe shall be installed with a minimum cover of 5.0 feet from top of curb to top of pipe. All fire hydrants, tees, bends and fittings shall be suitably harnessed or thrust blocked with concrete.
3. All improvements installed across paved or future paved areas shall be backfilled with sand or graded stone aggregate to the subgrade.
4. All water valves 12" or larger shall be placed in vaults.
5. On 12" water main bends, restrained joints shall be used, megalug or equal. At 90° bends, the water main shall be additionally restrained at 1 joint in each direction.
6. All fire hydrants shall be manufactured by Mueller Company, Super Centurion 250 model with 5/4" valve openings with a 5" Storz pumper connection and shall be backfilled with 3/4" stone for drainage purposes.


8. Care should be taken in parkway areas to assure compaction acceptable for the future stability of driveways and sidewalks. While special backfill material is not required, it shall be the responsibility of the Contractor to protect against substantial future settlement of backfilled areas. The Contractor shall provide special backfill material across driveways and sidewalks in the event that a water main is installed underneath.

10. All water main pipe shall be disinfected by the use of liquid chlorine. The Contractor shall notify the town of Munster when the water main system (or portion thereof) is ready for testing.


12. The newly installed water main (or portions thereof) shall be subjected to a pressure and leakage test, using hydrostatic testing. Test pressure shall not be less than 1.5 times the working pressure or exceed pipe design pressure. Pressure shall not vary by more than ± 5 PSI for a minimum of a 2 hour duration test. The exposed pipe and joints shall be examined carefully during the test and any damaged or defective pipe shall be replaced. The test shall be repeated until the test is passed. The allowable leakage shall not exceed 11.65 gpd/in. of nominal pipe diameter at a pressure of 150 PSI.

All visible leaks are to be repaired regardless of the amount of leakage. The contractor shall be responsible for supplying all testing materials and appurtenances. The Town of Munster shall be notified when the water main (or portion thereof) is ready for testing.


14. No water main shall be within eight (8) feet of a sanitary sewer manhole, a storm sewer manhole, or a drainage grate support structure as measured from the outside edge of the water main to the outside edge of the sanitary sewer manhole, storm sewer manhole, or drainage grate support structure.

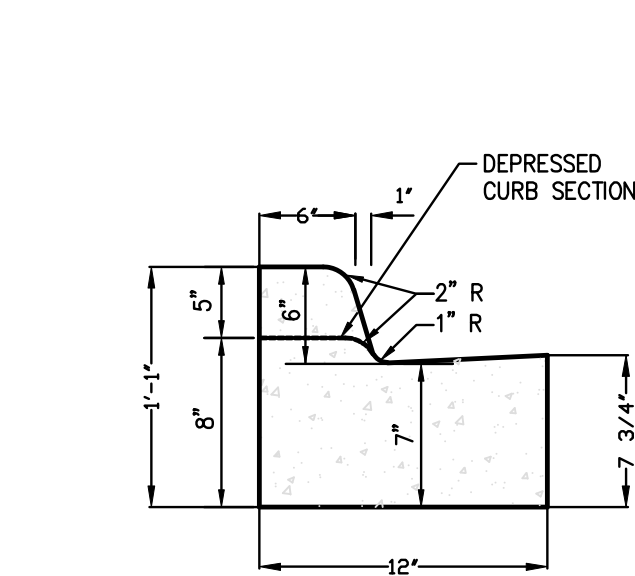

(C) COMBINED CONCRETE HIGH BACK CURB AND GUTTER
NOT TO SCALE

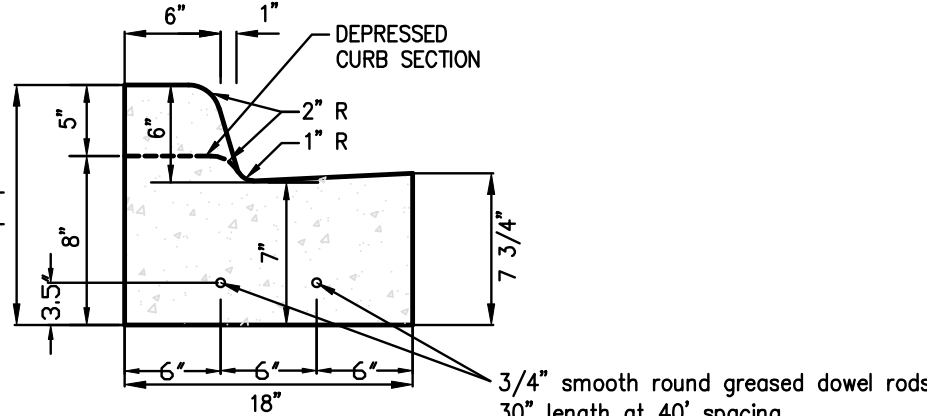


COMBINED CONCRETE HIGH BACK
CURB AND GUTTER
NOT TO SCALE


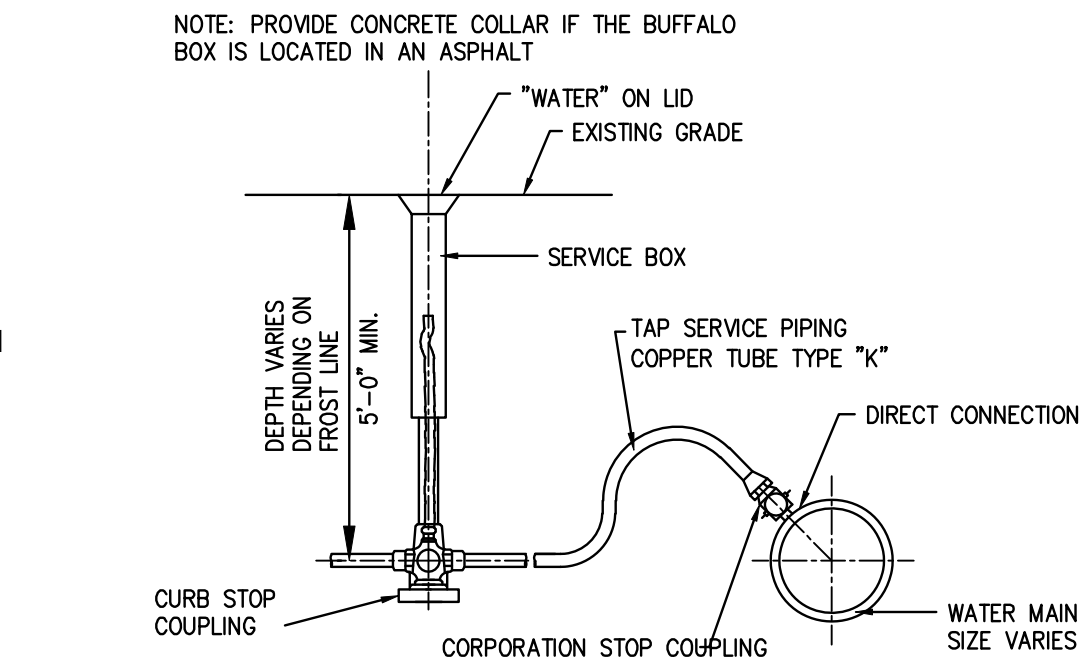


TYPICAL WATER TAP SERVICE PIPING

NOT TO SCALE

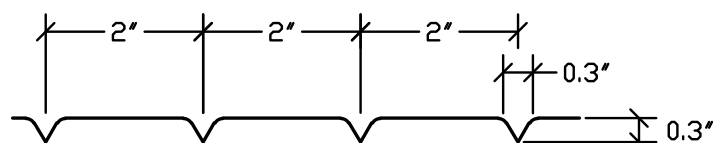


DETAIL OF RAMP GROOVES

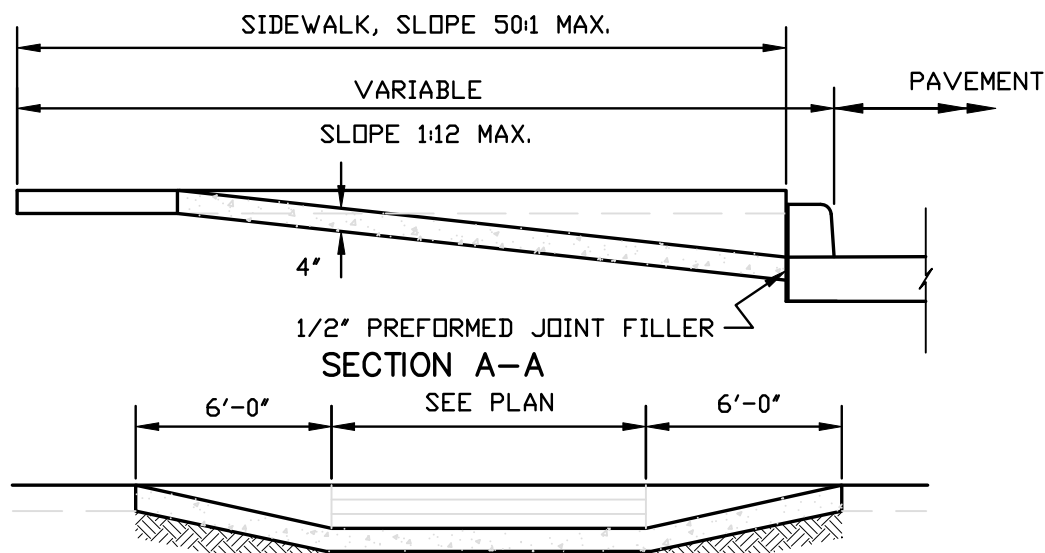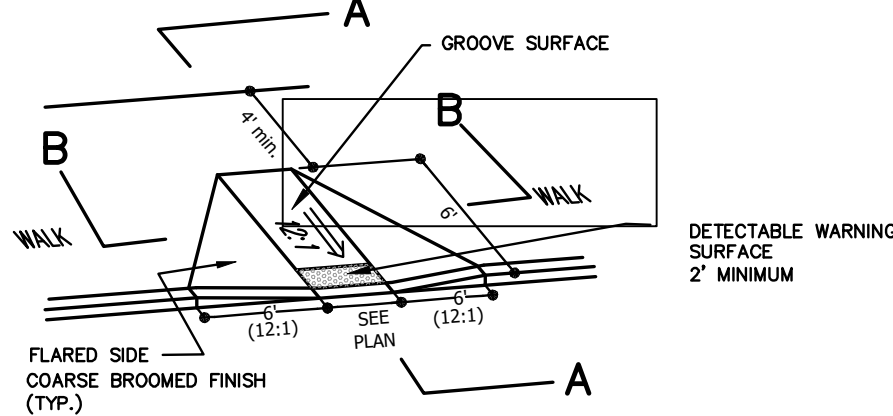

SECTION B-B
HANDICAP RAMP TYPE A

NOT TO SCALE

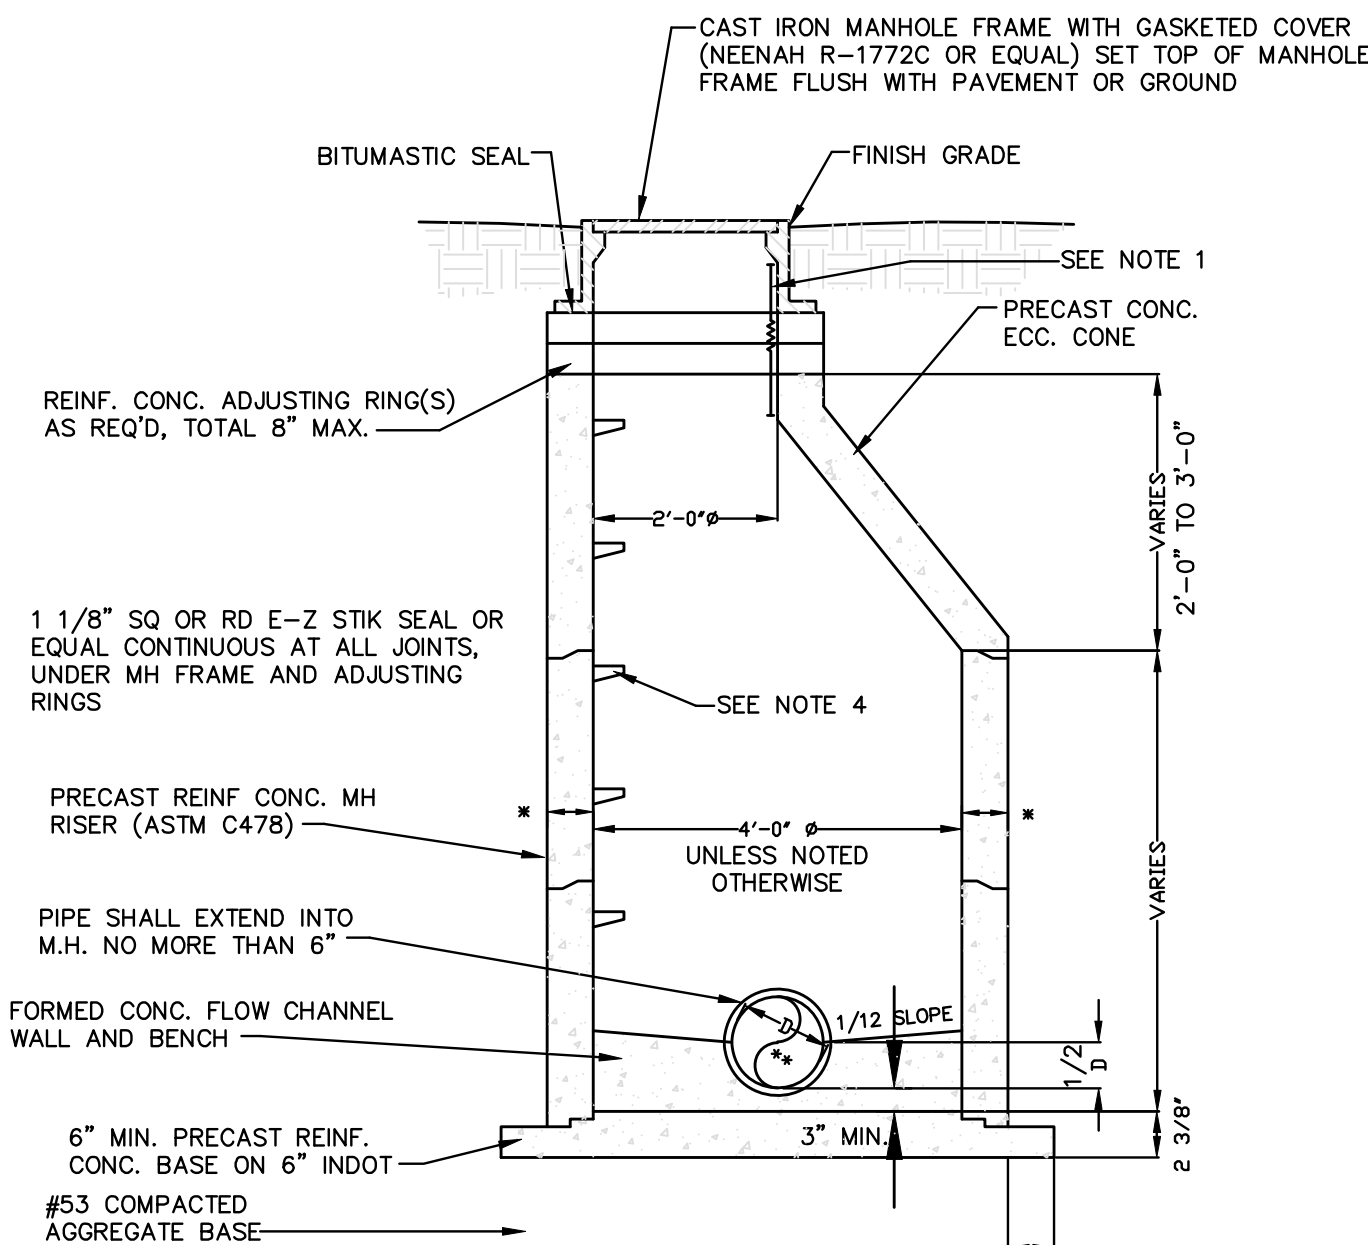


* MANHOLE WALL THICKNESS TABLE	
MH I.D.	WALL THICKNESS
48"	5"
60"	6"
72"	7"

NOTES:

1. USE CANUSA WRAP ON ALL MANHOLES.
 2. WHERE DEPTH FROM TOP OF CASTING TO INVERT IS LESS THAN 5'-0", USE FLAT TOP MANHOLE TYPE "C" IN LIEU OF ECCENTRIC CONE
 3. WATERTIGHT SEAL IS REQ'D BETWEEN PRECAST RISER AND SEWER PIPE TYPE A-LOK OR EQUAL.
 4. COPOLYMER/STEEL MH STEPS AS MANUFACTURED BY M.A. INDUSTRIES, INC., OR EQUAL, AT 16" O.C.
- ** FOR PIPE SIZES RANGING FROM 8" TO 30" IN DIAMETER.


SANITARY
TYPE "A" MANHOLE

NOT TO SCALE

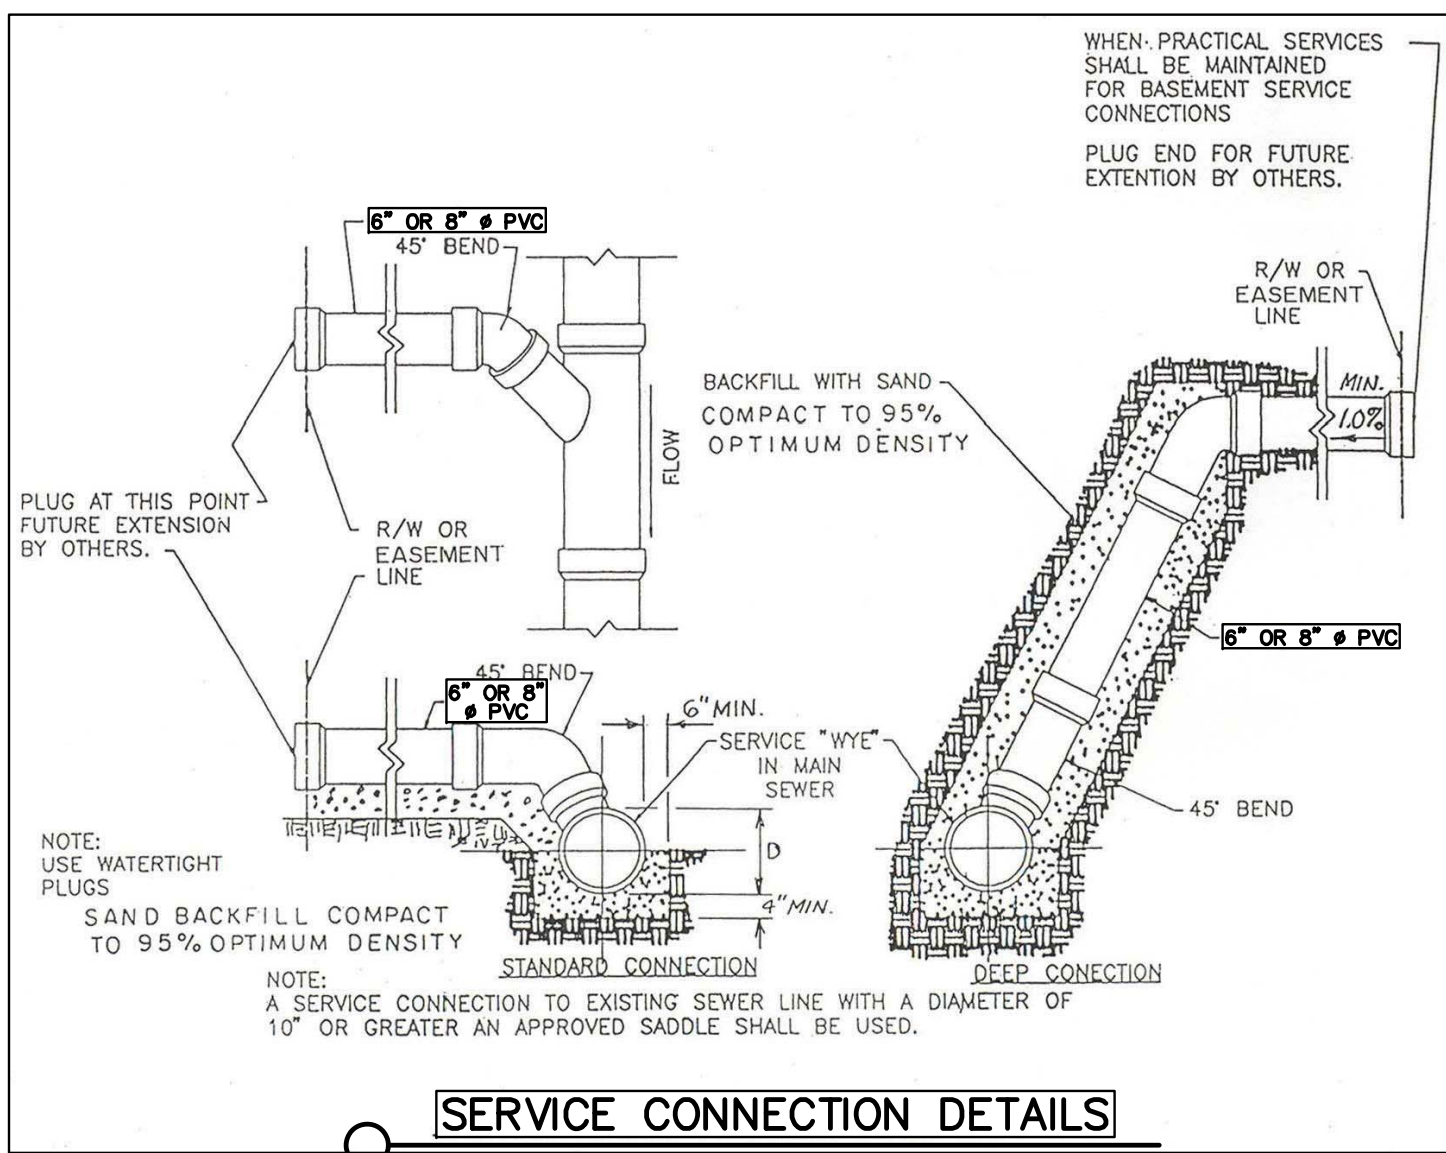

SERVICE CONNECTION DETAILS

NOT TO SCALE

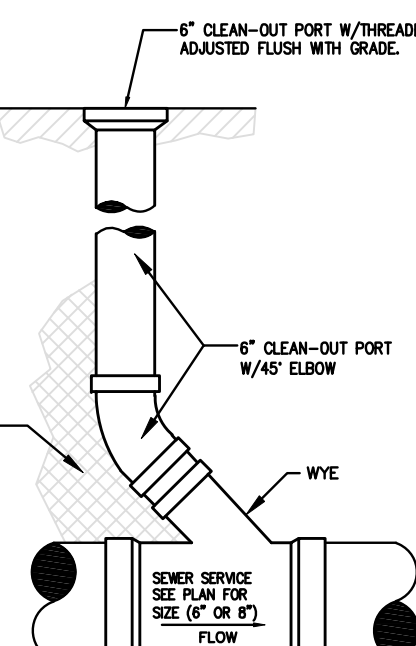

CLEAN-OUT

NOT TO SCALE



TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321

website: www.torrena.com

Tel. No.: (219) 836-8918

MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
DETAILS & SPECIFICATIONS


REVISIONS:

CLIENT:
First Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321




JOB NO: 2019-5052

SCALE: NTS

SHEET
C-5.1

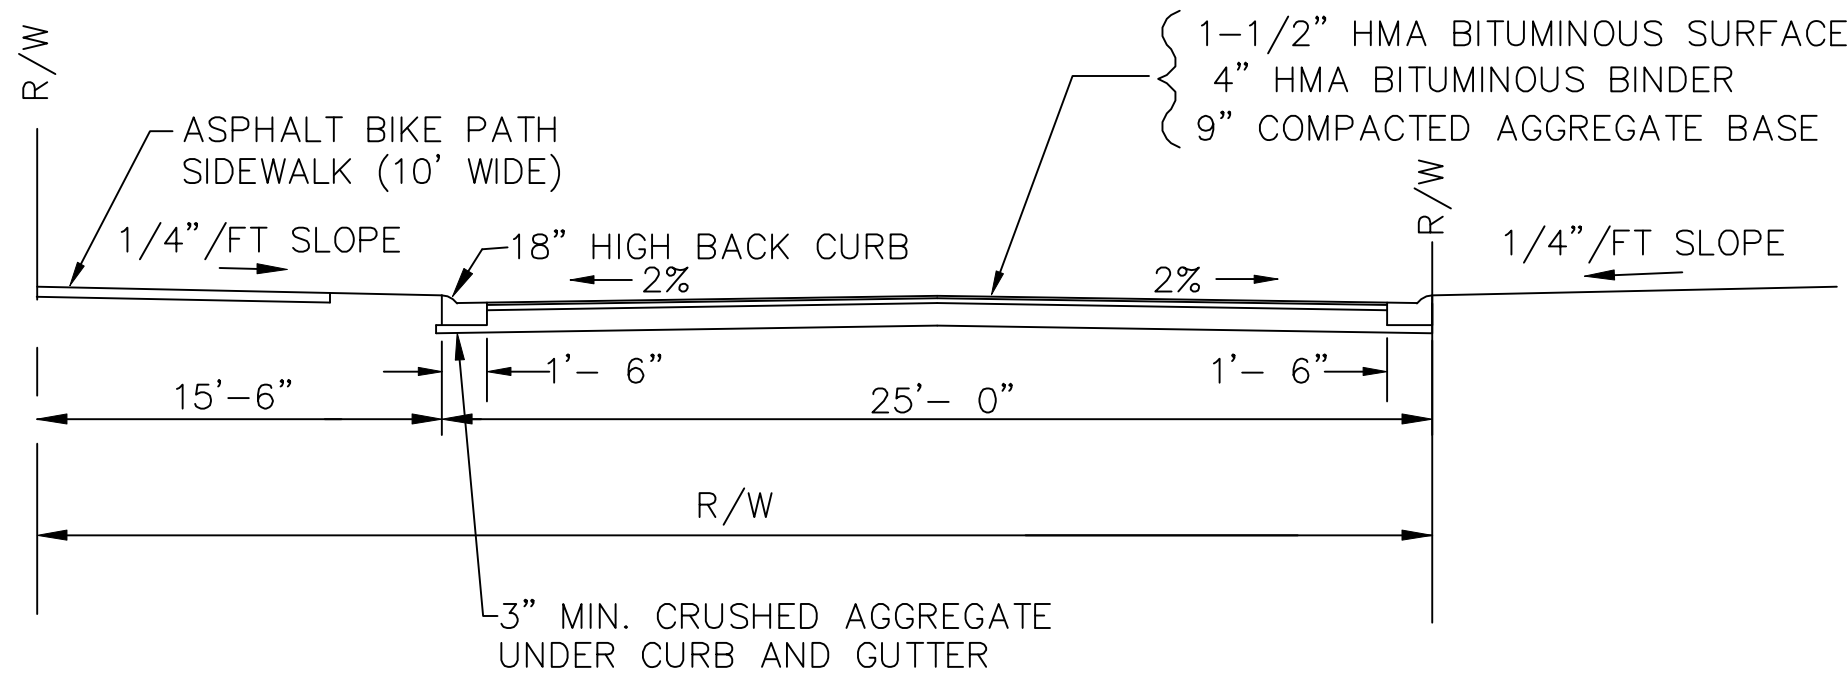


TYPICAL PUBLIC STREET CROSS SECTION
(NO SCALE)

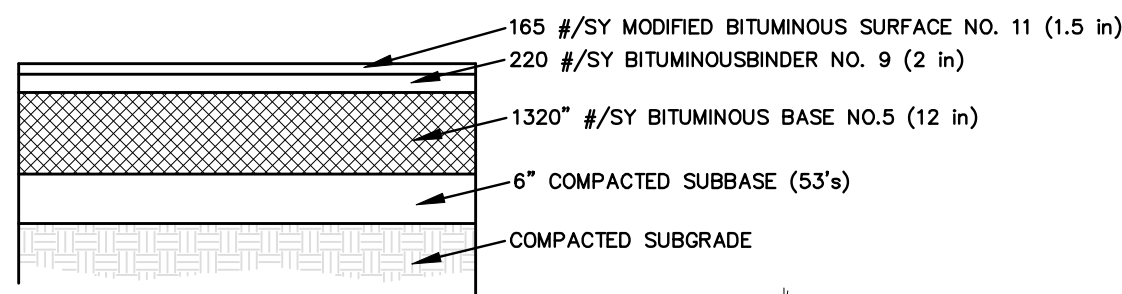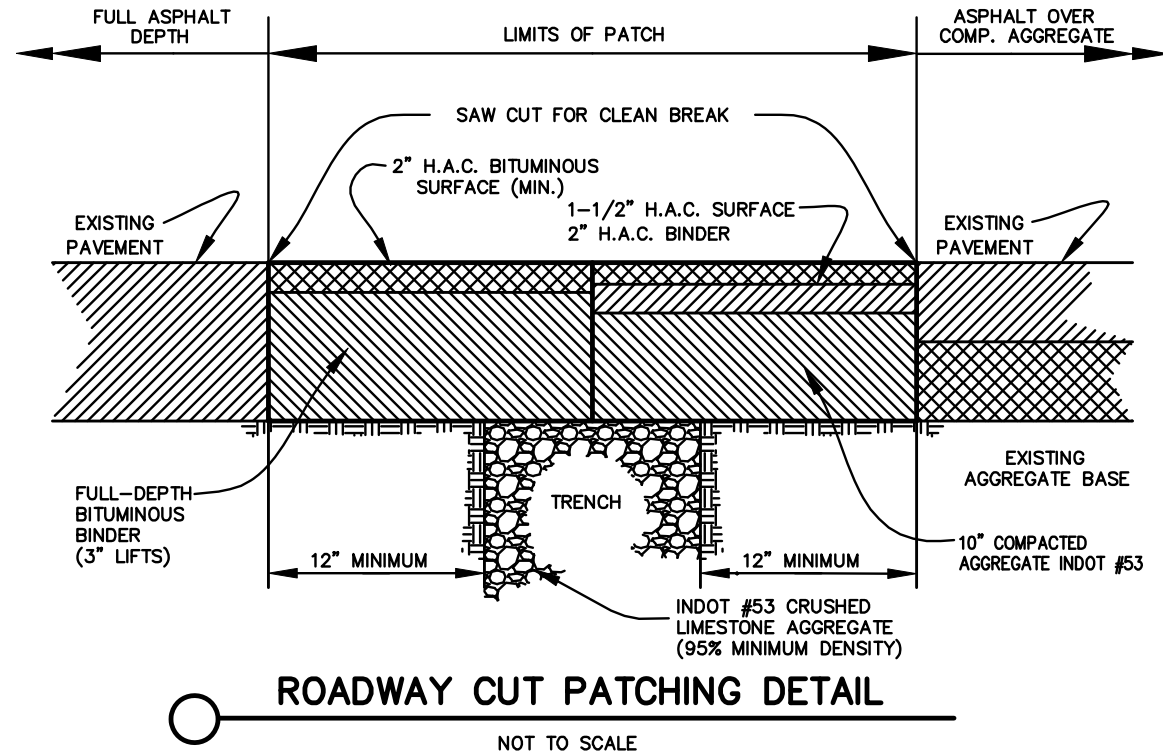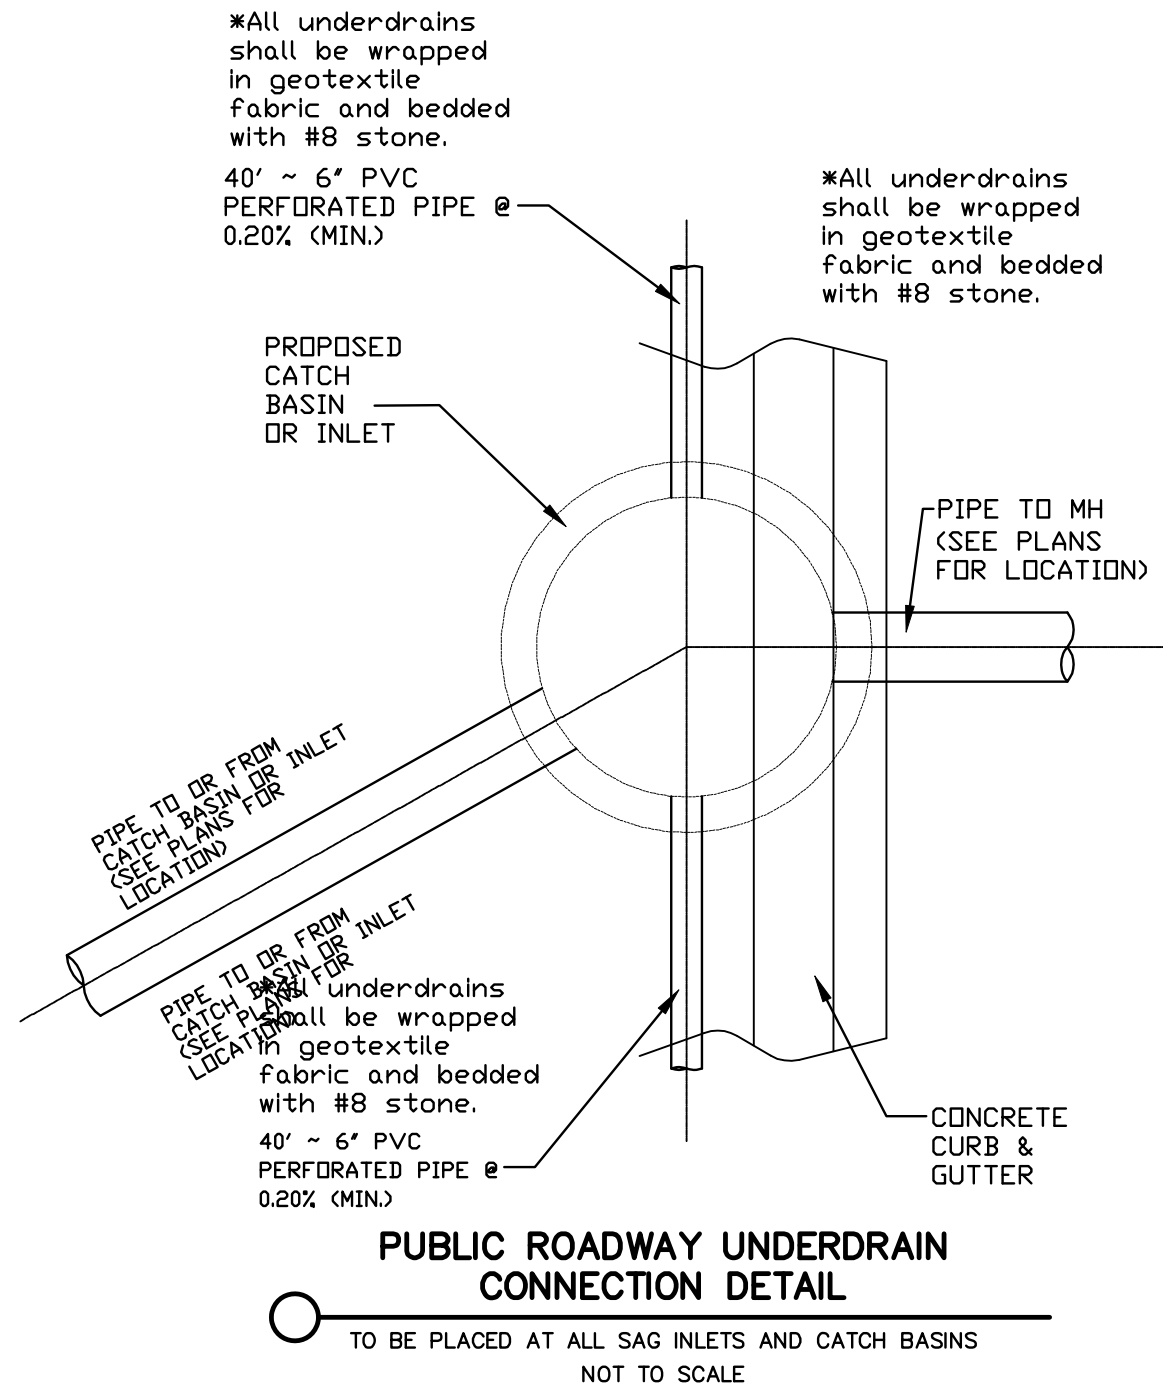

NOTES:
1. PAVEMENT & AGGREGATE THICKNESS ARE TAKEN FROM THE TYPICAL CROSS SECTION DETAIL ON THE ORIGINAL PLANS FOR CALUMET AVENUE STATE HIGHWAY MAM-M-PROJECT NO. 152 (2), DATED 12/23/86
2. WHERE FILL IS REQUIRED, SUBGRADE SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D698 METHOD OF TESTING.


TYPICAL PAVEMENT SECTION
CALUMET AVENUE

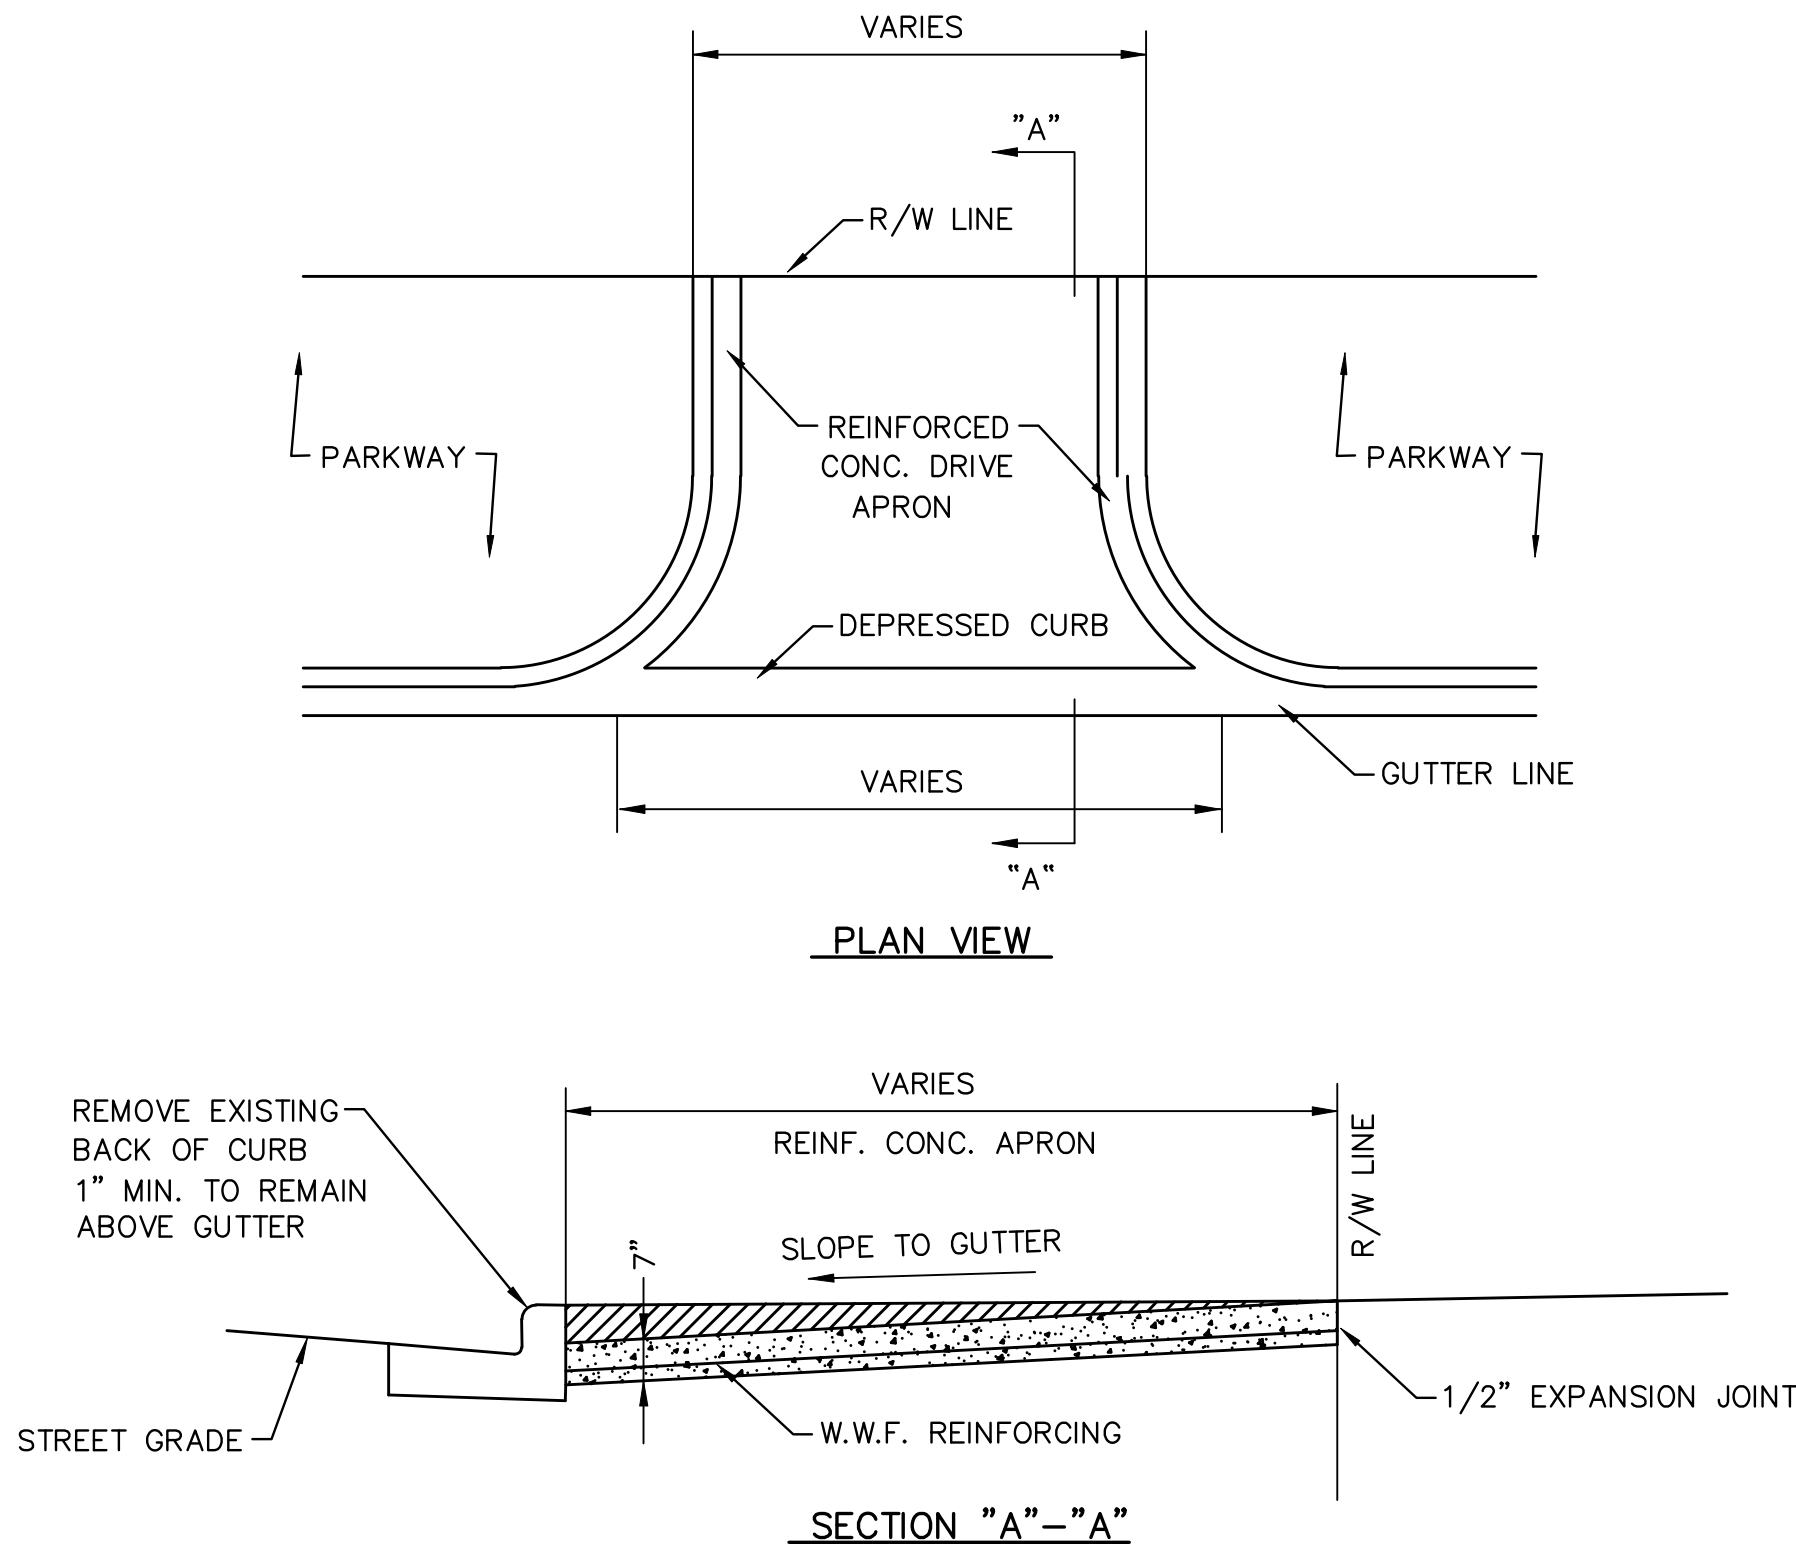

TYPICAL STREET CROSS SECTION
(NOT TO SCALE)

NOTE:
All concrete work for the drive aprons shall be in accordance with the codes and ordinances of the Town of Munster.

All driveway aprons extending beyond the sidewalk and into the street (parkway) shall consist of reinforced concrete at least seven inches in thickness and placed as shown on these plans and/or site plan accompanying the permit application.

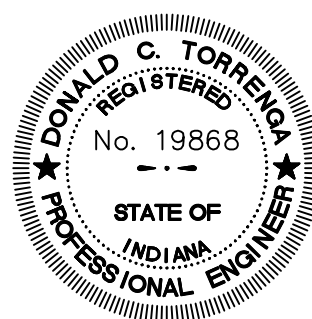

CLIENT:
First Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321


JOB NO: 2019-5052

SCALE: NTS


REVISIONS:
DATE: 05-11-2020

MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
DETAILS & SPECIFICATIONS

TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321
Tel. No.: (219) 836-8918
website: www.torrenga.com




FILE NO: Z:\2019-5052 Jay Lieser - Maple Leaf Crossings Calumet Avenue - Munster\dwg\2019-5052 Details.dwg 5/10/2020 2:35:45 PM CDT

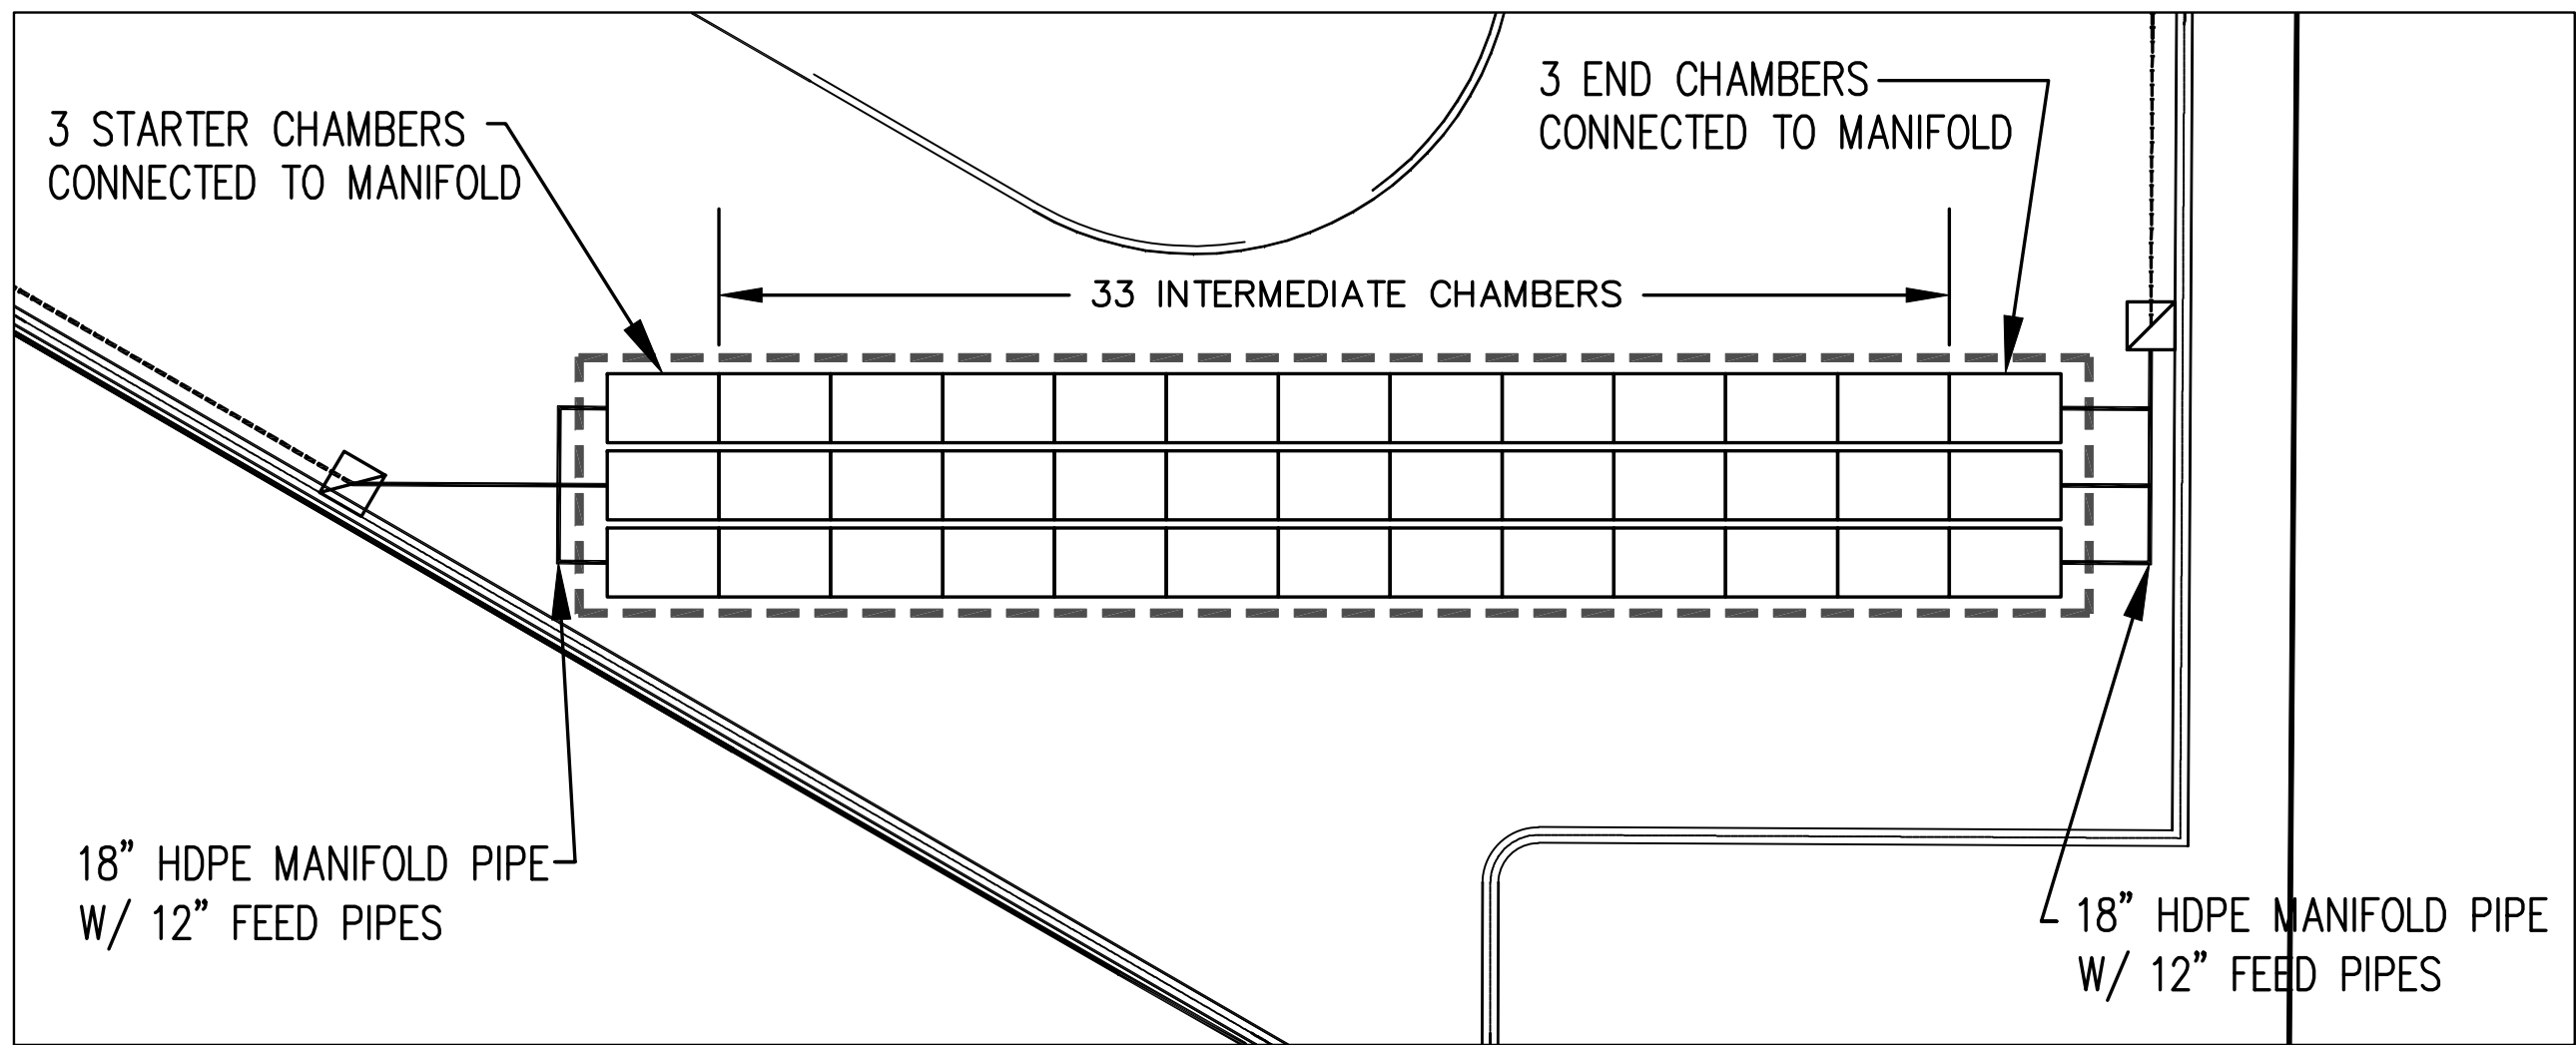

7.5' [2.29 m] MIN.
CULTEC NO. 4800 WOVEN GEOTEXTILE
BENEATH FEED CONNECTORS

10.0' [3.0 m] MIN.
CULTEC NO. 4800 WOVEN GEOTEXTILE
BENEATH INLET PIPES

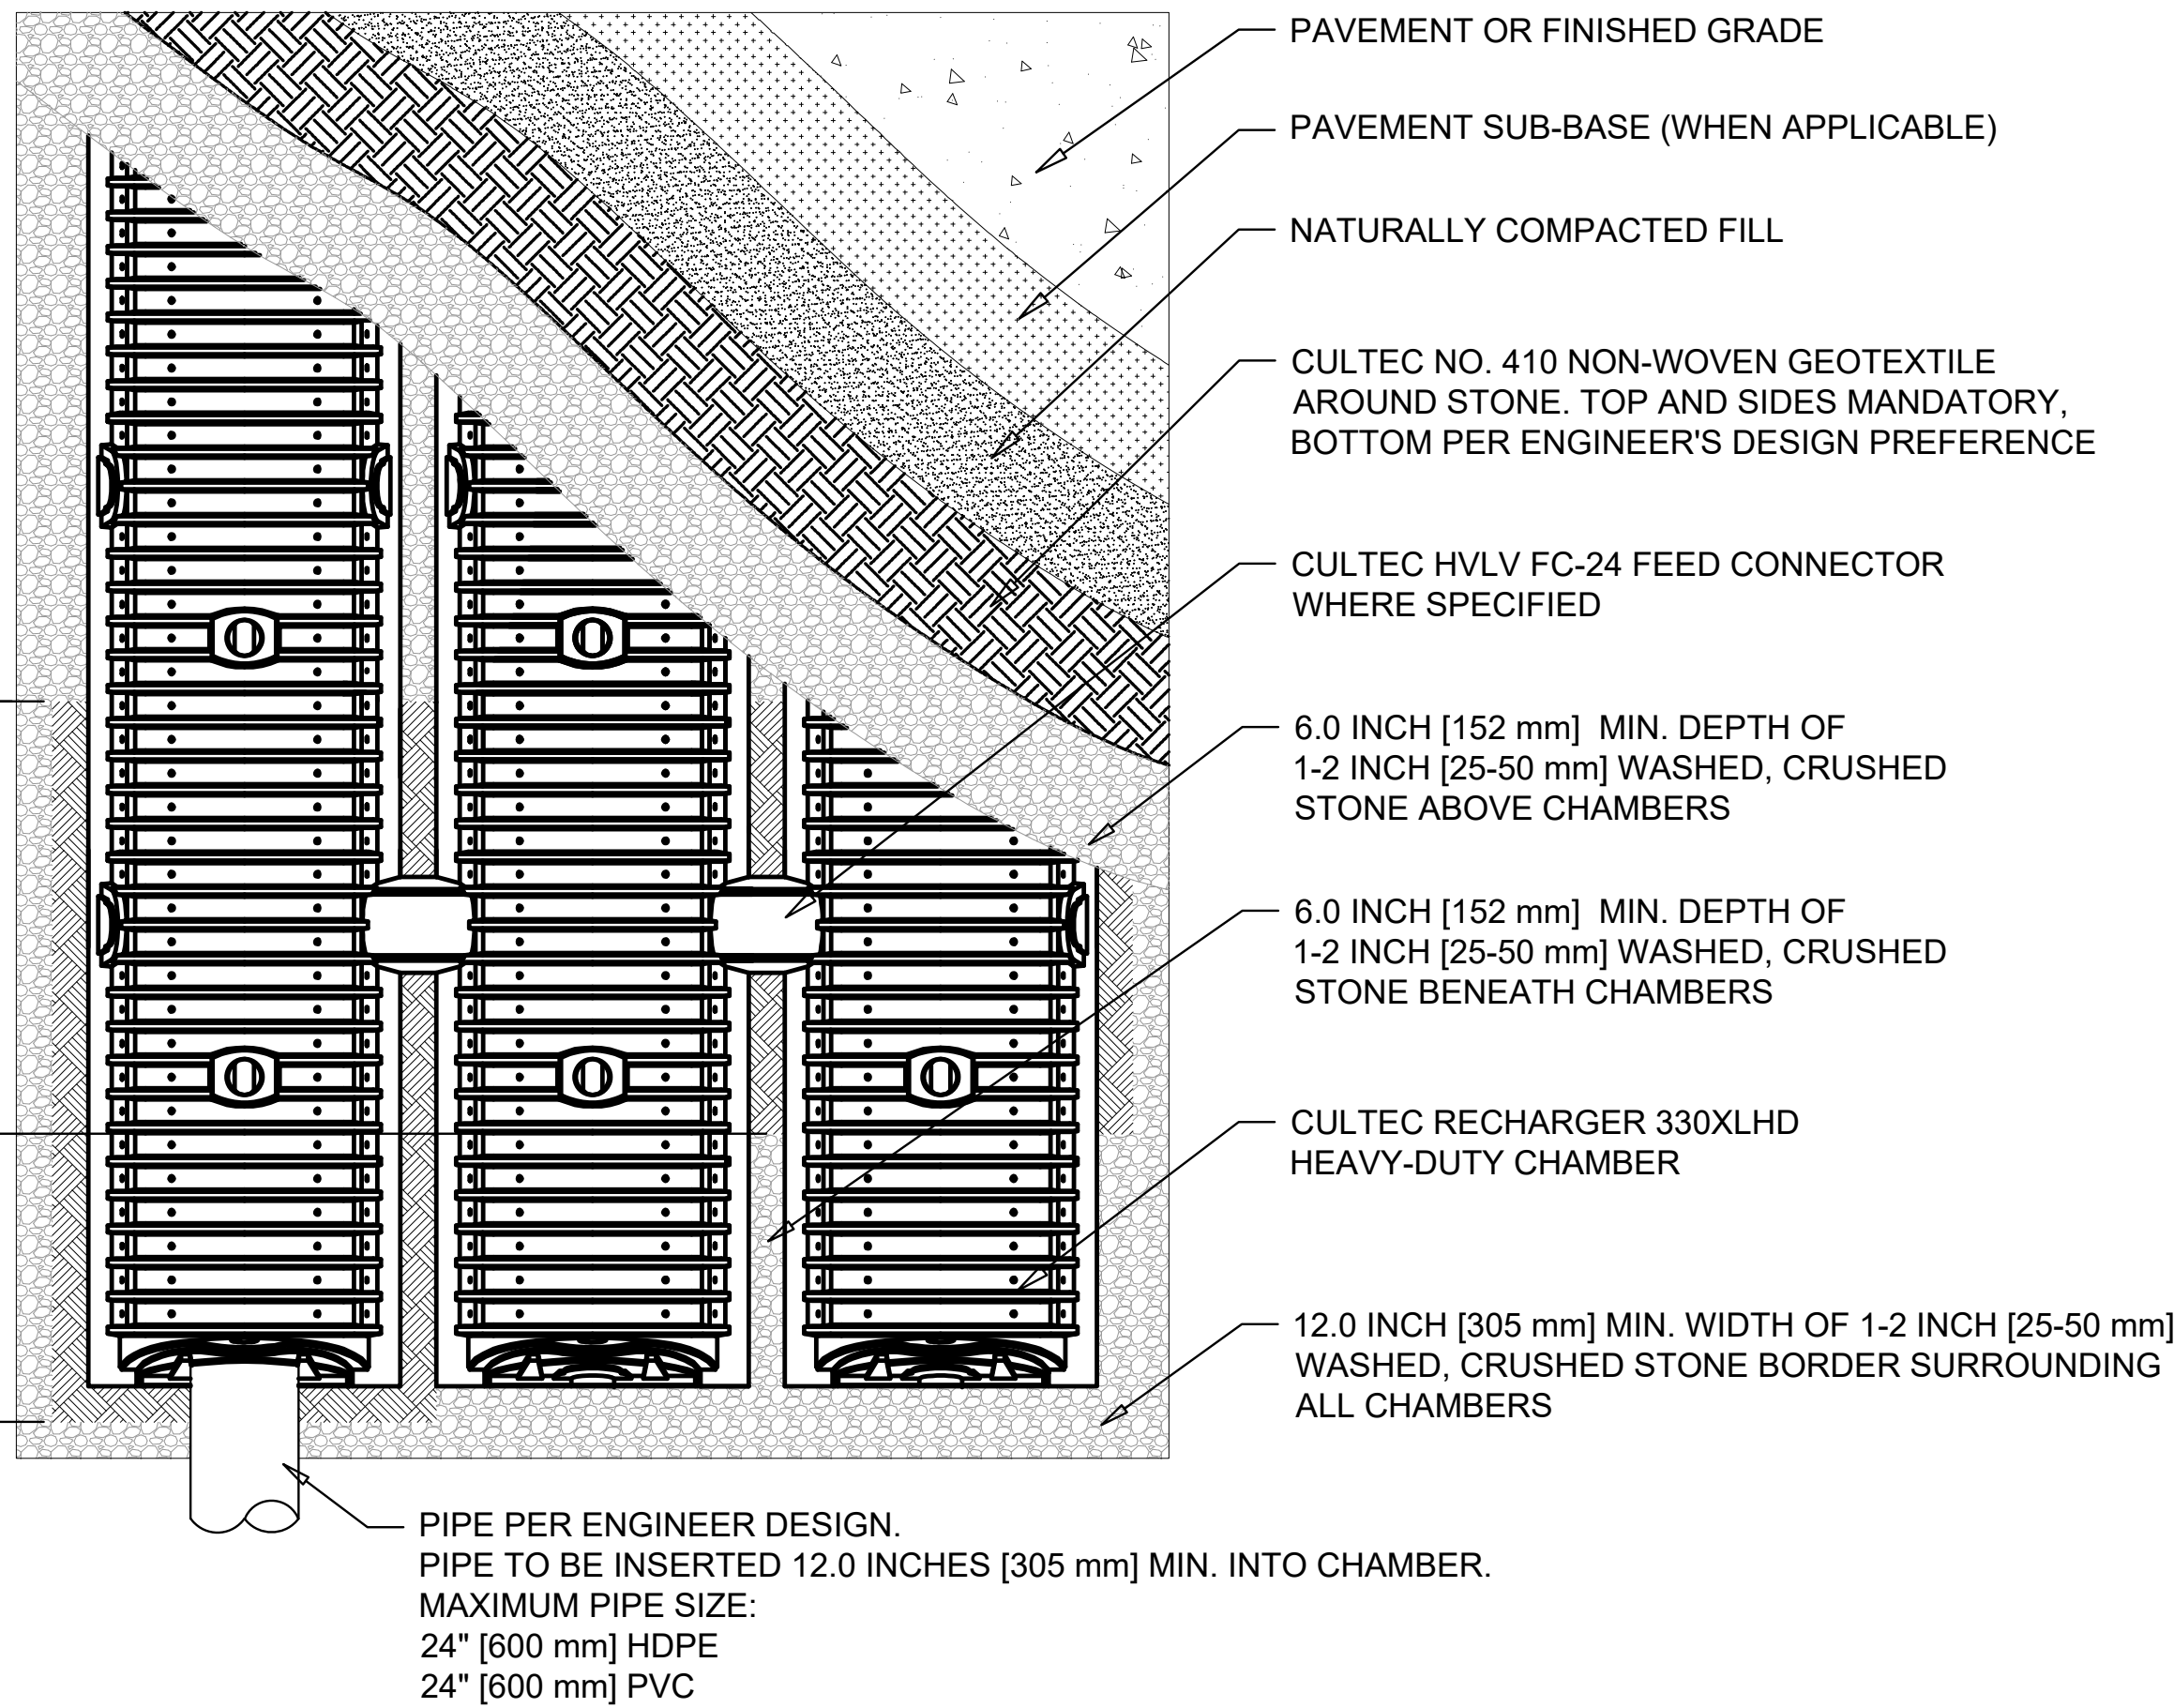

CULTEC Stormwater Design Calculator

Date:	May 05, 2020
Project Information:	
Maple Leaf Crossings	
9450 Calumet Avenue	
Munster	
Indiana	
United States	

Project Number:	2019-5052
Calculations Performed By:	
Ryan Torrenga	
Torrenga Engineering	
907 Ridge Road	
Munster	
Indiana	
46321	
United States	
(219) 836-8918	
Ryan.Torrenga@Torrenga.com	

RECHARGER 330XLHD



Recharger 330XLHD Chamber Specifications		
Height	30.5	inches
Width	52.0	inches
Length	8.50	feet
Installed Length	7.00	feet
Bare Chamber Volume	52.21	cu. feet
Installed Chamber Volume	86.03	cu. feet



Breakdown of Storage Provided by Recharger 330XLHD Stormwater System		
Within Chambers	2,009.87	cu. feet
Within Feed Connectors	-	cu. feet
Within Stone	1,616.45	cu. feet
Total Storage Provided	3,686.3	cu. feet
Total Storage Required	3485.00	cu. feet

Materials List

Recharger 330XLHD		
Total Number of Chambers Required	39	pieces
Separator Row Chambers	13	pieces
Starter Chambers	3	pieces
Intermediate Chambers	33	pieces
End Chambers	3	pieces
HVLV FC-24 Feed Connectors	0	pieces
CULTEC No. 410 Non-Woven Geotextile	544	sq. yards
CULTEC No. 4800 Woven Geotextile	93	feet
Stone	150	cu. yards

Separator Row Qty Included in Total

Based on External Pipe Manifold

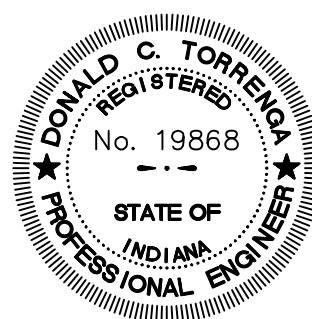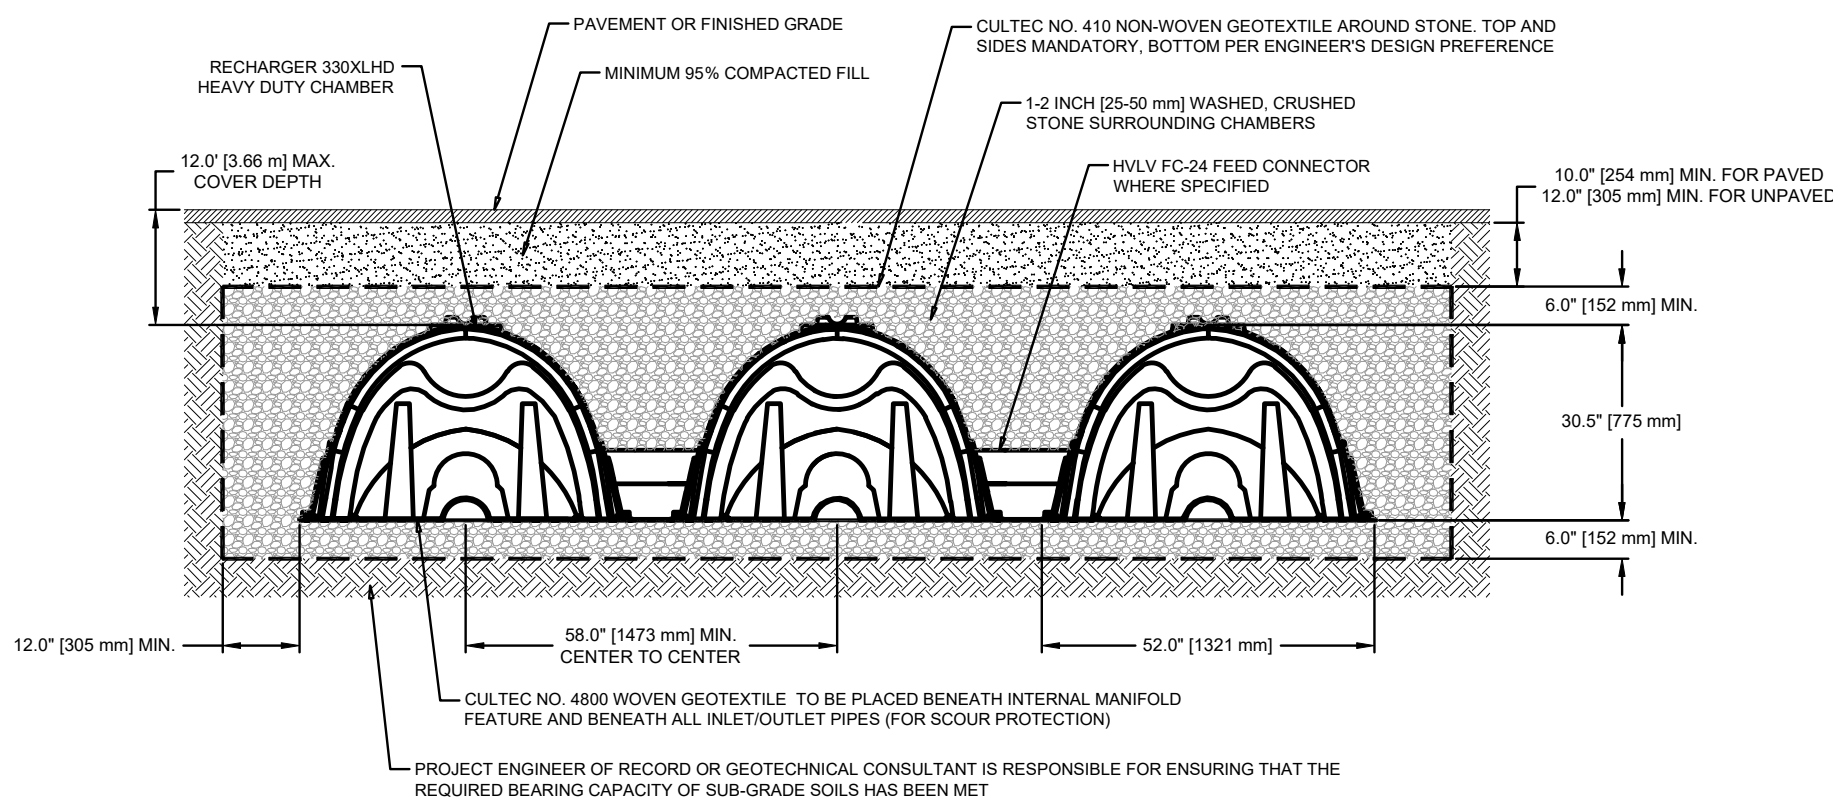

CLIENT: Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321

JOB NO: 2019-5052


SCALE: NTS


REVISIONS:
DATE: 05-11-2020

SHEET
C-5.3

MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
DETAILS & SPECIFICATIONS

TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321
Tel. No.: (219) 836-8918
website: www.torrenga.com

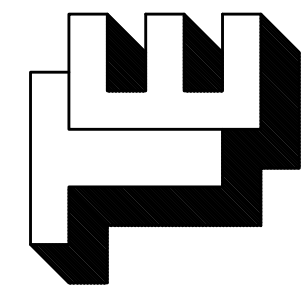

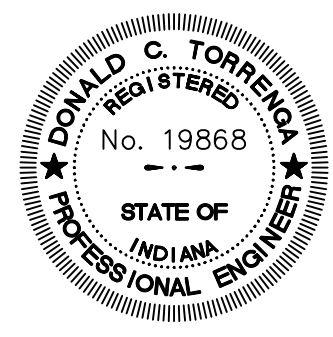

(IN FEET)
1 inch = 40 ft.

●	MANHOLE
○	CATCH BASIN/INLET
⊙	POWER POLE
☆	LIGHT POLE
⊕	TELEPHONE MANHOLE
⊗	TELEPHONE PEDESTAL
⊠	WATER VALVE
⊡	FIRE HYDRANT
⊢	GAS VALVE
PG	NIPSCO GAS LINE-FLAGGED
---	SANITARY SEWER
---	STORM SEWER
---	UNDERGROUND GAS LINE
---	UNDERGROUND TELEPHONE LINE
---	UNDERGROUND ELECTRIC LINE
---	UNDERGROUND FIBER OPTIC CABLE LINE
---	OVERHEAD ELECTRIC LINE

LEGEND

EXISTING


LEGEND

PROPOSED

●	MANHOLE
○	CATCH BASIN/INLET
⊙	FIRE HYDRANT
⊕	WATER VALVE
⊡	GRADE PROPOSED
---	FINISHED GRADE
---	STORM SEWER
---	SANITARY SEWER
---	SANITARY SEWER STUB
---	WATER MAIN
---	WATER MAIN STUB
→	GRADE DIRECTION ARROW

SWPPP LEGEND:

⬮	TEMPORARY ENTRANCE/EXIT (GRAVEL OR MAT)
⬮	SOIL STOCK PILE
B	BASKET DROP INLET PROTECTION
G	GRADE LIMITS
SF	SILT FENCE (SEDIMENT FENCE)
CW	CONCRETE WASH OUT AREA
TS	TEMPORARY SEEDING (SEE NOTE 12)
P	POSTING RULE 5 NOI & NOS LETTERS AND LOCAL SWPPP PERMIT (SEE NOTE 14)

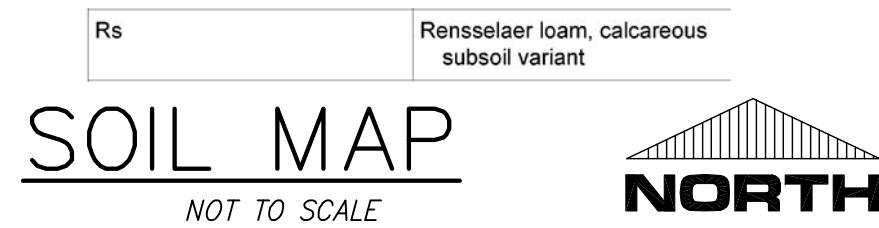

Temporary stabilization plans and sequence of implementation.

- On site posting of the complete Rule 5 NOI and NOS Letters. Location of the posting and plans shall be made available by the owner contractor.
- Installation of all erosion/sedimentation controls including stabilized construction entrance, silt fences, etc., per the engineering plans.
- Clearing and grubbing.
- All disturbed areas shall be permanent seeded, mulched, when no additional disturbance is anticipated.
- Topsoil stockpile surrounded with silt fencing.
- Rough cut and fill of all proposed swales, road, and other major grading per the engineering plans shall be done to rough grades at start of construction to prevent excessive soil erosion due to construction.
- Construction of storm sewers, sanitary sewers, water mains, and other utility, and implementation of storm sewer inlet protection at each open-grate structure (fabric drop inlet protection, basket inlet protection, etc., as per engineering plans).
- Regrade and construct road.
- Complete permanent erosion control and restoration of site vegetation. Erosion control measures are to be removed upon permanent vegetative cover being established.

RESPONSIBLE INDIVIDUAL FOR SWPPP
COMPANY: FIRST METROPOLITAN BUILDERS
NAME: JACK LIESER
ADDRESS: 400 FISHER AVENUE
MUNSTER, IN 46321
PHONE: (219) 746-0753
E-MAIL: JACKLIESER@AOL.COM

- GENERAL NOTES:
- THIS PROPERTY IS LOCATED IN FLOOD ZONE "X" (SHADED), AREA WITH REDUCED FLOOD RISK DUE TO LEVEE AS TAKEN FROM THE FLOOD INSURANCE RATE MAP (FIRM) FOR MUNSTER, LAKE COUNTY, INDIANA, MAP NUMBER 18880C13E, EFFECTIVE DATE JANUARY 18, 2012.
 - HYDROLOGIC UNIT CODES: 071200030300630 - HART DITCH (PLUM CREEK) - DYER DITCH.
 - STATE OR FEDERAL WATER QUALITY PERMITS ARE REQUIRED FOR THE PROJECT, A NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) IDEM RULE 5 WATER QUALITY PERMIT IS REQUIRED.
 - THE SITE CONSISTS PRIMARILY OF DEMOLISHED BUILDINGS, BROKEN ASPHALT AND STONE.
 - THERE IS NO PRESENCE OF HYDRIC SOILS ON THIS PROPERTY.
 - THERE ARE EXISTING WETLAND AREAS ON THIS PROPERTY AS CLASSIFIED BY THE U.S. FISH AND WILDLIFE SERVICE, NATIONAL WETLANDS INVENTORY, AND THE UNITED STATES DEPARTMENT OF THE INTERIOR. HART DITCH (PLUM CREEK) - DYER DITCH IS THE WATER COURSE WHICH THE STORMWATER FROM THE PROPOSED SITE WILL ULTIMATELY DISCHARGE INTO, ITS LOCATED APPROXIMATELY 1 MILE EAST OF THE PROJECT SITE, AND IS CLASSIFIED AS A WATER OF THE U.S., WITH A NWL = 602.
 - POTENTIAL SOURCE OF STORM WATER DISCHARGE ENTERING THE GROUNDWATER FROM THIS DEVELOPMENT WILL BE THROUGH NATURAL GROUND ABSORPTION ONLY. THERE ARE NO ABANDONED WELLS OR SINKHOLES ON THE PROPERTY.
 - THERE ARE NO REGULATED DRAINS WITHIN THIS PROPERTY, OR ON ADJACENT PROPERTIES. THERE IS NO RECORD OR KNOWLEDGE OF EXISTING FARM DRAINS OR FIELD TILE, INLETS AND OUTFALLS LOCATED WITHIN THE EXISTING PROPERTY LIMITS.
 - SOIL STOCKPILES, BORROW AND DISPOSAL AREAS ARE LOCATED WITHIN THE PROJECT SITE. THERE ARE NO OFFSITE BORROW, STOCKPILES, OR DISPOSAL AREA ASSOCIATED WITH THIS PROJECT. SOIL STOCKPILES SHALL BE SURROUNDED WITH SILT FENCING AT ALL TIMES TO PREVENT EXCESSIVE EROSION, AND IF LEFT UNDISTURBED FOR A PERIOD OF MORE THAN 14 DAYS, IT SHALL BE TEMPORARY SEEDING.
 - ALL ACREAGE OF THIS PROPERTY WILL BE DISTURBED DURING CONSTRUCTION.
 - FUEL STORAGE AREA SHALL BE WITHIN THE CONSTRUCTION STAGING AREA, FUEL SHALL BE STORED IN APPROVED MOBILE REFUELING TANK LOCATED AWAY FROM DRAINAGE STRUCTURES AND CHANNELS. FIRE EXTINGUISHERS SHALL BE LOCATED NEAR FUEL STORAGE AREA AND BE OF SUITABLE TYPE, POSTED, AND BE MAINTAINED IN GOOD CONDITION.
 - TEMPORARY SEED ALL AREAS OF BARE SOIL (WITH THE ADDITION OF A BLANKET WHERE SLOPES ARE GREATER THAN 2:1) THAT WILL REMAIN UNDISTURBED FOR A PERIOD OF MORE THAN 14 DAYS. SEEDING: OPTIMUM SEEDING DATED ARE MARCH 1 - MAY 10 AND AUGUST 10 - SEPTEMBER 30. SEEDING DATES BETWEEN MAY 10 AND AUGUST 10, MAY NEED TO BE IRRIGATED. FOR SEEDING RECOMMENDATIONS SEE PRACTICE 3.12, INDIANA STORM WATER QUALITY MANUAL.
 - ALL SOIL STOCKPILES, AREAS THAT ARE DISTURBED DURING CONSTRUCTION, AND DRAINAGE SWALES WHICH ARE SCHEDULED OR LIKELY TO BE LEFT INACTIVE FOR FOURTEEN (14) CALENDAR DAYS OR MORE MUST BE TEMPORARILY OR PERMANENTLY SEEDING WITH MEASURES APPROPRIATE FOR THE SEASON.
 - LOCATION OF ON-SITE POSTING, OF THE COMPLETE RULE 5 NOI WITH ASSIGNED PERMIT NUMBER, NOS LETTERS, LOCAL SWPPP PERMIT AND LOCATION OF THE COMPLETE SET OF ENGINEERING PLANS, SHALL BE AVAILABLE AT THE ENTRANCE TO THE SITE AND VISIBLE TO THE PUBLIC.
 - ALL PUBLIC AND PRIVATE STREETS AND ROADS FRONTING THE PROJECT SHALL BE SWEEPED OF ANY DEBRIS, TRASH OR SEDIMENT WHICH MAY ULTIMATELY DRAIN TO STORM SEWER.
 - SITE ELEVATIONS ARE BASED ON NAVD 88, AND HORIZONTAL DATUM IS BASED ON INDIANA STATE PLANE COORDINATES NAD 83.

MAPLE LEAF CROSSINGS
A P.U.D. TO THE TOWN MUNTER, INDIANA

STORM WATER POLLUTION PREVENTION PLAN

CLIENT:
First Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321

JOB NO: 2019-5052

SCALE: 1" = 40'


SHEET
C-6.0

TORRENGA ENGINEERING, INC.

CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321

Tel. No.: (219) 836-8918

website: www.torrengea.com

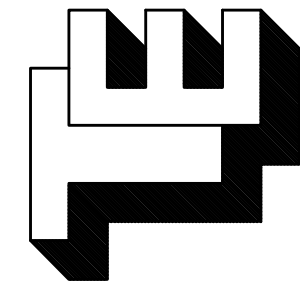

TEMPORARY CONSTRUCTION ENTRANCE/EXIT

Purpose: To provide a stable entrance/exit condition from the construction site, and to keep mud and sediment off public roads.

"GRAVEL"


Requirements:
Width: 12 feet minimum or full width of entrance
Length: 50 feet minimum
Material: 2-3 inch diameter washed stone (INDOT CA No. 2), with Geotextile Fabric Underliner.
Thickness: 6 inch minimum

Installation:

1. Remove all vegetation and other objectionable material from the foundation area.
2. Install pipe under the stone if needed to provide proper public road drainage.
3. Install Geotextile fabric on the graded foundation area prior to stone placement.
4. Divert all surface runoff and drainage from the stone to sediment trap.

Maintenance:

1. Inspect entrance pad for sediment deposits weekly and after storm events or heavy use.
2. Reshape pad as needed for drainage and runoff control.
3. Topdress with clean stone as needed.
4. Remove mud and sediment tracked or washed onto public road by brushing or sweeping. No flushing of sediment off the street.
5. Repair any broken road pavement immediately.

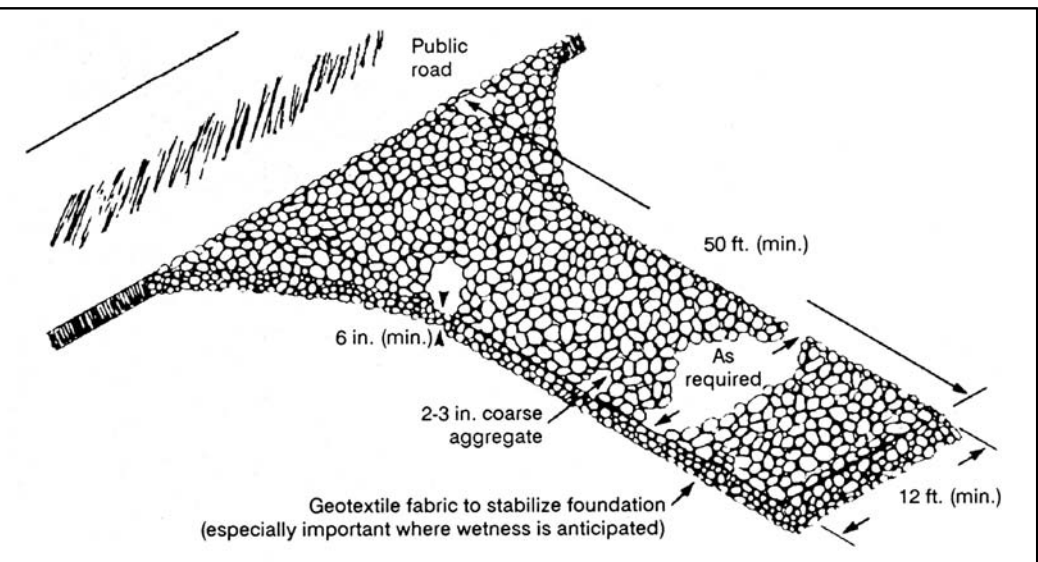

"MAT"


Requirements:
Width: 12 feet minimum or full width of entrance
Length: 50 feet minimum
Material: Geotextile-Type mats, AGES Mud Mat or approved equal

Installation:

1. Install pipe under mat if needed to provide proper site drainage.
2. Install Geotextile-Type mat on the graded foundation area.
3. Divert all surface runoff and drainage from the mat to sediment trap.

Maintenance:

1. Inspect entrance mat for sediment deposits weekly and after storm of a minimum of 1/2 inch rainfall events or heavy use.
2. Reshape pad as needed for drainage and runoff control.
3. Repair or replace mats as needed.
4. Remove mud and sediment tracked or washed onto public road by brushing or sweeping. No flushing of sediment off the street.

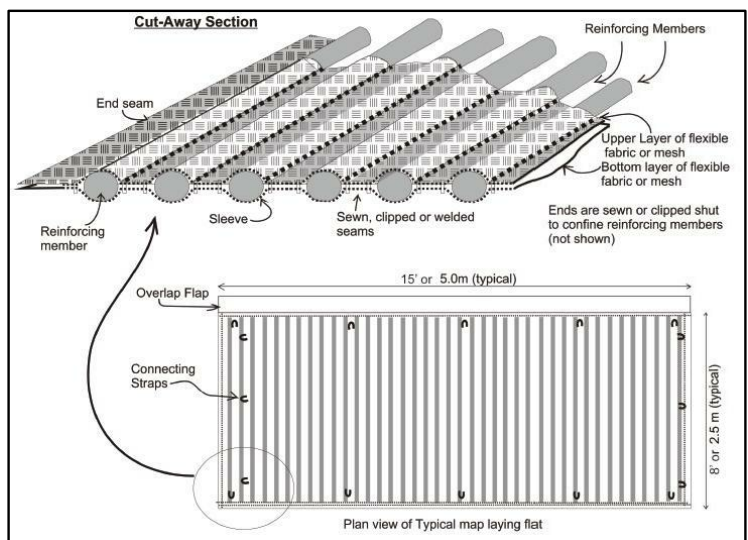

PLANS OF TEMPORARY CONSTRUCTION INGRESS/EGRESS PAD

TEMPORARY SEEDING

Purpose: To stabilize disturbed areas especially along both sides of the streets and courts after final grading work is completed and where additional work is not scheduled.

Requirements:

Site and seedbed preparation: Graded, and lime and fertilizer applied

Seed Selected:

Selected on the basis of quick germination, growth, and time of year, see Table for temporary seeding recommendations.

Fertilize:

According to soil test or use 600 lbs/acre 12-12-12 analysis or equivalent.

Mulch:

1.5 - 2 tons/acre straw. Straw must be dry, unchopped and free of undesirable seeds.

Application:

1. Fertilize and lime as recommended by the soil test.
2. Till the soil to obtain a uniform seedbed, working the fertilizer and lime into the soil 2-4" deep with a disk or rake operated across the slope.
3. Apply seed uniformly with a drill or cultipacker-seeder, or by broadcasting, and cover to a depth as shown on Table for temporary seeding recommendations.
4. If drilling or broadcasting, firm the seedbed with a roller or cultipacker.
5. Mulch all seeded areas. (Note: If seeding is done with a hydroseeder, fertilizer and mulch can be applied with the seed in a slurry mixture.)

Maintenance:

1. Inspect periodically after planting to see that vegetative stands are adequately established; re-seed if necessary.
2. Check for erosion damage after storm events and repair; re-seed and mulch if necessary.

Notes:

1. Vegetative Filter Strip: permanent or temporary, shall be done on all disturbed areas along both sides of the streets and courts to reduce erosion where additional work is not scheduled.
2. Permanent Seeding: or sodding shall be done at the time of final landscaping.

Exhibit 3.11-B. Temporary Seeding Recommendations.

Seed species*	Rate/acre	Planting depth	Optimum dates**
Wheat or rye	150 lbs.	1 to 1½ in.	9/15 to 10/30
Spring oats	100 lbs.	1 in.	3/1 to 4/15
Annual ryegrass	40 lbs.	1/4 in.	3/1 to 5/1
			8/1 to 9/1
German millet	40 lbs.	1 to 2 in.	5/1 to 6/1
Sudangrass	35 lbs.	1 to 2 in.	5/1 to 7/30

* Perennial species may be used as a temporary cover, especially if the area to be seeded will remain idle for more than a year (BUT NOT PERMANENT SEEDING)
** Seeding done outside the optimum dates increases the chances of seeding failure.

PERMANENT SEEDING

Purpose: To stabilize disturbed areas especially along both sides of the streets and courts after final grading work is completed and where additional work is not scheduled.

Requirements:

Site and seedbed preparation: Graded, and lime and fertilizer applied.

Seed Selected:

Selected on the basis of Site Conditions, Soil PH, intended land use, and expected level of maintenance see Table for permanent seeding recommendations.

Fertilize:

According to soil test or use 600 lbs/acre 12-12-12 analysis or equivalent.

Mulch:

1.5 - 2 tons/acre straw. Straw must be dry, unchopped and free of undesirable seeds.

Application:

1. Fertilize and lime as recommended by soil test.
2. Till the soil to obtain a uniform seedbed, working the fertilizer and lime into the soil 2-4" deep with a disk or rake operated across the slope.
3. Apply seed uniformly with a drill or cultipacker-seeder, or broadcasting, and cover to a depth of ¼ to ½ inch.
4. If drilling or broadcasting, firm the seedbed with a roller or cultipacker.
5. Mulch all seeded areas. (Note: If seeding is done with a hydroseeder, fertilizer and mulch can be applied with the seed in a slurry mixture.)

Maintenance:

1. Inspect periodically, especially after storm events, until the stand is successfully established. (Characteristics of a successful stand include: vigorous dark green or bluish-green seedling; uniform density with nurse plants, legumes, and grasses well intermixed; green leaves; and the perennials remaining green throughout the summer, at least at the plant base.)
2. Plan to add fertilizer the following seasons according to soil test recommendations.
3. Repair damaged, bare or sparse areas by filling any gullies, refertilizing, over- or re-seeding, and mulching.
4. If plant cover is sparse or patchy, review the plant materials chosen, soil fertility, moisture condition, and mulching; then repair the affected area either by over-seeding or by re-seeding, and mulching.
5. If vegetation fails to grow, consider soil testing to determine acidity or nutrient deficiency problems. (Contact your SWCD or Cooperative Extension office for assistance.)
6. If additional fertilization is needed to get a satisfactory stand, do so according to soil test recommendations.

Notes:

1. Permanent seeding optimum dates are March 1 to May 10 and August 10 to September 30, seeding done between May 10 to August 10 may require irrigation. Temporary seeding may be used as an alternative until preferred date for Permanent Seeding.
2. Retention/Detention area walls and base will be seeded as soon as possible using permanent seeding when possible, mulch or erosion control blankets are to be used on seeded areas to protect the soil from wind and water impact. Install silt fences around Retention/Detention area until seed is established.

Seeding Recommendations.

This table provides several seeding options. Additional seed species and mixtures are available commercially. When selecting a mixture, consider site conditions, including soil properties (e.g., soil pH and drainage), slope aspect and the tolerance of each species to shade and droughtiness.

Seed species and mixtures	Rate per acre		Optimum soil pH
	Permanent	Dormant or frost	
OPEN AND DISTURBED AREAS (REMAINING IDLE MORE THAN 1 YR.)			
1. Perennial ryegrass	35 to 50 lbs.	50 to 75 lbs.	5.6 to 7.0
+ white or ladino clover*	1 to 2 lbs.	1 ½ to 3 lbs.	
2. Kentucky bluegrass	20 lbs.	30 lbs.	5.5 to 7.5
+ smooth bromegrass	10 lbs.	15 lbs.	
+ switchgrass	3 lbs.	5 lbs.	
+ timothy	4 lbs.	6 lbs.	
+ perennial ryegrass	10 lbs.	15 lbs.	
+ white or ladino clover*	1 to 2 lbs.	1 ½ to 3 lbs.	5.6 to 7.0
3. Perennial ryegrass	15 to 30 lbs.	22 to 45 lbs.	
+ tall fescue**	15 to 30 lbs.	22 to 45 lbs.	
4. Tall fescue**	35 to 50 lbs.	50 to 75 lbs.	5.5 to 7.5
+ ladino or white clover*	1 to 2 lbs.	1 ½ to 3 lbs.	

STEEP BANKS AND CUTS, LOW MAINTENANCE AREAS (NOT MOWED)

1. Smooth bromegrass	25 to 35 lbs.	35 to 50 lbs.	
+ red clover*	10 to 20 lbs.	15 to 30 lbs.	
2. Tall fescue**	35 to 50 lbs.	50 to 75 lbs.	5.5 to 7.5
+ white or ladino clover*	1 to 2 lbs.	1 ½ to 3 lbs.	
3. Tall fescue**	35 to 50 lbs.	50 to 75 lbs.	5.5 to 7.5
+ red clover*	10 to 20 lbs.	15 to 30 lbs.	
(Recommended north of US 40)			
4. Orchardgrass	10 to 30 lbs.	30 to 45 lbs.	5.6 to 7.0
+ red clover*	10 to 20 lbs.	15 to 30 lbs.	
+ ladino clover*	1 to 2 lbs.	1 ½ to 3 lbs.	
5. Crownvetch*	10 to 12 lbs.	15 to 18 lbs.	5.6 to 7.0
+ tall fescue**	20 to 30 lbs.	30 to 45 lbs.	
(Recommended south of US 40)			

LAWNS AND HIGH MAINTENANCE AREAS

1. Bluegrass	105 to 140 lbs.	160 to 210 lbs.	5.5 to 7.0
2. Perennial ryegrass (turf-type)	45 to 60 lbs.	70 to 90 lbs.	5.6 to 7.0
+ bluegrass	70 to 90 lbs.	105 to 135 lbs.	
3. Tall fescue (turf-type)**	130 to 170 lbs.	195 to 250 lbs.	5.6 to 7.5
+ bluegrass	20 to 30 lbs.	30 to 45 lbs.	

CHANNELS AND AREAS OF CONCENTRATED FLOW

1. Perennial ryegrass	30 to 150 lbs.	150 to 225 lbs.	5.6 to 7.0
+ white or ladino clover*	1 to 2 lbs.	1 ½ to 3 lbs.	
2. Kentucky bluegrass	20 lbs.	30 lbs.	5.5 to 7.5
+ smooth bromegrass	10 lbs.	15 lbs.	
+ switchgrass	3 lbs.	5 lbs.	
+ timothy	4 lbs.	6 lbs.	
+ perennial ryegrass	10 lbs.	15 lbs.	
+ white or ladino clover*	1 to 2 lbs.	1 ½ to 3 lbs.	
3. Tall fescue**	100 to 150 lbs.	150 to 225 lbs.	5.5 to 7.5
+ ladino or white clover*	1 to 2 lbs.	1 ½ to 3 lbs.	
4. Tall fescue**	100 to 150 lbs.	150 to 225 lbs.	5.5 to 7.5
+ Perennial ryegrass	15 to 20 lbs.	22 to 30 lbs.	
+ Kentucky bluegrass	15 to 20 lbs.	22 to 30 lbs.	

* For best results: (a) legume seed should be inoculated; (b) seeding mixtures containing legumes should preferably be spring-seeded, although the grass may be fall-seeded and the legume frost-seeded; and (c) if legumes are fall-seeded, do so in early fall.
** Tall fescue provides little cover for, and may be toxic to, some species of wildlife. The IDNR recognizes the need for additional research on alternatives to tall fescue, such as buffalograss, orchardgrass, smooth bromegrass, and switch-grass. This research, in conjunction with demonstration areas, should focus on erosion control characteristics, wildlife toxicity, turf durability, and drought resistance.

DORMANT AND FROST SEEDING

Purpose:
1. To provide early germination and soil stabilization in the spring.
2. To reduce sediment runoff to downstream areas.
3. To repair previous seedings.

Requirements:

Site and seedbed preparation: Graded, lime and fertilizer applied.

Seed Selected:

Selected on the basis of Site Conditions, Soil PH, intended land use, and expected level of maintenance. See Table for dormant or frost seeding recommendations.

Fertilize:

According to soil test or use 400-600 lbs/acre 12-12-12 analysis or equivalent.

Application:

Dormant seeding is a temporary or permanent seeding application at a time when soil temperatures are too low for germination to occur (less than 50 °F) Frost seeding is a temporary or permanent seeding application in early spring when soils are in the freeze-thaw stage.

For Dormant Seeding: (Seeding dates: Dec. 1-Feb. 28)

1. Site preparation and mulching can be done months ahead of actual seeding, apply mulch upon completion of grading (Practice 3.13)
2. Broadcast fertilizer as recommended by soil test.
3. Broadcast seeding on top of the mulch and/or into existing ground cover at the rate shown on table. (if site preparation occurs within the recommended dates, fertilize and lime, seed, and mulch at the time.)

For Frost Seeding: (Seeding dates: Feb. 28 - Mar. 28)

1. Broadcast fertilizer as recommended by a soil test.
2. Select an appropriate seed species or mixture from table for temporary seeding or table for permanent seeding, and broadcast on to the seedbed or into the existing ground cover at the rate shown. (Do not work the seed into the soil.)

Maintenance:

1. Apply 200-300 lbs./acre of 12-12-12 or equivalent fertilizer between Apr. 15 and May 10 or during periods of vigorous growth.
2. Re-seed and mulch any areas that have inadequate cover by mid- to late April. For best results, re-seed within the recommended dates shown for temporary seeding or for permanent seeding.

Temporary Dormant or Frost Seeding Recommendations.

Seed species*	Rate per acre
Wheat or rye	150 lbs.
Spring oats	150 lbs.
Annual ryegrass	60 lbs.

*Perennial species may be used as temporary cover, especially if the area to be seeded will remain idle for more than a year.

MULCHING

Purpose: To promote seed germination and seedling growth, a temporary surface stabilization, and protecting the soil from wind and water impact.

Requirements:

Material: Straw, hay, wood fiber or excelsior, see table for Mulch Materials, Rates, and comments.

Comments:

Coverage: 75% of the soil surface
Anchoring: Required to prevent displacement by wind or water, see table for Mulch Anchoring Methods.

Application:

1. Apply mulch at the recommended rate.
2. Spread uniformly by hand, hay fork, mulch blower, or hydromulcher with no more than 25% of the surface visible.
3. Anchor immediately if using straw or hay, using one of the following methods:
 - Crimp with mulch anchoring tool.
 - Hydromulch with short cellulose fibers.
 - Apply liquid tackifier.
 - Cover with netting secured with metal staples.

Maintenance:

1. Inspect after storm events to check for movement of mulch or for erosion.
2. If washout, breakage, or erosion is present, repair the surface, then re-seed, re-mulch.
3. Continue inspections until vegetation is firmly established.

Exhibit 3.15-B. Mulch Materials, Rates, and Comments.

Material	Rate	Comments
Straw or hay	1½-2 tons/acre	Should be dry, unchopped, free of undesirable seeds. Spread by hand or machine. Must be crimped or anchored (see Exhibit 3.15-D).
Wood fiber or cellulose	1 ton /acre	Apply with a hydromulcher and use with tacking agent.
Long fiber wood (excelsior)	1/2-3/4 ton/acre	Anchor in areas subject to wind.

Exhibit 3.16-D. Mulch Anchoring Methods.

Anchoring method	How to apply
Mulch anchoring tool OR Farm disk (dull, serrated, and set straight)	Crimp or punch the straw or hay into the soil 2-4 in. Operate machinery on the contour of the slope.
Cleating with dozer tracks	Operate dozer up and down slope, not across, or else the tracks will form rills.
Wood hydromulch fibers	Apply 1-2 tons/acre using a hydromulcher at a rate of 750 lbs./acre with a tacking agent (or according to contractor specifications). Do not use in areas of concentrated flow.
Asphalt emulsion	Emulsified asphalt should conform to the requirements of ASTM Spec. #977. Apply with suitable equipment at a rate of 0.05 gal./sq. yd. Do not use in areas of concentrated flow.
Synthetic tackifier, binder or soil stabilizer	Apply according to manufacturer's recommendation.
Biodegradable netting (polypropylene or similar material)*	Follow manufacturer's recommendations for installation. Best suited to slope application.

* Install the netting immediately after applying the mulch. In areas of concentrated water flow, lay it parallel to the direction of flow; on other slopes, lay it either parallel or perpendicular to direction of flow. Edges of adjacent netting strips should overlap 4-6 in., with the strip on the up-slope side of any lateral water flow on top. Installation details are site specific, so follow manufacturer's directions.

SELF-MONITORING PROGRAM

A self-monitoring program that includes the following must be implemented at all permitted project sites:

1. A trained individual shall perform a written evaluation of the project site a minimum of one (1) time per week and by the end of the next business day following each measurable storm event.
2. The evaluation must address the maintenance of existing storm water quality measures to ensure they are functioning properly and identify additional measures necessary to remain in compliance with all applicable statutes and rules.
3. Written evaluation reports must include:
 - a. the name of individual performing the evaluation;
 - b. the date of evaluation;
 - c. problems identified at the project site; and
 - d. details of corrective actions recommended and completed.
4. All evaluation reports for the project site must be made available to the MS4 Operator or other designated entity within forty-eight (48) hours of a request.
5. Evaluation reports must be maintained for a period of two (2) years from date of NOT.
6. All evaluation reports will be submitted to the Town of Munster when requested.

Date: _____
Project: _____
Inspected by: _____ Scheduled Weekly: _____ Rain Event: _____

CONSTRUCTION SITE INSPECTION AND MAINTENANCE LOG
(To be Completed by Property Owner or Agent)

All stormwater pollution prevention (BMPs) shall be inspected and maintained as needed to ensure continued performance of their intended function during construction and shall continue until the entire site has been stabilized and a Notice of Termination has been issued. An inspection of the project site must be completed by the end of the next business day following each measurable storm event. If there are no measurable storm events within a given week, the site should be monitored at least once in that week. Maintenance and repair shall be conducted in accordance with the accepted site plans. This log shall be kept as a permanent record and must be made available to the Town of Munster Engineer, in an organized fashion, within forty-eight (48) hours upon request.

Yes	No	NA	
			1. Are all sediment control barriers, silt protection and silt fences in place and functioning properly?
			2. Are all erodible slopes protected from erosion through the implementation of acceptable soil stabilization practices?
			3. Are all dewatering structures functioning properly?
			4. Are all discharge points free of any releasable pollutant discharges?
			5. Are all discharge points free of any releasable erosion or sediment transport?
			6. Are designated equipment washout areas properly sited, clearly marked, and being utilized?
			7. Are construction staging and parking areas restricted to areas designated as such on the plans?
			8. Are temporary soil stockpiles in approved areas and properly protected?
			9. Are construction entrances properly installed and being used and maintained?
			10. Are "Do Not Disturb" areas designated on plan sheets clearly marked on-site and avoided?
			11. Are public roads at intersections with site access roads being kept clear of sediment, debris, and mud?
			12. Is soil response equipment on-site, logically located, and easily accessed in an emergency?
			13. Are emergency response procedures and contact information clearly posted?
			14. Is solid waste properly contained?
			15. Is the spill area provided to the solid waste storage and pick-up area?
			16. Are hazardous materials, waste or otherwise, being properly handled and stored?
			17. Have personnel recommended corrective actions been implemented?

If you answered "no" to any of the above questions, describe any corrective action which must be taken to remedy the problem and when the corrective actions are to be completed.

REPORT SAMPLE

SPILL PREVENTION AND RESPONSE

Purpose: Procedures and practices to prevent and control spills in a manner that minimizes or eliminates the discharge of spilled material to the drainage system or watercourses.

Hazardous Waste Products:

- Petroleum Products,
- Asphalt Products,
- Concrete Curing Compounds,
- Pesticides,
- Acids,
- Paints,
- Stains,
- Solvents,
- Wood Preservatives,
- Roofing Tar, or

Other Waste Products:

- Soil stabilizers/binders
- Dust palliatives
- Herbicides
- Growth inhibitors
- Fertilizers
- Deicing/anti-icing chemicals
- Fuels
- Lubricants
- Other petroleum distillates

Any materials deemed a hazardous waste in 40 CFR Parts 110, 117, 261, or 302

Spill Prevention Practices:

- The following are management practices used for reduction of spills and other accidental exposure of materials and substances to storm water runoff:
- a. The contractors and subcontractors shall refer to the Material Safety Data Sheet (MSDS) for information on the proper storage, use, and clean-up methods for all materials anticipated being on the project site.
 - b. All required materials for spill clean up and disposal of all onsite materials shall be kept on site in a project trailer with easy access for all users of associated materials.
 - c. All disposals of spilled materials shall be done in accordance with Federal, State and Local waste disposal regulations. All contractors and subcontractors shall be responsible for any and all spills associated with their work.
 - d. Prompt cleanup of any spills that may occur of liquid or dry materials.
 - e. Cleanup of sediments that have been tracked by vehicles or have been transported by wind or storm water about the site or onto nearby roadways.

Response Practices:

In the event that a large spill occurs (that which requires extensive cleanup actions, refer to MSD sheets for information), the following procedures shall be followed to minimize exposure of the material.

- a. Immediate action shall be taken to control and contain the spill to prevent it from entering any nearby storm sewer structures or open waters.
- b. Notify the Town of Munster Fire Department at 911 for all combustible and flammable materials.
- c. Notify the Federal Emergency Spill Hotline at 1-800-424-8802 within 2 hours for spills above the reported allowable quantity, or if the material enters any nearby storm sewer structures or open waters.
- d. Notify the Indiana Emergency Response Hotline at 1-888-233-7745.
- e. The spill area shall be isolated from all surrounding areas with absorbent pads, booms, and pillows designed for the use of spill containment and absorption.
- f. The spill kits that are required to be on site shall be used.
- g. Emergency Response teams shall be contacted for extensive spills above and beyond the containment by available methods.


Waste Disposal Management Practices:

All solid waste associated with the construction and development of this project shall be removed and disposed of properly with in all applicable state and federal laws associated with the waste generated. Developer and/or contractor are to provide on-site dumpsters, rented from a licensed solid waste management company, to ensure waste is collected and disposed of properly. All trash and construction debris from the site will be deposited in a dumpster. No construction waste will be buried onsite. All personnel will be instructed regarding the correct procedure for waste disposal.

- a. Select a designated waste collection area onsite.
- b. Provide an adequate number of containers with lids or covers throughout the site, and frequent pickups
- c. Provide immediate cleanup of any container spills.
- d. Make sure that construction waste is collected, removed, and disposed of only at authorized areas.

BASKET INLET / CATCH BASIN PROTECTION

- Purpose:** To prevent excessive sediment from entering storm sewers at inlet/catch basin, allowing full use of the storm drain system during the construction period.
- Requirements:** Steel Frame with top width-length dimensions such that the basket fits into the inlet and/or catch basin (circular and/or rectangular), and a replaceable Geotextile fabric bag attached with a steel band locking cap that is suspended from the frame, **Catch-all Inlet Protector Hancor Flo-Gard ht Nyloplast** or approved equal.
- Installation:**
1. Install protection to existing and newly installed inlet/catch basin in a new development before land disturbing activities begin in a stabilized area.
 2. Remove the grate, and place the basket assembly under the grate on the lip of the structure frame.
 3. Replace the inlet/catch basin grate.
- Maintenance:**
1. Inspect weekly during construction and after each storm event of a minimum of 1/2 inch rainfall, and remove built-up sediment.
 2. Replace bag every six (6) months.
 3. Replace the Geotextile fabric bag if there is a hole and/or won't pass water.
 4. Replace the Geotextile fabric bag after any oil, gasoline or solvent spill.

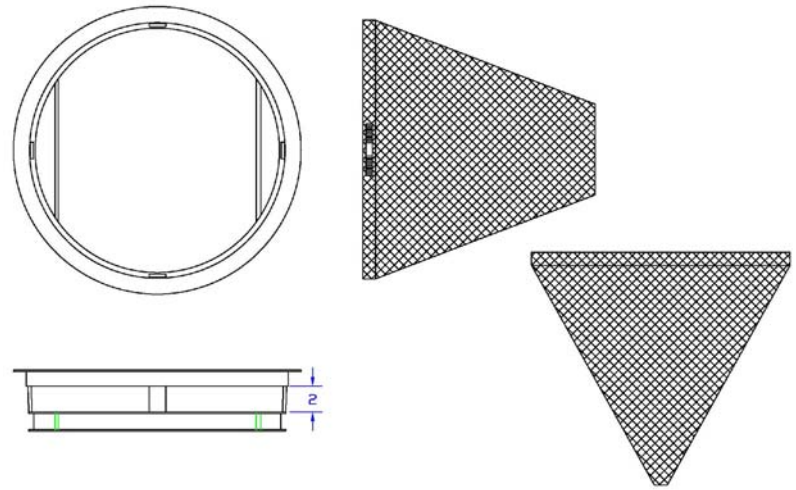

GENERAL NOTES:
FRAME: Top Flange fabricated from 1/8"x1/8"x1/8" angle. Base rim fabricated from 1/8"x2"x1/8" channel. Handles and suspension brackets fabricated from 1/8"x1/8" flat stock. All steel conforming to ASTM-A36.
SEDIMENT BAG: Bag fabricated from 4 oz./sq.yd. non-woven polypropylene geotextile reinforced with polyester mesh. Bag secured to base rim with a stainless steel band and lock.

TYPICAL INLET/CATCH BASIN PROTECTION
INSERT DETAIL

STREET AND PARKING LOT SWEEPING



- Purpose:** To reduce the amount of pollutants that get washed into the storm drain and ultimately transported and deposited in waterbodies.
- Application:**
1. Sweeping at points of egress where sediment is tracked from project site onto public or private streets and roads.
- Limitations:**
1. Sweeping may be ineffective if soil is wet or heavy accumulation of mud.
 2. May require repeat cleanings.
- Maintenance:**
1. Inspect potential sediment tracking ingress and egress points locations daily, and after rain events.
 2. Visible sediment observed outside the construction limits shall be swept and removed daily.
 3. Do not use kick brooms or sweeper attachments. These tend to spread the dirt rather than remove it.
 4. If not mixed with debris or trash, consider incorporating the removed sediment back into the project.
 5. Be careful not to sweep up any unknown substance or any object that may be potentially hazardous.
 6. Adjust brooms frequently; maximize efficiency of sweeping operations.
 7. After sweeping is finished, properly dispose of sweeper wastes at an approved dumpsite.

SILT FENCE


- Purpose:** To retain sediment from small sloping disturbed areas by reducing the velocity of sheet flow.
- Requirements:** Trench: 6" minimum depth, flat bottom, filled with compacted soil to bury lower portion of fence fabric.
- Support : 2" x 2" hardwood stakes set at least 8-inches to 12-inches deep.
- Spacing of Support: 6-foot maximum on center.
- Fence height: A 2-ft. minimum or high enough so depth of impounded water does not exceed one-half the height of the fence at any point along the line.
- Attachment: Hardwood laths secured to stakes with five (5) 1-1/2 inch staples.
- Fence Fabric: Spunbound polyester material with a fiberglass scrim or net sandwiched in between the layers, **SS-700 SiltSaver** or approved equal.

- Installation:**
1. Along the entire intended fence line, maintain contour as much as possible, dig a 6" deep flat bottom trench.
 2. On the downslope side of the trench, drive the post 8" to 12" into the ground.
 3. Run a continuous length of fence fabric along upslope side of posts.
 4. Fasten fence fabric to the upslope side of the stakes, extending it into the trench, and securing it with hardwood laths secured with five (5) 1-1/2 staples. The bottom 12" of the fence fabric shall be left unsecured to allow for entrenchment.
 5. If a joint is necessary, staple the overlap to the nearest post with a wood lath.
 6. Place the bottom 1' of fabric in the 6" deep trench, extending the remaining 4" of fabric toward the upslope side.
 7. Backfill the trench with compacted earth.

- Maintenance:**
1. Inspect silt fence once every seven calendar days and 24 hours after each storm event of minimum of 1/2 inch rainfall.
 2. If fence fabric tears, starts to decompose, or becomes ineffective, replace the affected portion, as outlined by the manufacturer.
 3. Remove deposited sediment when it reaches one-half the height of the fence at its lowest point or is causing the fabric to bulge.
 4. Take care to avoid undermining the fence during clean out.
 5. After watershed has been stabilized, remove fence and sediment deposits, bring the disturbed area to grade and stabilize.

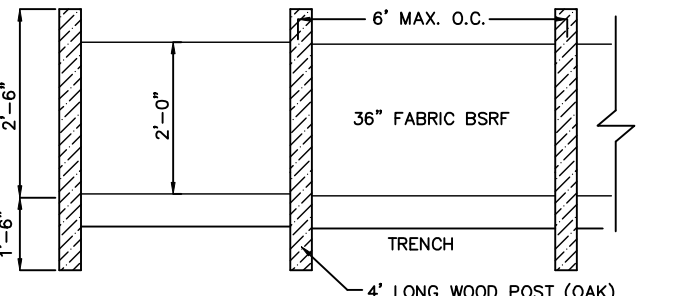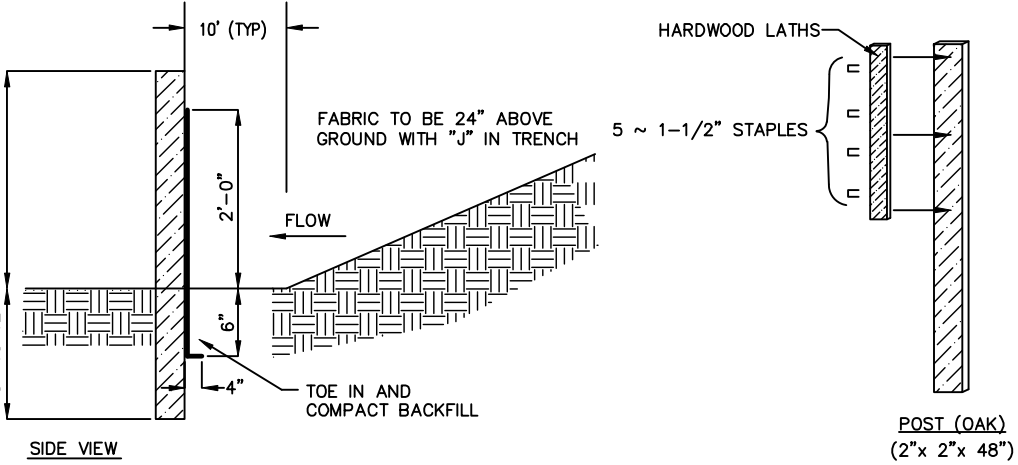

FRONT ELEVATION
BELTED SILT RETENTION FENCE

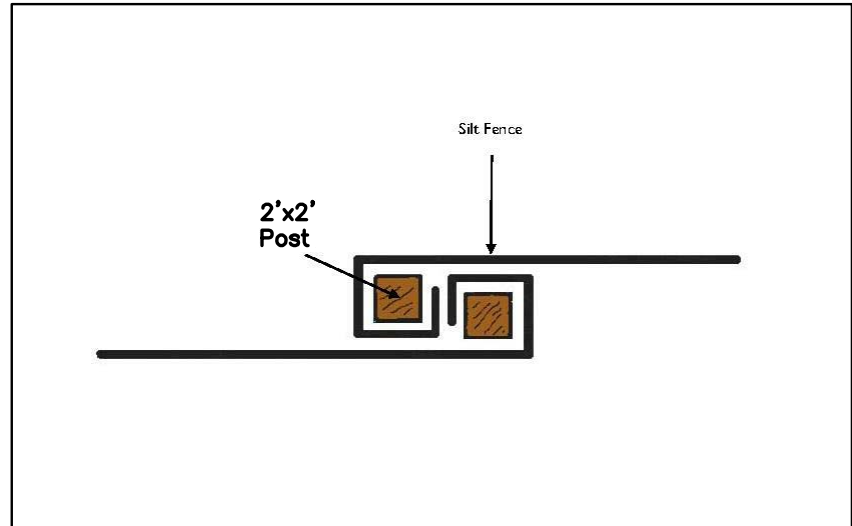

Silt Fence Wrap Joint Detail

TOPSOIL SALVAGE & UTILIZATION

- Purpose:** To provide a method of preserving topsoil for use in establishing vegetation to achieve final site stabilization.
- Specifications:** Material: Typically the darker, friable, loamy surface layer of soil found immediately below vegetation.
- Storage Area
1. Free of stumps, rock, and construction debris.
 2. Stockpile covered with vegetation or a tarp.
 3. Surrounded by a sediment barrier or sediment filter.
 4. Stockpile outside rooting zone of trees to be protected.

- Application:** Salvaging and Stockpiling Topsoil
1. Determine depth and suitability of topsoil at site.
 2. Prior to stripping topsoil, install any site-specific down slope measures needed to control storm water runoff and sedimentation.
 3. Remove soil material no deeper than the "surface soil".
 4. Stockpile the material in accessible locations that will not interfere with other construction activities or block drainage.
 5. Stockpiled soil should be temporarily seeded and surrounded by a sediment control measure.

- Spreading Topsoil
1. Prior to applying topsoil, grade the subsoil and roughen the top three to four inches by disking.
 2. Apply topsoil evenly to a depth of a minimum of four inches, then compact slightly to improve contact with the subsoil.
 3. Do not apply topsoil when the site is wet, muddy, or frozen.
 4. After spreading the topsoil, grade and stabilize the site.

- Maintenance:**
1. Inspect daily.
 2. Check for damage to perimeter barrier; repair immediately.
 3. Check for erosion or damage to newly spread topsoil; repair immediately and revegetate.

CONCRETE WASHOUT


- Purpose:** To reduce the discharge of pollutants associated with concrete waste through consolidation of solids and retention of liquids.
- Requirements:**
- 1.) Locate concrete washout systems at least 50 feet from any creeks, wetlands, ditches, karst features, or storm drains/manmade conveyance systems.
 - 2.) Locate concrete washout systems in relatively flat areas with established vegetative cover and do not receive runoff from adjacent land areas.
 - 3.) Locate in areas that provide easy access for concrete trucks and other construction equipment.
 - 4.) Locate away from other construction traffic to reduce the potential for damage to the system.
 - 5.) Minimum of ten millimeter polyethylene sheeting that is free of holes, tears, and other defects. The sheeting selected should be of an appropriate size to fit the washout system without seams or overlap of the lining.
 - 6.) Signage.
 - 7.) Orange safety fencing or equivalent.
 - 8.) Straw bales, sandbags (bags should be ultraviolet-stabilized geotextile fabric), soil material, or other appropriate materials that can be used to construct a containment system (above grade systems).

- Installation:**
- 1.) Dependent upon the type of system, either excavate the pit or install the containment system.
 - 2.) A base shall be constructed and prepared that is free of rocks and other debris that may cause tears or punctures in the polyethylene lining.
 - 3.) Install the polyethylene lining. For excavated systems, the lining should extend over the entire excavation. The lining for bermed systems should be installed over the pooling area with enough material to extend the lining over the berm or containment system. The lining should be secured with pins, staples, or other fasteners.
 - 4.) Place flags, safety fencing, or equivalent to provide a barrier to construction equipment and other traffic.
 - 5.) Place a non-collapsing, non-water holding cover over the washout facility prior to a predicted rainfall event to prevent accumulation of water and possible overflow of the system (optional).
 - 6.) Install signage that identifies concrete washout areas.
 - 7.) Post signs directing contractors and suppliers to designated locations.

- Maintenance:**
- 1.) Inspect daily and after each storm event.
 - 2.) Inspect the integrity of the overall structure including, where applicable, the containment system.
 - 3.) Inspect the system for leaks, spills, and tracking of soil by equipment.
 - 4.) Inspect the polyethylene lining for failure, including tears and punctures.
 - 5.) Once concrete wastes harden, remove and dispose of the material.
 - 6.) Excess concrete should be removed when the washout system reaches 50 percent of the design capacity. Use of the system should be discontinued until appropriate measures can be initiated to clean the structure. Prefabricated systems should also utilize this criterion, unless the manufacturer has alternate specifications.
 - 7.) Upon removal of the solids, inspect the structure. Repair the structure as needed or construct a new system.
 - 8.) Dispose of all concrete in a legal manner. Reuse the material on site, recycle, or haul the material to an approved construction/demolition landfill site. Recycling of material is encouraged. The waste material can be used for multiple applications including but not limited to roadbeds and building. The availability for recycling should be checked locally.
 - 9.) The plastic liner should be replaced after every cleaning; the removal of material will usually damage the lining.
 - 10.) The concrete washout system should be repaired or enlarged as necessary to maintain capacity for concrete waste.
 - 11.) Concrete washout systems are designed to promote evaporation. However, if the liquids do not evaporate and the system is near capacity it may be necessary to vacuum or remove the liquids and dispose of them in an acceptable method. Disposal may be allowed at the local sanitary sewer authority provided their National Pollutant Discharge Elimination System permits allow for acceptance of this material. Another option would be to utilize a secondary containment system or basin for further dewatering.
 - 12.) Prefabricated units are often pumped and the company supplying the unit provides this service.
 - 13.) Inspect construction activities on a regular basis to ensure suppliers, contractors, and others are utilizing designated washout areas. If concrete waste is being disposed of improperly, identify the violators and take appropriate action.
 - 14.) When concrete washout systems are no longer required, the concrete washout systems shall be closed. Dispose of all hardened concrete and other materials used to construct the system.
 - 15.) Holes, depressions and other land disturbances associated with the system should be backfilled, graded, and stabilized.

CONCRETE WASHOUT


Concrete Washout (Above Grade System) Worksheet

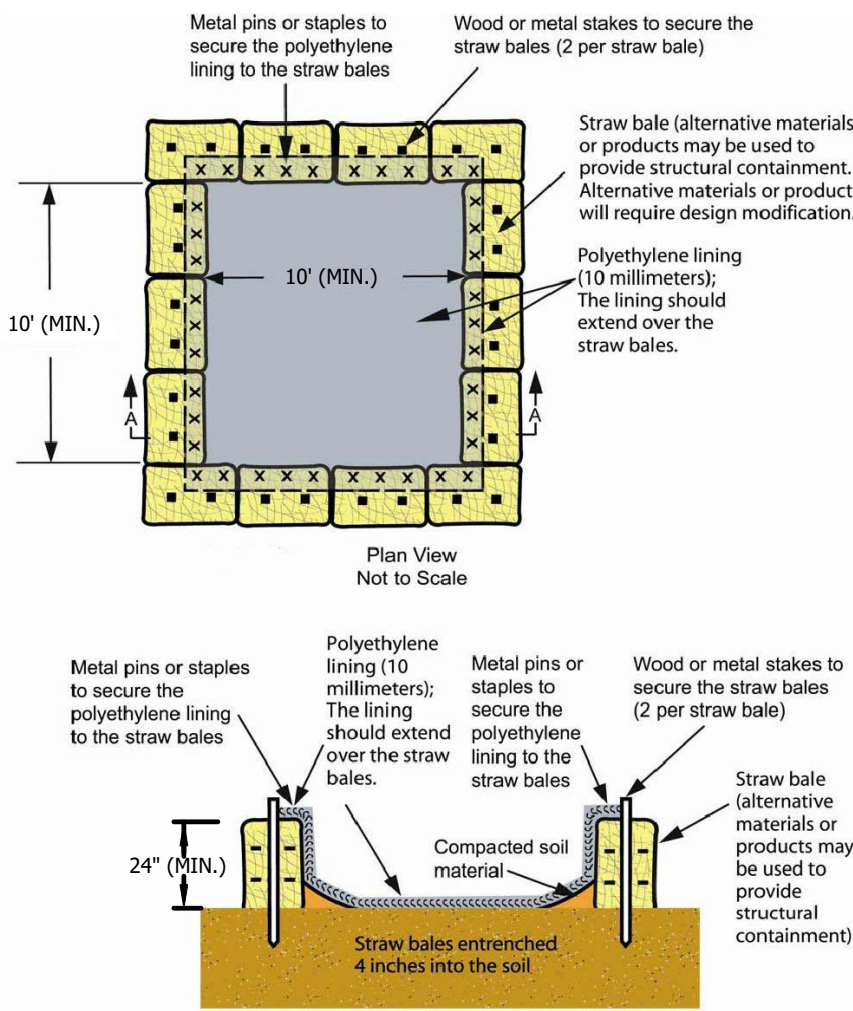

254 Chapter 7 October 2007

CONCRETE WASHOUT

Concrete Washout (Below Grade System) Worksheet

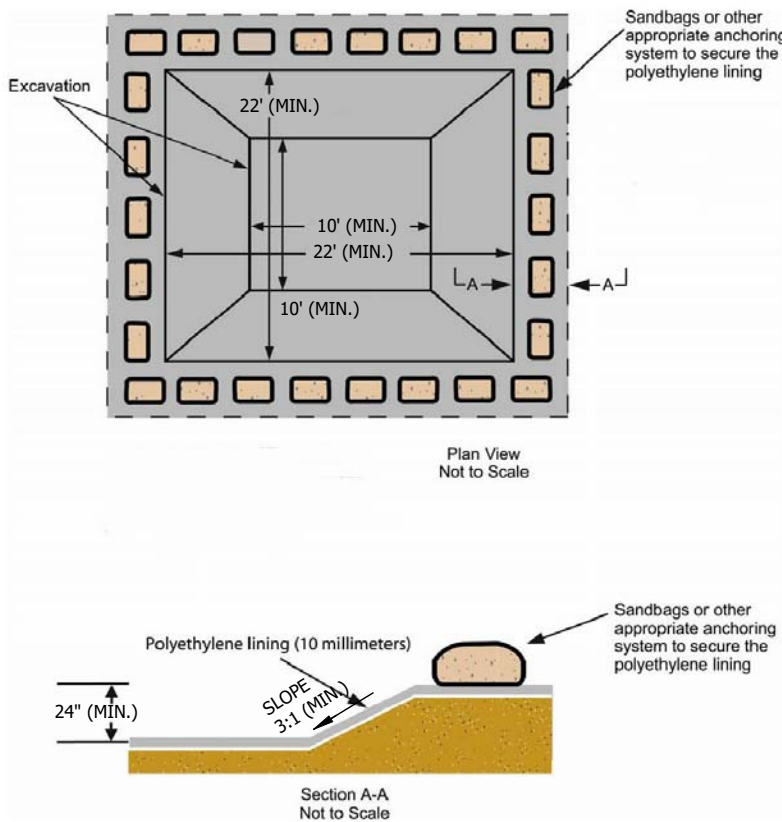

October 2007 Chapter 7 255




MAPLE LEAF CROSSINGS
A PLANNED UNIT DEVELOPMENT TO THE
TOWN OF MUNSTER, LAKE CO., INDIANA
SWPPP DETAILS & SPECIFICATIONS

CLIENT: Metropolitan Builders
First 400 Fisher Avenue
Munster, Indiana 46321


JOB NO: 2019-5052
SCALE: NTS

SHEET
C-7.1

TORRENGA ENGINEERING, INC.
CONSULTING ENGINEERS & LAND SURVEYORS
907 RIDGE ROAD, MUNSTER, INDIANA 46321
Tel. No.: (219) 836-8918
website: www.torrenza.com

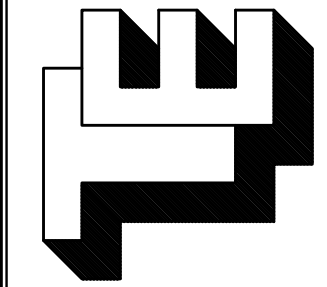

FILE NO:Z:\2019-5052 Jay Lieser - Maple Leaf Crossings Calumet Avenue - Munster.dwg 2019-5052.dwg 5/10/2020 2:20:27 PM CDT

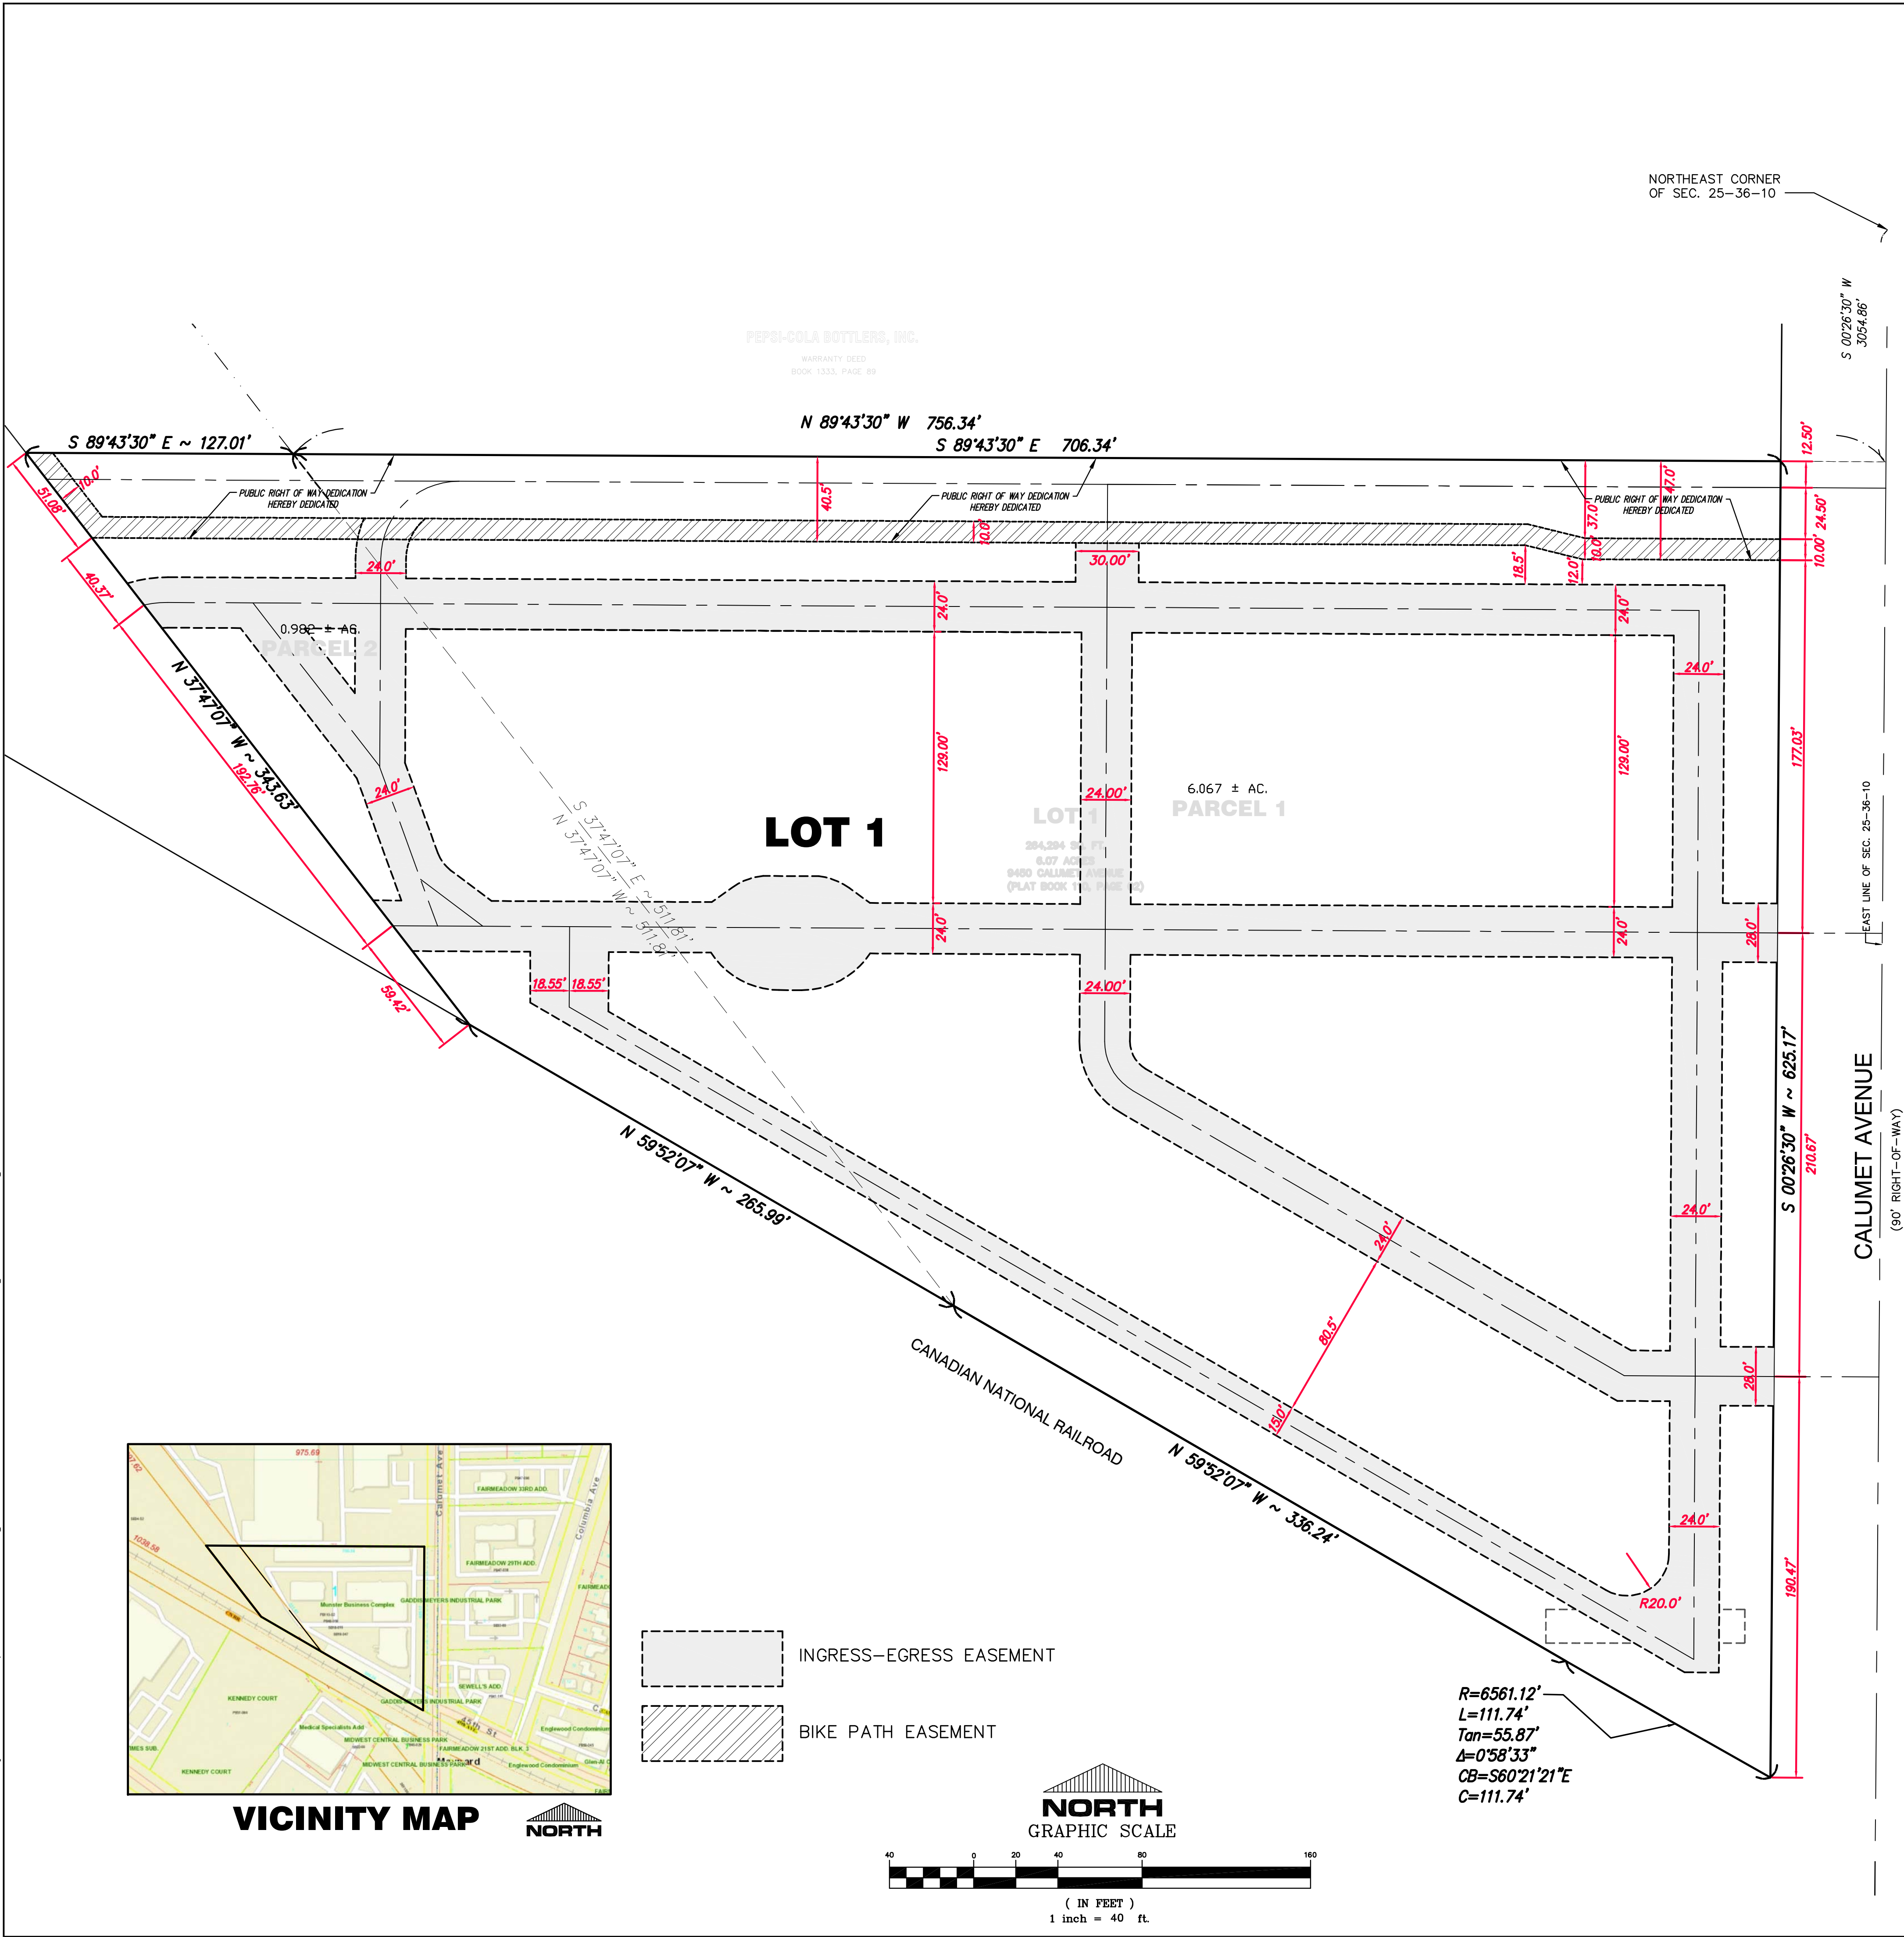

MAPLE LEAF CROSSINGS

A PLANNED UNIT DEVELOPMENT TO THE TOWN OF MUNSTER, LAKE COUNTY, INDIANA

Legal Descriptions:
PARCEL 1
Lot 1 in Munster Business Complex, a Planned Unit Development, in the Town of Munster, as per plat thereof, recorded in Plat Book 110, page 02 in the Office of the Recorder, Lake County, Indiana.
PARCEL 2
Part of the Southeast Quarter of Section 25, Township 36 North, Range 10 West of the Second Principal Meridian, lying West of Lot 1 in Munster Business Complex, a Planned Unit Development, in the Town of Munster, as per plat thereof, recorded in Plat Book 110, page 02 in the Office of the Recorder, Lake County, Indiana, and North of Canadian National Railroad right-of-way, being more particularly described as follows:
Commencing at the Northeast corner of said Section 25; thence South 00° 26' 30" West, along the East line of said Section 25, a distance of 3,054.86 feet; thence North 89° 43' 30" West, along the North line of said Lot 1 extended East, a distance of 756.34 feet to the Northwest corner of said Lot 1 and also being point of beginning; thence South 37° 47' 07" East, along the West line of said Lot 1, a distance of 511.81 feet to the Southwest corner of said Lot 1; thence North 59° 52' 07" West, along the Northerly line of said Canadian National Railroad right-of-way (100 feet wide), a distance of 265.99 feet; thence North 37° 47' 07" West, a distance of 343.63 feet; thence South 89° 43' 30" East, a distance of 127.01 feet to the point of beginning, containing 0.982 acres, more or less, all in the Town of Munster, Lake County, Indiana.

STATE OF INDIANA)
COUNTY OF LAKE)
We, the undersigned, Maple Leaf Crossings, LLC, do hereby certify that we are the owner of the property herein described and that of its own free will and accord has caused said property to be surveyed and subdivided into lots, blocks and streets as heron shown.
This subdivision shall be known and designated as MAPLE LEAF CROSSINGS, a Planned Unit Development to the Town of Munster. All streets and easements shown and not heretofore dedicated, are hereby dedicated, to the Town of Munster.

Maple Leaf Crossings, LLC
Jay Lieser, Principal
STATE OF INDIANA)
COUNTY OF LAKE)
Before me, the undersigned Notary Public, in and for the County and State aforesaid, personally appeared Jay Lieser, on behalf of Maple Leaf Crossings, LLC, personally known to me to be the same persons who signed the attached certificate and acknowledged to me that he executed the same as his own free act and deed.
Witness my hand and Notarial Seal this _____ day of _____, 20____ A.D.
My Commission expires: _____
County of Residence: _____ Notary Public
STATE OF INDIANA)
COUNTY OF LAKE)
Submitted to, approved and accepted by the Plan Commission of the Town of Munster, Lake County, Indiana, this _____ day of _____, 20____.
PLAN COMMISSION OF THE TOWN OF MUNSTER, LAKE COUNTY, INDIANA.
Chairman: _____ ATTEST: _____
Executive Secretary: _____
STATE OF INDIANA)
COUNTY OF LAKE)
I, Gary P. Torrenga, hereby state that I am a registered Land Surveyor, licensed in compliance with the laws of the State of Indiana; and that to the best of my knowledge, information and belief, the plat within represents a survey made under my direction in accordance with Title 865, Article 1, Rule 12 of the Indiana Administrative Code. The field work for said survey was completed on March 25, 2020; that this plat correctly represents said survey and that all dimensions, linear and angular are correctly shown, and that all monuments or markers shown thereon actually exist, and that their locations, size, type and description are accurately shown. I affirm, under the penalties for perjury, that I have taken reasonable care to redact each Social Security Number in this document, unless required by law.
Witness my hand and Seal this _____ day of _____, 20____.

TORRENGA ENGINEERING, INC.
Gary P. Torrenga - Registered L.S. #S0514
GARY P. TORRENGA
REGISTERED
No. S0514
STATE OF INDIANA
LAND SURVEYOR

UTILITY EASEMENTS:
An easement is hereby granted to the Town of Munster, Indiana, SBC, AT&T, Northern Indiana Public Service Company and other companies identified by the Munster Town Board as supplying public service needs severally and their respective successors and assigns to install, lay, erect, construct, renew, operate, repair, replace and maintain sewers, water mains, gas mains, conduits, cables, poles and wires, underground with all necessary braces, guys, anchors and other appliances, in, upon, along and over the strip or strips of land designated by dotted lines on the plat and marked "easements for public utilities" for the purpose of serving the public in general with sewer, water, gas, electric, telephone and television service, including aerial right as to streets where necessary with aerial service wires to adjacent lots, together with the right to enter upon the said easements for public utilities at all times for any and all of the purposes aforesaid and to trim and keep trimmed any trees, shrubs, or saplings that interfere with any such utility equipment. Any fences, trees, black topings, vegetation improvements or other potential obstacles to the use of easements shown upon the subdivision plat shall be placed at the risk of the property owner and may be subject to removal in the event of any interference with the use of said easements or drainage of other lots. Changes of yard elevations in easements from those established upon the subdivision plat or noted on plats submitted and approved when building permits are issued that adversely impact drainage of adjoining lots shall be subject to regrading at the owner's expense. All designated utility easements are also hereby dedicated as drainage easements.

FLOOD STATEMENT:
As taken from FEMA Flood Insurance Rate Map (FIRM), Community-Panel Number 18089C0117E, Effective Date January 18, 2012, this property is in Flood Zone X, areas determined to be outside the 0.2 % annual chance floodplain.

TORRENGA ENGINEERING, INC.

CONSULTING ENGINEERS & LAND SURVEYORS

907 RIDGE ROAD, MUNSTER, INDIANA 46321

website: www.torrenga.com

Tel. No.: (219) 836-8918

MAPLE LEAF CROSSINGS

A PLANNED UNIT DEVELOPMENT TO THE

TOWN OF MUNSTER, LAKE CO., INDIANA

FINAL PLAT

CLIENT: Metropolitan Builders
400 Fisher Avenue
Munster, Indiana 46321

JOB NO: 2019-5052


SCALE: 1" = 40'

SHEET

1 of 1

Luminaire Locations						
Location						
No.	Label	X	Y	MH	Orientation	Tilt
1	A	409.25	353.75	18.00	270.00	0.00
2	A	322.00	498.25	18.00	180.00	0.00
3	A	484.50	498.50	18.00	180.00	0.00
4	A	610.50	498.50	18.00	180.00	0.00
5	A	779.75	498.00	18.00	180.00	0.00
6	A	906.00	497.00	18.00	180.00	0.00
7	A	1038.00	365.25	18.00	270.00	0.00
8	A	1038.00	248.25	18.00	270.00	0.00
9	A	1037.50	122.00	18.00	270.00	0.00
10	A	1037.00	-4.00	18.00	270.00	0.00
11	A	944.50	-38.50	18.00	30.00	0.00
12	A	810.25	39.50	18.00	30.00	0.00
13	A	694.00	106.75	18.00	30.00	0.00
14	A	559.50	185.25	18.00	30.00	0.00
15	A	449.25	250.25	18.00	30.00	0.00
16	A	307.25	429.25	18.00	30.00	0.00
17	A	532.25	275.75	18.00	0.00	0.00
18	A	652.75	274.75	18.00	0.00	0.00
19	A	774.75	274.25	18.00	0.00	0.00
20	A	899.50	273.25	18.00	0.00	0.00
21	A	780.25	254.00	18.00	210.00	0.00
22	A	847.00	215.50	18.00	210.00	0.00
23	A	908.75	180.25	18.00	210.00	0.00
24	A	720.00	208.00	18.00	30.00	0.00
25	A	977.75	66.00	18.00	30.00	0.00
26	A	550.25	348.25	18.00	180.00	0.00
27	A	652.50	349.75	18.00	180.00	0.00
28	A	821.25	345.25	18.00	180.00	0.00
29	A	941.00	344.25	18.00	180.00	0.00
30	A	398.25	444.50	18.00	0.00	0.00
31	A	705.75	443.50	18.00	0.00	0.00
32	A	988.25	439.75	18.00	0.00	0.00
33	A	766.25	384.00	18.00	270.00	0.00

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Calc Zone #1	+	0.9 fc	3.6 fc	0.0 fc	N/A	N/A

Schedule									
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp
	A	33	Stenberg Lighting	MS805B LED-4A1R45T3-MD_03-CA	Main Street Series, MS805 Post Top, Type 3 Optic, Clear Acrylic	82 LEDs	1	MS805_LED-4A1R45T3-MD_05-CA.IES	9220
									Light Loss Factor
									0.95
									Wattage
									142.7

